

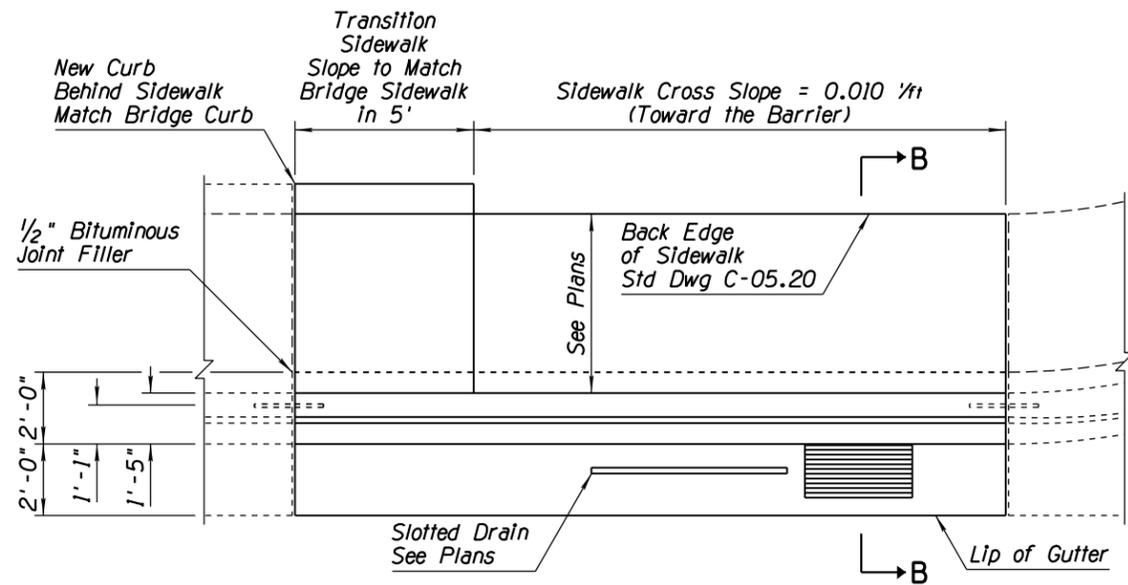


Note to Designer: The information presented in this Standard Drawing has been prepared in accordance with recognized engineering principles and is for general use. It should not be used for specific application without competent professional examination and verification of its suitability and applicability by a licensed professional engineer. Contents within the inner border line shall not be altered.

PRIOR DISTRIBUTION DATE 05/12

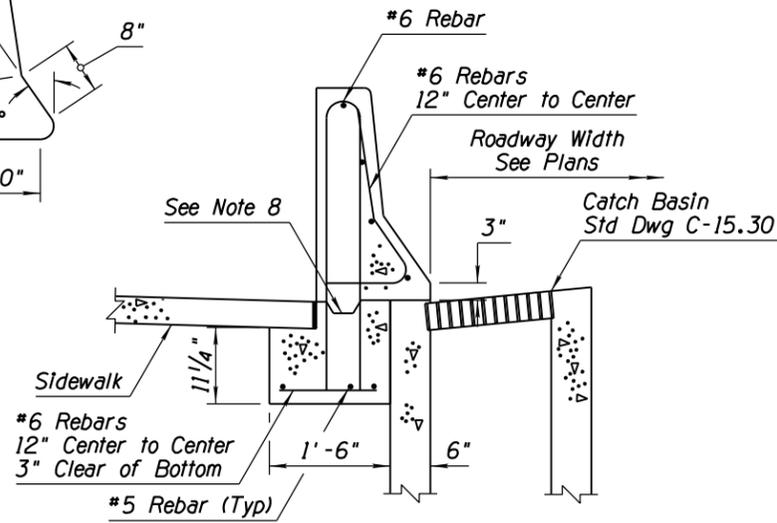


PLAN VIEW




SECTION B-B AT CATCH BASINS


- ### GENERAL NOTES
- Barrier concrete shall be Class S, $f'c=4500$ PSI.
 - Rebar shall be Grade 60.
 - Rebar shall have 2" minimum clear cover unless otherwise noted.
 - See drainage sheets for slotted drain and catch basin details.
 - Departure termination may be substituted for Std Dwg C-10.76 barrier transition under departure conditions.
 - See Std Dwg C-05.20 for sidewalk construction.
 - All bend dimensions for rebar are out-to-out of rebars.
 - See Std Dwg C-10.54 for Keyway Details.

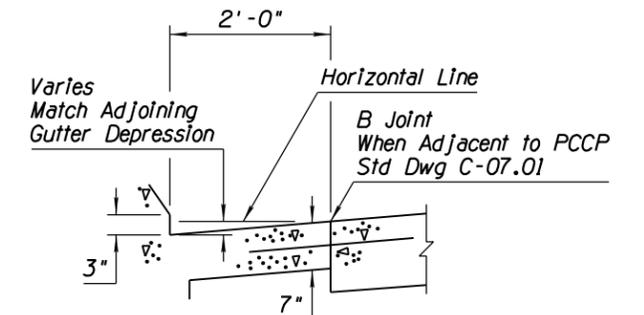



BARRIER GUTTER DETAIL

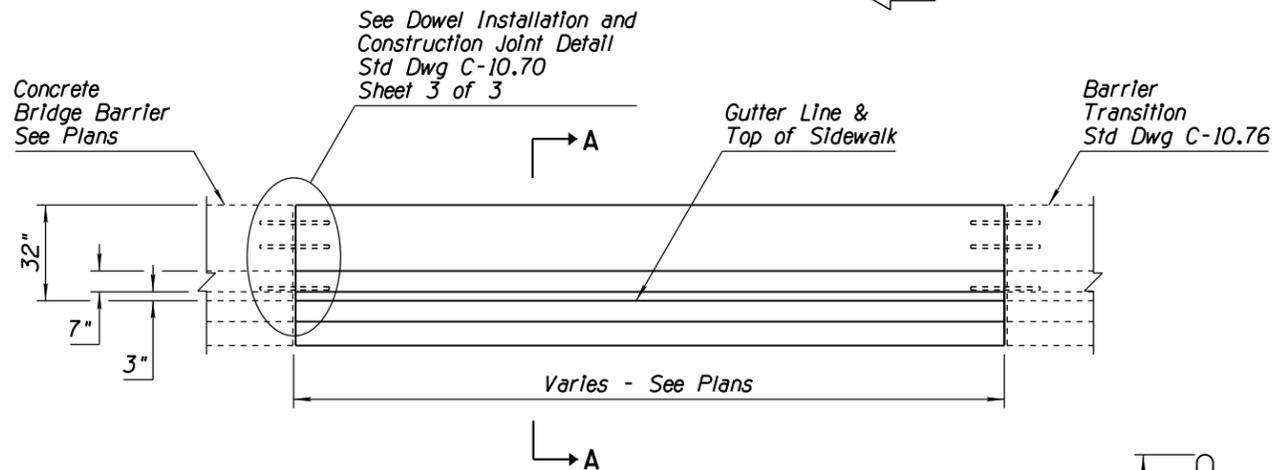

ELEVATION

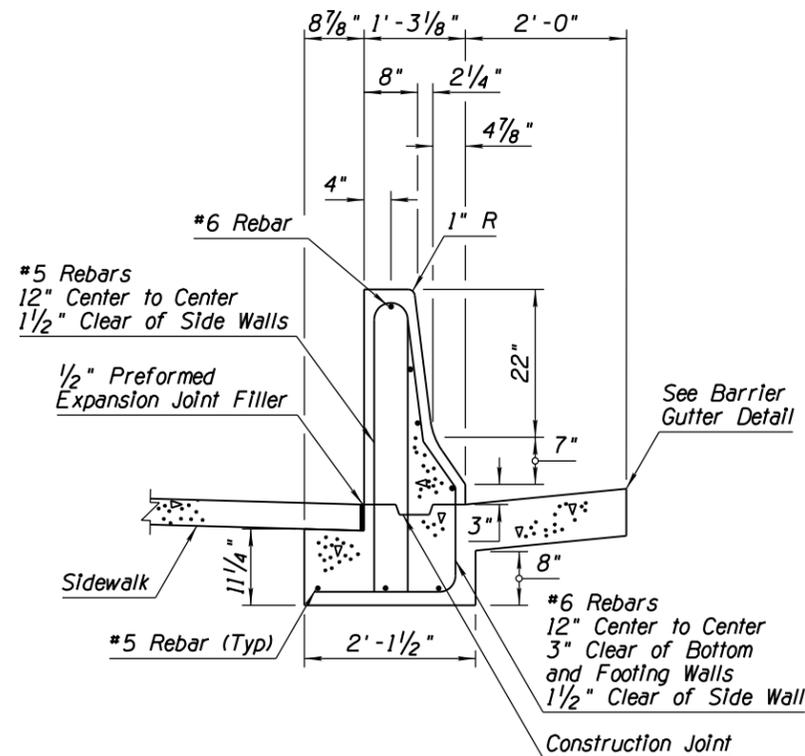

SECTION A-A

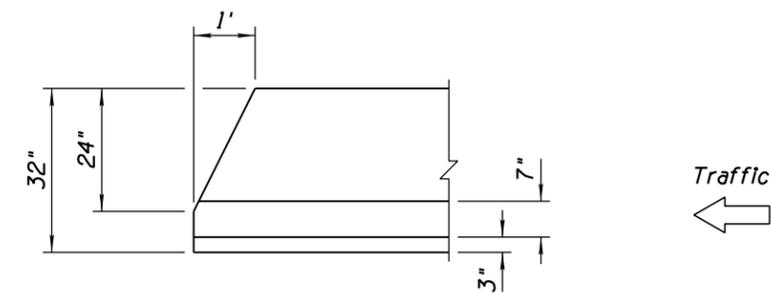

ELEVATION DEPARTURE TERMINATION WITHOUT GUARDRAIL

STANDARDS ENGINEER J. C. COOPER	ARIZONA DEPARTMENT OF TRANSPORTATION INFRASTRUCTURE DELIVERY AND OPERATIONS DIVISION ROADWAY GROUP STANDARD DRAWING
RECOMMENDED FOR APPROVAL GROUP MANAGER D. R. HENRY	
APPROVED	CONCRETE HALF BARRIER 32" TYPE 'F' WITH SIDEWALK
STANDARDS COMMITTEE APPROVED FOR DISTRIBUTION	DRAWING NO. C-10.51

DATE 12/17