



Note to Designer: The information presented in this Standard Drawing has been prepared in accordance with recognized engineering principles and is for general use. It should not be used for specific application without competent professional examination and verification of its suitability and applicability by a licensed professional engineer. Contents within the inner border line shall not be altered.


PRIOR DISTRIBUTION DATE 05/12

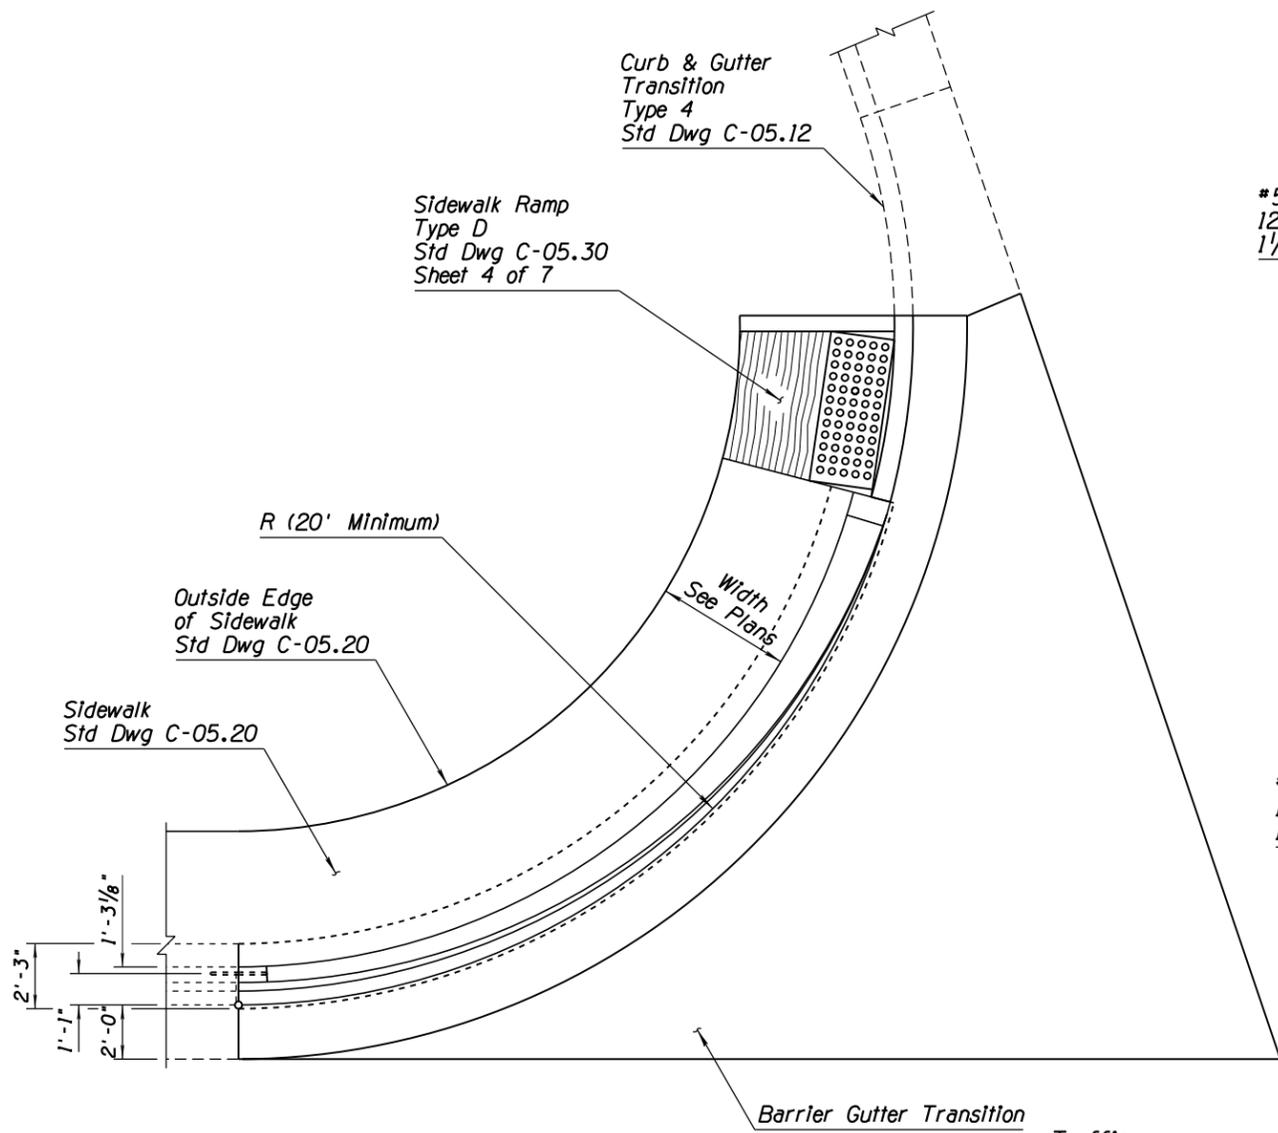


PLAN

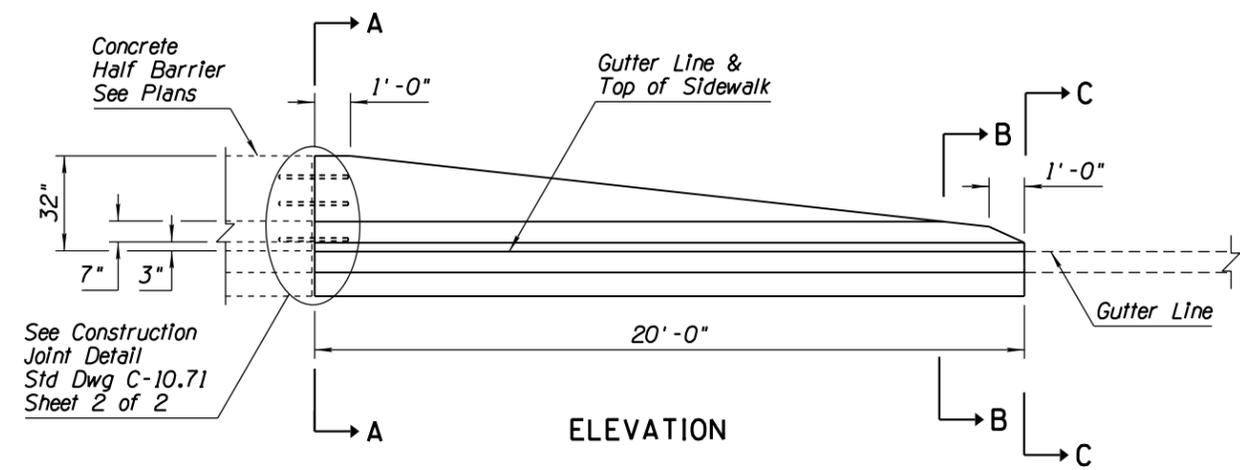


ELEVATION

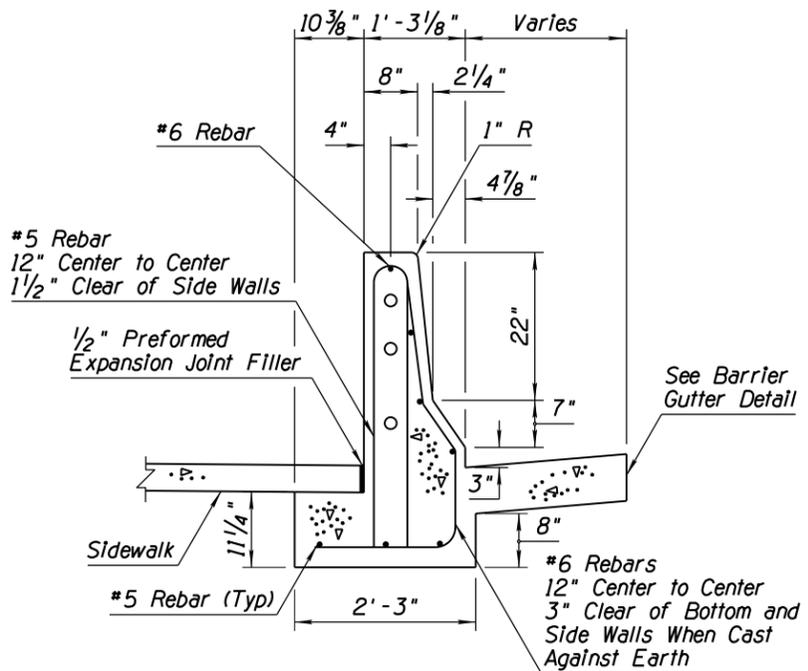

SECTION A-A

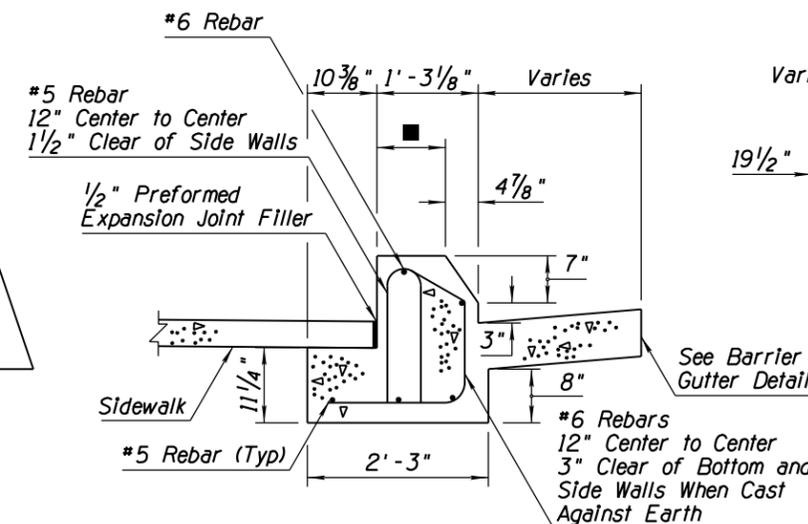


SECTION B-B

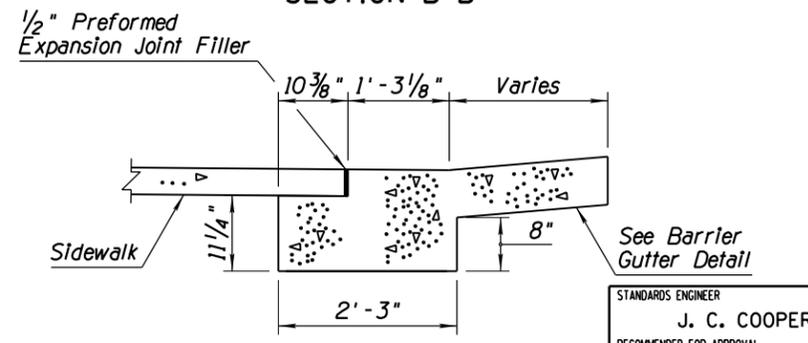

SECTION C-C

GENERAL NOTES

1. Barrier concrete shall be Class S,  $f'c=4500$  PSI.
  2. Rebar shall be Grade 60.
  3. All rebar shall have 2" minimum clear cover unless otherwise noted.
  4. See drainage sheets for slotted drain and catch basin details.
  5. Barrier transition shall match the adjoining concrete half barrier.
  6. See Std Dwg C-05.20 for sidewalk construction.
  7. All bend dimensions for rebar are out-to-out of bars.
- Varies;  $10\frac{1}{4}"$  to  $1'-0\frac{5}{8}"$  to  $1'-3\frac{1}{8}"$

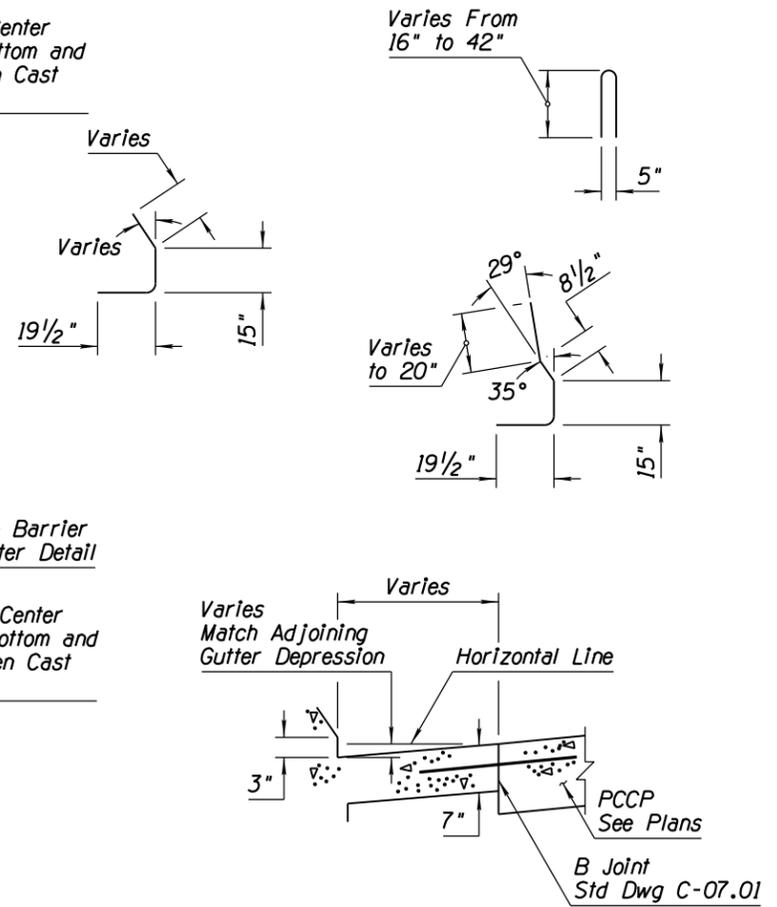

BARRIER GUTTER DETAIL

STANDARDS ENGINEER J. C. COOPER	ARIZONA DEPARTMENT OF TRANSPORTATION INFRASTRUCTURE DELIVERY AND OPERATIONS DIVISION ROADWAY GROUP STANDARD DRAWING	
RECOMMENDED FOR APPROVAL GROUP MANAGER D. R. HENRY	CONCRETE HALF BARRIER TRANSITION TYPE 'F' AT RADIUS 32" TO 0"	DRAWING NO. C-10.76
APPROVED STANDARDS COMMITTEE APPROVED FOR DISTRIBUTION	12/17 DATE	