
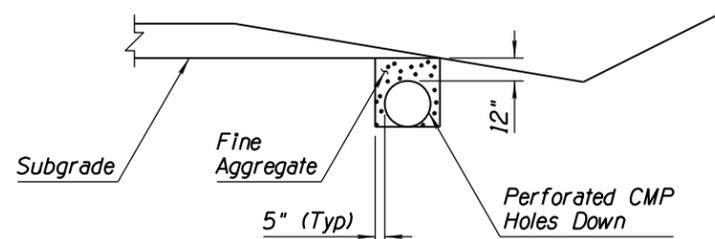


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1	NEW GENERAL NOTE 2	RLF	9/04
2			
3			
4			


**GENERAL NOTES**

1. Minimum cover over pipe culverts shall be 12", measured from the top of pipe.
- ① 2. After welding, the damaged coating shall be cleaned by a wire brush and painted with at least one full coat of Paint Number 4, or given two coats of an approved hot asphalt paint, as directed by the Engineer.

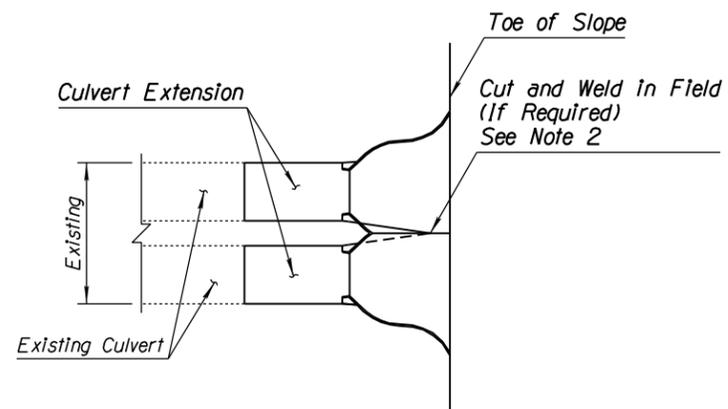


**PERFORATED CMP INSTALLATION**


**SPECIAL MULTIPLE PIPE END SECTION DETAIL FOR PIPE CULVERT EXTENSIONS ONLY**

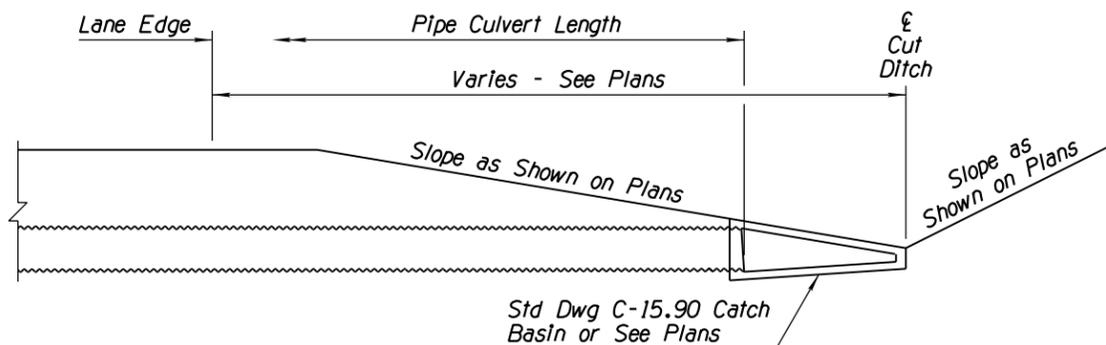

**PIPE AND CATCH BASIN INSTALLATION AT SAG CONDITION OF CUT DITCH**

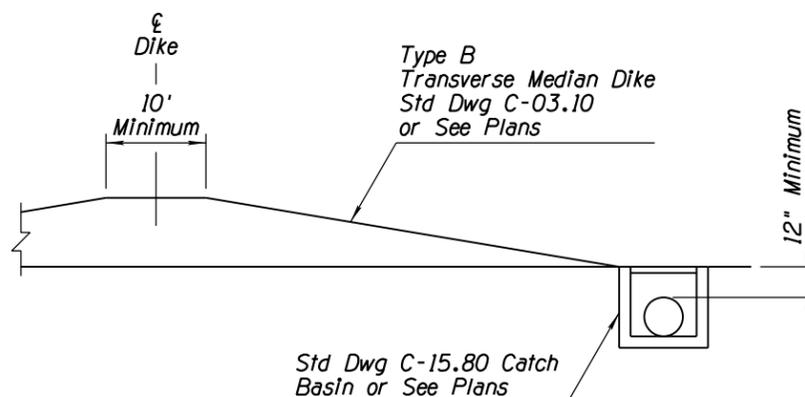

**PIPE AND CATCH BASIN INSTALLATION AT BASE OF TRANSVERSE DIKE**

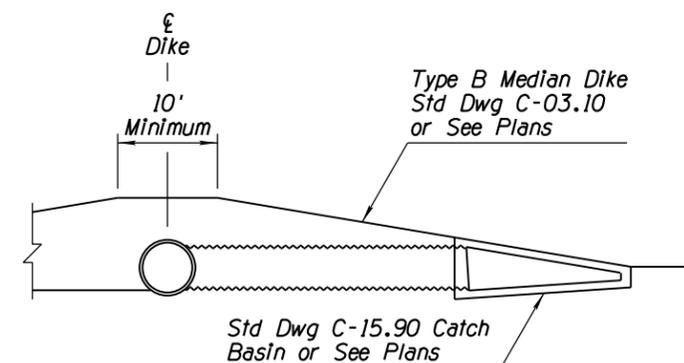

**PIPE AND CATCH BASIN INSTALLATION AT FACE OF TRANSVERSE DIKE**

APPROVED FOR DESIGN 	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	REV. 5/12
APPROVED FOR DISTRIBUTION 	PIPE CULVERT INSTALLATION	DRAWING NO. C-13.10 Sheet 2 of 2