# STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION INTERMODAL TRANSPORTATION DIVISION ROADWAY ENGINEERING ROADWAY DESIGN SECTION

**MAY** 



2007

# CONSTRUCTION STANDARD DRAWINGS



#### Arizona Department of Transportation

### Intermodal Transportation Division Roadway Engineering Group

#### MEMORANDUM

To: All Users of the Roadway Construction Standard Drawings		<b>Date:</b> 21 May 2007	
From: Mary Viparina	] [	Subject: C-Standards New Edition	
Assistant State Engineer  Roadway Engineering Group			

The Roadway Construction Standard Drawings (C-Stds) have been revised and updated, and printed as a new, complete set. Users should obtain the new Construction Standard Drawings (May 2007 cover) from Engineering Records. The new edition has both format and engineering changes. The format change is the most obvious and affects all of the drawings. This change is as follows and is not noted individually in the revision block:

The drawings font size and style, and lines now conform to the ADOT CADD guidelines. Information is contained on the same levels as those prescribed for plan sheets.

Some of the significant engineering changes from the October 2004 edition are the following:

- C-01.10, Sht 1 of 4: changed the order of the various boundary and jurisdictional lines
- C-02.20 and C-02.30: changed the steepest allowable slope for 1-1/2:1 to 2:1
- C-04.10, Sht 2 of 2: new drawing for double inlet in sag condition
- C-04.20, Sht 2 of 2: new drawing for double inlet in sag condition
- C-04.30 and C-04.40: revised tables as a result of slope changes in C-02.20 and C-02.30, and quidance on spillway and downdrain usage from the RDG
- C-05.10: added General Note 7 reading, "Place AB under single curb, valley gutter, and curb & gutter when shown on plans."
- C-05.20, Sht 1 of 2: added General Note 5 reading, "Place AB under driveways when shown on plans."
- C-05.20, Sht 2 of 2: added General Note 5 reading, "Place AB under sidewalks when shown on plans."
- C-05.30, Sht 1 of 7: changed slope rate in Sections A-A and C-C to 15:1; changed maximum ramp length at 15:1 slope to 15 feet
- C-05.30, Shts 2 5 of 7: changed maximum ramp length at 15:1 slope to 15 feet
- C-07.02: revised General Note 1 to read, "Load transfer dowel assemblies shall be used with non-skewed, mainline PCCP joints"
- C-10.00: revised graphics to match Bridge Group's Transition, SD 1.03; thrie-beam approach and departure transitions are now the same
- C-10.30, Sht 2 of 2: added anchor hardware drawings formerly shown on concrete barrier transition drawings
- C-10.32: deleted
- C-10.54 and C-10.55, Shts 1 & 2 of 3: added concrete cap to Section A-A; revised General Note 3 to read, "Longitudinal rebar shall extend 12" past the construction joint at the completion of each incremental pour."
- C-10.70, C-10.71, C-10.72, and C-10.73: removed Thrie-Beam Guardrail Transition System hardware details and added references to Std Dwg C-10.30
- C-11.10, Shts 1 4 of 4: re-issued drawing with additional sheet detailing the clamp
- C-18.10, Sht 1 of 3: added "NOTE TO DESIGNERS" reading, "Per OSHA requirements, special treatments are required for heights exceeding 30 ft."

C-Standards New Edition 21 May 2007 Page 2

Design personnel should incorporate the new edition of the C-Stds into their project plans. For projects at or near completion, where the inclusion of all new standard drawings is not practical, the 1A Sheet must accurately reflect the drawings' correct revision date. Construction personnel should review the drawing revisions for possible implementation on construction projects.

Please arrange for additional copies of the new C-Stds for all users within your Group or District. Additional copies (8-1/2" x 11" or 11" x 17") may be obtained from Engineering Records located at 1655 West Jackson, Room 175, Phoenix, AZ 85007-3217 or by telephoning 602-712-8216.

An updated List of Standards (1A Sheet) is available either from the Roadway Support Desk (602-712-8667 or 602-712–8491) or on-line at the Roadway Design web site at the following address: http://www.azdot.gov/Highways/Rdwyeng/RoadwayDesign/Index.asp

Updated Summary Sheets are also available on-line at the address shown above.

Please distribute this memorandum to all design personnel, project managers, consultants, and other users in your respective Group, District, or Section.

Please direct questions regarding this memo or the updated standards to Kenneth Cooper, P.E., Roadway Standards Engineer, at 602-712-8674.

#### MAV/KRC/krc

c: Roadway Engineering Group
Traffic Engineering Group
Valley Project Management Group
Environmental and Enhancement Group
Districts (10)
Statewide Project Management Group
FHWA
Contracts and Specifications Section
Construction Group
Bridge Group
Maintenance Group

Regional Traffic Engineers (4)
Materials Group
Local Government Section
Engineering Consultant Section
District Permits Office (9)
Engineering Records
Sam Elters
Dan Lance
Sam Maroufkhani
Doug Forstie

#### NOTICE TO READERS: REVISION DATES

This edition of the Roadway Construction Standard Drawings contains both format and engineering changes.

The format changes include font style and size, line weights and terminators, and placing information on the same levels as specified for plan sheets. These changes are universal for all the sheets and are not noted. The revision date for all the format changes is 5/07 and is noted in the title block. This is the revision date shown on the 1A sheet.

Engineering changes have been made to some of the drawings since the last edition was issued in October 2004. These numbered changes are noted in the revision block in the upper left-hand corner of the affected sheets and referenced by circled numbers on the drawings.

Future engineering revisions will be noted in the revision and title blocks, and the 1A sheet.

Standard Names with an asterisk (\*) have recommended Special Provisions associated with them that can be found here. Be sure to review the recommended Special Provisions if you are using any of those drawings.

#### **C-STANDARDS FEEDBACK FORM**

#### \* Required Information

PROJECT: *Project Nam	e/No.:			
Route:	Milepost:		District:	
C-STANDARD: *Number	:	*Sheet No.:	Edition Yr.:	
*COMMENT OR QUEST	ION: Use back of for	m for additional sp	pace	
CONTACT INFORMATIO	<u>)N:</u> *Name:		*Mail Drop.:	
*Phone No.:	Cons	str./Maint./Design(	ORG No.:	
*E-mail Address:				
	For C	ffice Use Only		
ANALYSIS/EVALUATION	N: Use back of form	for additional space	e	
RECOMMENDATION/AC	CTION: Use back of t	form for additional	space	

#### CONSTRUCTION STANDARD DRAWINGS - INDEX

DRAWING NO.	TITLE	DRAWING NO.	TITLE
C-01.10 C-01.30	SYMBOL LEGEND (4 SHEETS) GENERAL ABBREVIATIONS (3 SHEETS)  SLOPES, RURAL DIVIDED HIGHWAYS SLOPES, RURAL UNDIVIDED AND FRINGE-URBAN HIGHWAYS SLOPES, MISCELLANEOUS ROADWAYS  DITCHES, CHANNELS, DIKES AND BERMS (5 SHEETS)  SPILLWAY, EMBANKMENT (2 SHEETS) DOWNDRAIN, EMBANKMENT (2 SHEETS) SPILLWAY LENGTH TABLE DOWNDRAIN LENGTH TABLE DOWNDRAIN ENERGY DISSIPATOR  CURB & GUTTER, CURB, AND GUTTER CURB & GUTTER, CURB, AND GUTTER CURB & GUTTER TRANSITIONS (3 SHEETS) CONCRETE DRIVEWAYS & SIDEWALKS (2 SHEETS) SIDEWALK RAMP (7 SHEETS) MEDIAN PAVING AND NOSE TAPER CONCRETE BUS BAY  DRIVEWAY & TURNOUT LAYOUTS (2 SHEETS) PCCP JOINTS (2 SHEETS) LOAD TRANSFER DOWEL ASSEMBLY PCCP JOINT LOCATIONS, MAINLINE (8 SHEETS) PCCP JOINT LOCATIONS, RAMPS & CROSSROADS (5 SHEETS) TRENCH BACKFILL AND PAVEMENT REPLACEMENT	C-10.00 C-10.01	GUARDRAIL MEASUREMENT LIMITS GUARDRAIL INSTALLATION, TYPE A AND REFLECTOR TAB
C-01.30	GENERAL ADDREVIATIONS ( ) SHEETS!	C-10.01 C-10.02	GUARDRAIL INSTALLATION, TIPE A AND REFLECTOR TAB
C-02.10	SLOPES, RURAL DIVIDED HIGHWAYS	C-10.03	W-BEAM GUARDRAIL, G4(1W) AND G4(2W), BLOCKED-OUT TIMBER POST
C-02.20	SLOPES, RURAL UNDIVIDED AND FRINGE-URBAN HIGHWAYS	C-10.04	W-BEAM GUARDRAIL, G4(1S), BLOCKED-OUT STEEL POST
C-02.30	SLUPES, MISCELLANEOUS RUADWATS	C-10.05 C-10.06	W-BEAM GUARDRAIL, G4(MODIFIED), WITH FREEWAY CURB & GUTTER (2 SHEETS) W-BEAM GUARDRAIL, NESTED (2 SHEETS)
C-03.10	DITCHES, CHANNELS, DIKES AND BERMS (5 SHEETS)	C-10.07	W-BEAM GUARDRAIL, BOLTED ANCHOR (2 SHEETS)
		C-10.08	W-BEAM GUARDRAIL, END ANCHOR
C-04.10 C-04.20	SPILLWAY, EMBANKMENT (2 SHEETS)	C-10.20 C-10.30	THRIE-BEAM GUARDRAIL, G9, BLOCKED-OUT STEEL POST GUARDRAIL TRANSITION, W-BEAM TO CONCRETE HALF BARRIER, 32" TYPE 'F'
C-04.20 C-04.30	SPILL WAY LENGTH TABLE	C-10.30 C-10.40	CONCRETE MEDIAN BARRIER, 32" TYPE 'F', CAST-IN-PLACE
C-04.40	DOWNDRAIN LENGTH TABLE	C-10.41	CONCRETE MEDIAN BARRIER, 42" TYPE 'F', CAST-IN-PLACE
C-04.50	DOWNDRAIN ENERGY DISSIPATOR	C-10.42	GLARE SCREEN, CONCRETE MEDIAN BARRIER (3 SHEETS)
C-05.10	CURR & CUTTER CURR AND CUTTER	C-10.50 C-10.51	CONCRETE HALF BARRIER, 32" TYPE 'F' (2 SHEETS)
C-05.10	CURB & GUTTER TRANSITIONS (3 SHEETS)	C-10.51	CONCRETE HALF BARRIER, 32" TYPE 'F', WITH SIDEWALK CONCRETE HALF BARRIER, 32" TYPE 'F', WITH GUTTER
C-05.20	CONCRETE DRIVEWAYS & SIDEWALKS (2 SHEETS)	C-10.53	CONCRETE HALF BARRIER, 42" TYPE 'F', WITH GUTTER
C-05.30	SIDEWALK RAMP (7 SHEETS)	C-10.54	CONCRETE HALF BARRIER, 32" TYPE 'F' AT PIERS (3 SHEETS)
C-05.40 C-05.50	MEDIAN PAVING AND NOSE TAPER	C-10.55 C-10.70	CONCRETE HALF BARRIER, 42" TYPE 'F' AT PIERS (3 SHEETS) CONCRETE HALF-BARRIER TRANSITION TO VERTICAL, 32" TYPE 'F' WITH CAISSONS (3 SHEETS)
C 03.30	CONCRETE BOS DAT	C-10.71	CONCRETE HALF-BARRIER TRANSITION TO VERTICAL. 32" TYPE 'F' WITH CURB & GUTTER (2 SHEETS)
C-06.10	DRIVEWAY & TURNOUT LAYOUTS (2 SHEETS)	C-10.72	CONCRETE HALF-BARRIER TRANSITION TO VERTICAL, 42" TO 32" TYPE 'F' WITH CAISSONS (3 SHEETS)
0 07 01	DCCD LOINTS / 2 CHEFTS)	C-10.73 C-10.74	CONCRETE HALF-BARRIER TRANSITION TO VERTICAL, 42" TO 32" TYPE 'F' WITH GUTTER (2 SHEETS)
C-07.01 C-07.02	I DAD TRANSEER DOWEL ASSEMBLY	C-10.75	CONCRETE HALF-BARRIER TRANSITION, 42" TO 32" TYPE 'F' CONCRETE HALF-BARRIER TRANSITION, TYPE 'F' TANGENT DEPARTURE (2 SHEETS)
C-07.03	PCCP JOINT LOCATIONS, MAINLINE (8 SHEETS)	C-10.76	CONCRETE HALF-BARRIER TRANSITION, TYPE 'F' AT RADIUS, 32" TO 0"
C-07.04	PCCP JOINT LOCATIONS, RAMPS & CROSSROADS (5 SHEETS)	C-10.77	CONCRETE HALF-BARRIER TRANSITION, END TERMINAL, CURB AND GUTTER
C-07.06	TRENCH BACKFILL AND PAVEMENT REPLACEMENT	C-11.10	ROADWAY CATTLE GUARD (4 SHEETS)
C-08.20	PAVED GORE AREA	C-11.20	CATTLE GUARD, DRAINAGE
		C-12.10	FENCE, WOVEN AND BARBED WIRE WITH GATES (5 SHEETS)
		C-12.20 C-12.30	FENCE, CHAIN LINK TYPES 1 AND 2 WITH GATES (3 SHEETS) FENCE, CHAIN LINK CABLE BARRIER (3 SHEETS)
			<del></del>

#### CONSTRUCTION STANDARD DRAWINGS - INDEX

DRAWING NO.	TITLE
C-13.10 C-13.15 C-13.20 C-13.25 C-13.30 C-13.55 C-13.60 C-13.65 C-13.70 C-13.75 C-13.76	PIPE, REINFORCED CONCRETE END SECTION PIPE, CORRUGATED METAL END SECTION PIPE AND PIPE ARCH, CORRUGATED METAL CONCRETE INVERT PAVING PIPE, CATTLE-VEHICLE PASS, MITERED END TREATMENT SLOTTED DRAIN DETAILS SLOTTED DRAIN, INSTALLATION DETAILS STORM DRAIN, CONNECTION DETAILS STORM DRAIN, OUTLET BARRIER GATE STORM DRAIN OUTLET AND STORM DRAIN PLUG
C-15.10 C-15.20 C-15.30 C-15.40 C-15.50 C-15.70 C-15.75 C-15.80 C-15.81 C-15.90 C-15.91	CATCH BASIN, TYPE 3 (3 SHEETS) CATCH BASIN, TYPE 4 CATCH BASIN, TYPE 5 (2 SHEETS) CATCH BASIN, FRAME AND GRATE CATCH BASIN, MISCELLANEOUS DETAILS (2 SHEETS) CATCH BASIN, DROP INLET CATCH BASIN, FLUSH CATCH BASIN, SIDE SLOPE CATCH BASIN, MEDIAN DIKE (PRECAST) FREEWAY CATCH BASIN DETAILS (2 SHEETS)
C-16.40	IRRIGATION SLEEVES
C-17.10 C-17.15 C-17.20	RAIL BANK PROTECTION FOR DRAINAGEWAYS, TYPES 1, 2 & 3 RAIL BANK PROTECTION AT ABUTMENTS, TYPES 4, 5 & 6 RAIL BANK PROTECTION FOR DRAINAGEWAYS, TYPES 7, 8 & 9

DRAWING NO.	TITLE
C-18.10	MANHOLES (3 SHEETS)
C-19.10	FORD, CONCRETE WALLS (2 SHEETS)
C-21.10 C-21.20	SURVEY MONUMENT, FRAME AND COVER, RIGHT-OF-WAY MARKER SURVEY MARKER

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REISSUED STANDARD DRAWING - REVISED ORDER OF FEATURES	RLF	5/07
(2)			
(3)			
4			

	CONSTRUCTION D	RAWING SYMBOLS		CONSTRUCTION D	RAWING SYMBOLS
	NEW FEATURES	EXISTING FEATURES		NEW FEATURES	EXISTING FEATURES
National, State Boundary			Survey Control Point	o	
Forest or Reservation Boundary			Bench Mark		×
County Line			Centerline, Station Marks		
City Limits			Mile Post Marker	MP	△ MP
Township or Range Line			Sidewalk, Curb & Gutter w/Depressed Curb (1" = 50' or larger)	30' DC	
Section Line			Curb & Gutter with Depressed Curb (I"=100')	+ 25	
Quarter or Mid-Section Line			Curb, Single with Depressed Area		========:
Sixteenth-Section Line			Pavement and Sidewalk Edge		
Right-of-Way Line			Turnout	<u></u>	
Property Line			Top of Cut		
Temporary Construction Easement			Toe of Fill		
Access Control			Transition, Cut to Fill	_cor	
Section Corner		<u> </u>	Railroad Track (1"=50' or larger)		
Ouarter Corner		-0-	Railroad Track (  " = 100')		
Survey Monument	$\oplus$	(+)	Bank Protection	XXXXXXXXXX	XXXXXXXXXXX
Right-of-Way Marker	•	$\oplus$	Bridge		
Angle Point or PI	Δ		Building	Floor Elevation 1984.68*	Floor Elevation 1984.68'
			APPROVED FOR DESIGN May Vipauna	STATE OF AF DEPARTMENT OF TRA ROADWAY STANDAR	NSPORTATION 5/07
			APPROVED FOR DISTRIBUTION		DRAWING NO.

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	RENAMED STD FROM C-01.11 TO C-01.10, SHEET 2 OF 4	RLF	9/04
(2)			
(3)			
<b>(</b>			

	CONSTRUCTION DRAWING SYMBOLS			CONSTRUCTION DRAWING SYMBOLS	
	NEW FEATURES	EXISTING FEATURES		NEW FEATURES	EXISTING FEATURES
Catch Basin, Curb & Gutter			Straight Hdwl w/End Sct, Pipe (1"=20') (All Dia)		
Catch Basin, Median Dike			Straight Hdwl w/End Sct, Pipe (1"=50' or smaller) (Dia=42" and larger)		[] 
Catch Basin, Off Roadway, Flush			Straight Hdwl w/End Sct, Pipe (1"=50' or smaller) (Dia=36" and smaller)	<del>                                   </del>	
Catch Basin, Single Curb		======:	"U" Hdwl w/End Sct, Pîpe (["=20") (All Dîa)		
Cattle Guard			"U" Hdwl w/End Sct, Pipe (  "=50' or smaller) (Dia=42" and larger)		
Concrete Box Culvert			"U" Hdwl w/End Sci, Pipe (  "=50' or smaller) (Dia=36" and smaller)	]	(
Dike, Median			Wing Hdwl w/End Sct, Pipe (I"=20') (All Dia)	)———	1 h
Dike			Wing Hdwl w/End Sct, Pipe (1"=50' or smaller) (Dia=42" and larger)	)——	11
Downdrain, one-way	35,		Wing Hdwl w/End Sct, Pipe (1"=50' or smaller) (Dia=36" and smaller)	)——	)
Downdrain, two-way			"L" Hdwl w/End Sct, Pipe (["=20') (All Dia)	7——□	11 11 12 12 13 13 13 13 13 13 13 13 13 13 13 13 13
Manhala	+ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \		"L" Hdwl w/End Sct, Pipe (  "=50' or smaller) (Dia=42" and larger)	<b>—</b>	
Manhole			"L" Hdwl w/End Sct, Pipe (  "=50' or smaller) (Dia=36" and smaller)	<b> </b>	<del></del>
Manhole, Frame & Cover, Reset	<b>®</b>		Pipe Ext W/End Sct & Berm (1"=20') (All Dia)		
Retaining Wall			Pipe Ext W/End Sct & Berm (1"=20') (1"=50' or smaller) (Dia=42" and larger)		
Rock Riprap			(In 50)		
Spillway, one-way	5.		Pipe Ext W/End Sct & Berm (1"=20') (Dia=36" and smaller)		
Spillway, two-way	35, 3,		Pipe Ext W/End Sct Roadway Widening (1"=20')		
			APPROVED FOR DESIGN  May Vipaura	STATE OF AF DEPARTMENT OF TRA ROADWAY STANDAR	NSPORTATION   5/07

APPROVED FOR DISTRIBUTION

DRAWING NO.

SYMBOL LEGEND

1

C-01.10 Sheet 2 of 4

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(1)	RENAMED STD FROM C-01.12 TO C-01.10, SHEET 3 OF 4	RLF	9/04
(2)			
(3)			
(4)			

	CONSTRUCTION DRAWING SYMBOLS			CONSTRUCTION D	RAWING SYMBOLS
	NEW FEATURES	EXISTING FEATURES		NEW FEATURES	EXISTING FEATURES
Plan View, Bituminous Pavement			Irrigation Ditch, Concrete	= IR ==================================	== IR ===== IR =====
Plan View, Concrete Pavement			Irrigation Ditch, Earth	— IR———————————————————————————————————	— IR ——————————————————————————————————
Plan View, Graded Surface			Irrigation Line (  " = 20')	—IR———————————————————————————————————	= R R
Plan View, Obliterate Pavement			Irrigation Line (  " = 100')	iRiR	— IR — IR —
Plan View, Wood	577777		Overhead Power/Joint-Use Line	OP	-or
Section, Asphaltic Concrete Friction Course			Overhead Telephone Line	_or	-ot
Section, Bituminous Pavement			Sanitary Sewer (1"=20')	=S <u></u>	=S <del></del>
Section, Concrete			Sanitary Sewer (1"=100')	_ss	-s- <del></del>
Section, Metal			Storm Drain (1"=20') & (1"=50')		=SD <u></u>
Section, Wood			Storm Drain (1"=100')		— SD ——————————————————————————————————
Section, Aggregate Base			Street Light and with Mast Arm	¤ 0—¤	¤ ∘
Section, Ground Line	SUSSISSI SUSSISSI		Telephone/Power Pedestal	<b>■</b> T <b>■</b> P	$\Box T  \Box P$
Ground Line Profile			Utility Pole with Down Guy and Anchor	<b>●</b>	o—)
Barbed Wire Fence & Gate			Underground Power/Joint-Use Line	_р	_P
Chain Link Fence & Gate			Underground Telephone Line		-TT
Guardrail & Flared End Terminal	<b>*</b> ***********************************	Doggood	Water/Gas Meter Box	■ ■ WM GM	□ □ WM GM
Guardrail & Tangent End Terminal	<b>•••••</b>	D	Water/Gas Valve	₩V GV	WV GV
Gas Line	_cc	_ G G	APPROVED FOR DESIGN May Vipauna	STATE OF AF DEPARTMENT OF TRA ROADWAY STANDAR	NSPORTATION 5/07
			APPROVED FOR DISTRIBUTION  Julia Section	SYMBOL LEGEN	DRAWING NO. (1) C-01.10 Sheet 3 of 4

	COLUCTO INTERNATION	DOAWING CYLIDG: C		001107011071011	ODAWING COLOGO
		DRAWING SYMBOLS			DRAWING SYMBOLS
	NEW FEATURES	EXISTING FEATURES		NEW FEATURES	EXISTING FEATURES
Water Line			Depressed Index Contour Line	8650	8650 -
Drainage Channel		-	Depressed Intermediate Contour Line		
Drainage Ditch	Dreinage Disch		Block Wall ( "=20')		
Major Wash		NAME -	Median Barrier		
Minor Wash			Fire Hydrant	<b>Y</b> FH	FH
& Grade, Profile		_	Standpipe		O SP
Hedge			Transmission Tower		>
Palm Tree		of the second	Windmill		
Shrubbery			Mail Box		7
Unclassified Tree			Flag Pole		N
Sign, Single Post	•	q			
Sign, Multiple Post		O O	North Arrow		
Dimensions					
Visible Outlines, Sections, etc		-			<b>N</b>
Index Contour Line	8650	8650			
Intermediate Contour Line		-			
			May Vipa	DEPARTMENT OF THE ROADWAY STANDA	RANSPORTATION 5/0
			APPROVED FOR DISTR		DRAWING NO.  C-01.10

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(1)	RENAMED STD DWG FROM C-01.30 TO C-01.30, SHEET 1 OF 3	RLF	9/04
(2)			
(3)			
4			

WORDS	ABBREVIATION	WORDS	ABBREVIATION	WORDS	ABBREVIATION
A		B (cont)		C (cont)	
Abutunat	44.4	Bituminous Mixture	Bit Mix	Corrugated High-Density Polyethylene Plass	tic Pipe CHDPEPP
Abutment	Abt	Bituminous Surface Treatment	BST	Corrugated Metal Pipe	CMP
Acceleration Acres	Acc Ac	Bituminous Treated Base	ВТВ	Corrugated Steel Pipe	CSP
Aggregate	Agg	Black Steel Pipe	BSP	County	Co
Aggregate Base	AB	Borrow	Bor	Crossing	X-ING
Ahead	AHD, Ahd	Boulevard	BLVD, Blvd	Cross Section	X-SECT
Alternate	Alt	Boundary	Bdry	Crown	Cr
Aluminum	A/	Brass Cap	BC	Cubic	Cu
American Association of State Highway	AASHTO	Breakaway Cable Terminal	BCT	Cubic Feet Per Second	CFS
and Transportation Officials		Bridge	Br	Cubic Yard or Cubic Yards	CY, Cu Yd
American Concrete Institute	AC/	Building	Bldg	Culvert	Culv
American Institute of Steel Construction	AISC	C	•	Curb and Gutter, Curb & Gutter	C&G
American Road and Transportation	ARTBA	Calculated	Calc	Curve to Spiral	CS
Builders Association		Cast-In-Place	C-I-P	D	
American Society for Testing Materials	ASTM	Cast Iron	CI	Deceleration	Dcl
Amount	Amt	Cast Iron Pipe	CIP	Deflection	Def
Approach	Appr	Catch Basin	СВ	Deflection of Total Curve	1
Approximate	Approx	Cattle Guard	CG	Degree of Curve	D
Asphalt	A <i>sph</i>	Cement	Cem	Delineator	Del
Asphalt Rubber	AR	Cement-Treated Base	СТВ	Delta	Δ
Asphalt Rubber ACFC	ARACFC	Center	Ctr	Depressed Curb	DC
Asphaltic Concrete	AC	Center Line	Ę	Design Speed	Des Spd
Asphaltic Concrete Base	ABC	Center to Center	C to C	Detail	Dtl
Asphaltic Concrete Friction Course	ACFC	Channel	Chan	Diameter	Dia
Asphaltic Concrete Surface Course	ACSC	Class	СІ	Distance	Dist
Avenue	AVE, Ave	Clear	CIr	Division	Dîv
Average Daily Traffic	ADT	Column	Col	Double	DbI
В		Compact or Compaction	Comp	Drain or Drainage	Drn
Back	BK. Bk	Complete In Place	C in P	Drainage Area	DA
Backfill	Bkfl	Concrete	Conc	Drawing	Dwg
Balance	Bal	Concrete Box Culvert	CBC	Drive	Dr
Bank Protection	BP, Bank Prt	Concrete-Treated Base	СТВ	Driveway	Dwy
Barbed Wire	BW	Connection	Conn	Ductile Iron Pipe	DIP
Bearing	Brg	Conduit	Cond	E	
Begin	Bgn	Construct or Construction	Cst	Each	Ea
Begin Curb Return	BCR	Continous	Cont	Easement	Esmt
Begin Full Super	BFS	Coordinate	Coord	East	E
Bench Mark	ВМ	Corner	Cor	Eastbound	EB
Bevel or Beveled	Bev	Correction	Corr		
Bituminous	Bît	Corrugated Aluminum Pipe	CAP	APPROVED FOR DESIGN	STATE OF ADIZONA REV.
				May Vipauña	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS 5/07

APPROVED FOR DISTRIBUTION

GENERAL ABBREVIATIONS

1

**C-01.30** Sheet 1 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	RENAMED STD DWG C-01.31 TO C-01.30, SHEET 2 OF 3	RLF	9/04
2			
(3)			
4			


WORDS	ABBREVIATION	WORDS	ABBREVIATION	WORDS	ABBREVIATION
E (cont)		G (cont)		M (cont)	
Edge of Pavement	EP	Ground	Gnd	Mile or Miles	MI
Electric, Electricity	Elec, E	Ground Compaction	Gnd Comp	Mile Post	MP
Elevation	Elev	Grubbing	Grb	Miles Per Hour	MPH
Embankment	Emb	Guard	Grd	Mineral Aggregate	MA
End Curb Return	ECR	Guardrail	GR	Minimum	Min
End Full Superelevation	EFS	Guardrail Extruder Terminal	GET	Miscellaneous	Misc
Engineer	Engr	н		Modify or Modified	Mod
Entrance	Ent	Headwall	Hdwl	Monument	Mon
Equation	EO, Eq	Height	Ht. H. h	Mountain	Mt
Estimate	Est	Height of Instrument	HI	N	
Excavation	Exc	Head Water	HW	National	Natl
Existing	Exst	Highway	Hwy		NRCIPCP
Expansion Joint	Exp Jf	Horizontal	Horz	Non-Reinforced Cast-In-Place Concrete Pipe	
Extend or Extension	Ext	Horizontal Elliptical Reinforced	HERCP	Normal Crown	NC
External	Ext	Concrete Pipe	HENCI	North	N
External	Exi	•			N ND
F	Fo.d	l marayamant	lman	Northbound	NB No.
Federal	Fed	Improvement	Impr	Number	No
Feet or Foot	Ft	Inch or Inches	In	0	<b>-</b>
Feet per Foot	7/1	Include, Included or Inclusive	Incl	Obliterate	Obl
Feet Per Second	FPS	Inside Diameter	ID	Original	Orig
Figure	Fig	Invert	Inv	Outside Diameter	OD
Finish	Fin	Irrigation	Irr	Overhead	ОН
Floor	FI	J		Overpass	0P
Flow Line	FL	Joint	Jt	Р	
Footing	Ftg	Junction	Jct	Parkway	Pkwy
Forest	Fst	L		Pavement	Pvmt
Found	Fnd	Laboratory	Lab	Pedestrian	Ped
Frame	Fr	Lateral	Lat	Place	PI
Freeway	Fwy	Left	Lt	Point	Pt
Frontage	Frt	Length or Length of Curve	L	Point of Compound Curvature	PCC
Furnish or Furnished	Furn	Length of Normal Crown Removal	L <sub>C</sub>	Point of Curvature	PC
Future	Fut	Length of Spiral	Ls	Point of Intersection	PI
G		Length of Superelevation Runoff	L <sub>s</sub>	Point of Reverse Curvature	PRC
Gas	G	Line	 Ln	Point of Tangency	PT
Gas Meter	GM	Linear or Lineal	Lin	Point on Curve	POC
Gas Valve	GV	Linear Feet	Lîn Ft	Point on Semi-Tangent	POST
Galvanize or Galvanized	Galv	Location	Loc	Point on Spiral	POS
Gauge	Ga	N	200	Point on Tangent	POT
Government	Gov't	Manhole	мн	Polyethylene	PE
Grade		matinole Material	Mtl		
	Gr			APPROVED FOR DESIGN May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION
Grade Seperation	GS	Maximum	Max	may opaula	ROADWAY STANDARD DRAWINGS
		Median	Med	APPROVED FOR DISTRIBUTION	GENERAL ABBREVIATIONS  C-01

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	RENAMED STD DWG C-01.32 TO C-01.30, SHEET 3 OF 3	RLF	9/04
2			
3			
4			


WORDS	ABBREVIATION	WORDS	ABBREVIATION	WORDS	ABBREVIATION
P (cont)		S		T (cont)	
Polyvinyl Chloride	PVC	Salvage	Salv	Telephone	Tel
Portland Cement Concrete	PCC	Section	Sct	Temporary	Temp
Portland Cement Concrete Pavement	PCCP	Select Material	SM	Temporary Construction Easement	TCE
Pounds	Lbs	Sheet	Sh	Timber	Tbr
Pounds Per Square Inch	PSI	Shoulder	Shldr	Top of Curb	TC
Preliminary	Prelim	Shrinkage	Shr	Topography	Торо
Prestress, Prestressed or Prestressing	PS	Sidewalk	S/W	Township	Τ
Project	Prj	Sight Distance, Stopping	SD <sub>S</sub>	Traffic Interchange	TI
Property Line	P/L	Single	Sgl	Transition	Trns
Proposed	Prop	Skew	Sk	Turning Point	TP
Protection	Prt	South	s	Turnout	TO
Provision or Provide	Prv	Southbound	SB	Typîcal	Тур
0		Special	Spcl	U	
Quadrant	Quad	Specification	Spec	Underground	Ugnd
Quantity or Quantities	Quan	Spiral Rate of Change	a	Underpass	UP
Quantity of Drainage Runoff	0	Spiral To Curve	SC	V	
R		Spiral To Tangent	ST	Variable	Var
Radius	R	Square	Sq	Vertical	Vert
Railroad	RR	Square Feet	Sq Ft	Vertical Curve	VC
Range	R	Square Yard	Sq Yd	Vertical Elliptical Reinforced	VERCP
Reconstruct	Recst	Standard	Std	Concrete Pipe	
Reference	Ref	State Route	SR	Vertical Point of Intersection	VPI
Reinforced or Reinforcing	Reinf	Station	Sta	Viaduct	Via
Reinforced Concrete	RC	Street	St	Vitrified Clay Pipe	VCP
Reinforced Concrete Pipe	RCP	Structure or Structural	Str	Volume	Vol
Reinforcing Bar	Rebar	Subdivision	Subdiv	w	
Relocate, Relocation or Relocated	Reloc	Subgrade	SG	Water	W
Remove	Rem	Subgrade Seal	SS	Water Meter	WM
Required	Reqd	Superelevation	e or Super	Water Valve	₩ <i>V</i>
Reservation	Resv	Surface	Surf	Welded Wire Fabric	<i>WWF</i>
Residence	Res	Survey	Sur	West	W
Retain or Retaining	Ret	Swell	Sw	Westbound	WB
Revised or Revision	Rev	Symmetrical	Sym	Western Wood Products Association	<i>WWPA</i>
Right	Rt	T		Wide or Width	W
Right-of-Way	R/W	Tangent	Tan	Wood	Wd
Road	Rd	Tangent Length	Τ	Y	
Roadway	Rdwy	Tangent to Spiral	TS	Yard	Yd
Route	Rte	Telegraph	TIg		
Rubber Gasket Reinforced Concrete Pipe	RGRCP				
				APPROVED FOR DESIGN	STATE OF ADIZONA REV.

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	GENERAL ABBREVIATIONS	_	NO. (1)


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED TITLE	RLF	4/06
2	REVISED 'NOTE TO DESIGNERS'	RLF	7/06
3	MODIFIED SYMBOL	RLF	7/06
4			

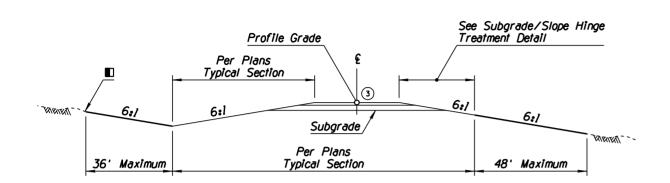


#### MINIMUM SLOPES

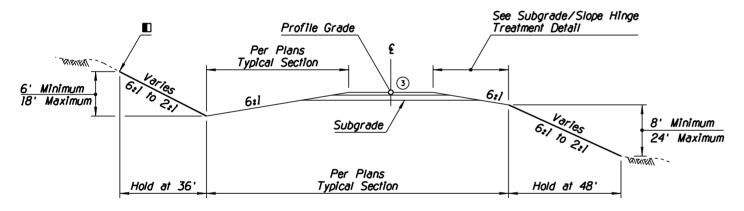


#### INTERMEDIATE SLOPES

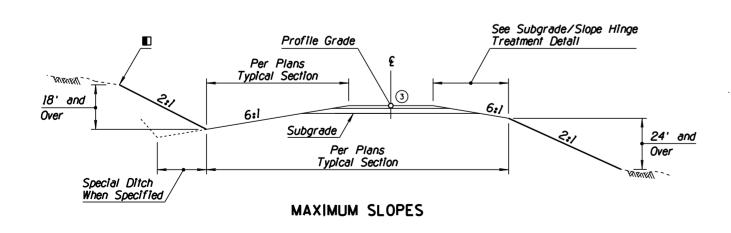

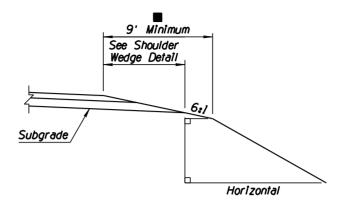


SUBGRADE/SLOPE HINGE TREATMENT DETAIL



W = D x Slope (6:1)
D = Str Sct Depth (Ft) Excluding ACFC
Subgrade = 2 x W + Roadway Width

#### SHOULDER WEDGE DETAIL

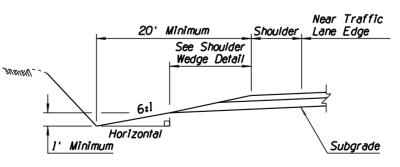


#### MINIMUM DITCH CONDITIONS DETAIL

#### **GENERAL NOTES**

- Roadway width, cut ditch width, cross slope, and pavement structure section will be shown on project plans.
- 2. Pavement structure slope is nominal.
  Actual slope is controlled by (D). See
  Shoulder Wedge Detail.
- 3. Slopes beyond the pavement structure, such as embankment and cut slopes, are relative to horizontal.
- 4. For slope controls within interchange areas, see project plans.
- 5. When median slopes intersect, see project plans for controls.
- 6. These slopes are intended to be used with new or reconstructed roadways.

#### NOTE TO DESIGNERS

Required when guardrail is present on the project. Treatment shall be uniform throughout the project length. The 9' requirement may be waived under special conditions on projects without guardrail.



#### SLOPE ROUNDING DETAIL

Except in solid rock, or as directed by the Engineer, the intersection of roadway cut slopes with the ground surfaces shall be rounded.

For cuts up to 6', use 5' semi-tangents for slope rounding. For each additional foot of cut add 1' to semi-tangent to 11' maximum.


PPROVED FOR DESIGN

STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS


PPROVED FOR DISTRIBUTION
SLOPES
RURAL DIVIDED HIGHWAYS

C-02.10


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REVISED TITLE	RLF	4/06
2	MODIFIED SLOPE CRITERIA	RLF	4/06
3	REVISED 'NOTE TO DESIGNERS'	RLF	7/06
(4)	MODIFIED SYMBOL	RLF	7/06

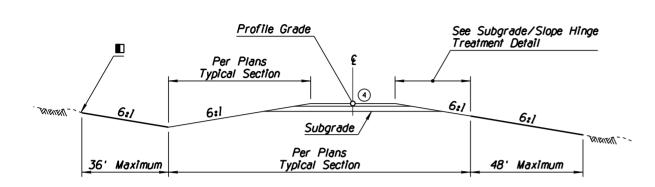


#### MINIMUM SLOPES

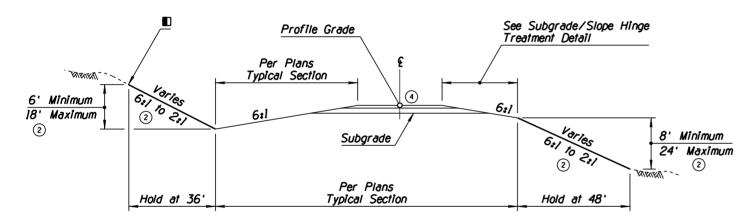


#### INTERMEDIATE SLOPES

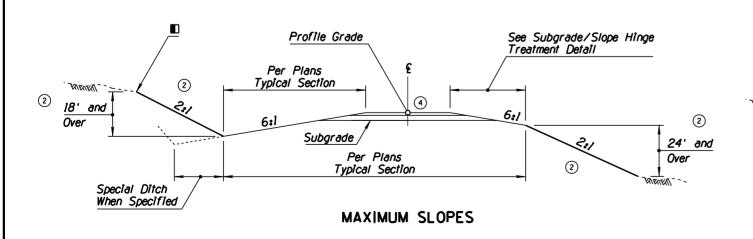

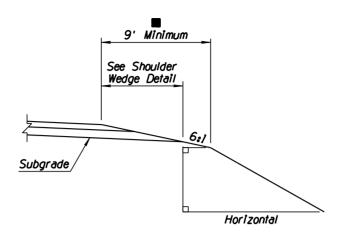


SUBGRADE/SLOPE HINGE TREATMENT DETAIL



W = D x Slope (6:1)
D = Str Sct Depth (Ft) Excluding ACFC
Subgrade = 2 x W + Roadway Width

#### SHOULDER WEDGE DETAIL

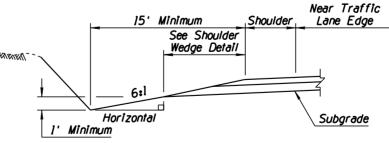


#### MINIMUM DITCH CONDITIONS DETAIL

#### GENERAL NOTES

- Roadway width, cut ditch width, cross slope, and pavement structure section will be shown on project plans.
- Pavement structure slope is nominal.
   Actual slope is controlled by (D). See Shoulder Wedge Detail.
- 3. Slopes beyond the pavement structure, such as embankment and cut slopes, are relative to horizontal.
- 4. When median slopes intersect, see project plans for controls.
- 5. These slopes are intended to be used with new or reconstructed roadways.

#### NOTE TO DESIGNERS

Required when guardrail is present on the project. Treatment shall be uniform throughout the project length. The 9' requirement may be waived under special conditions on projects without guardrail.




#### SLOPE ROUNDING DETAIL

Except in solid rock, or as directed by the Engineer, the intersection of roadway cut slopes with the ground surfaces shall be rounded.


For cuts up to 6', use 5' semi-tangents for slope rounding. For each additional foot of cut add 1' to semi-tangent to 11' maximum.

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	N REV.
PROVED FOR DISTRIBUTION	SLOPES () RURAL UNDIVIDED AND FRINGE-URBAN HIGHWAYS	C-02.20


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED SLOPE CRITERIA	RLF	4/06
2	ADDED USAGE NOTE	RLF	4/06
3	MODIFIED 'NOTE TO DESIGNERS'	RLF	7/06
4	MODIFIED SYMBOL	RLF	7/06

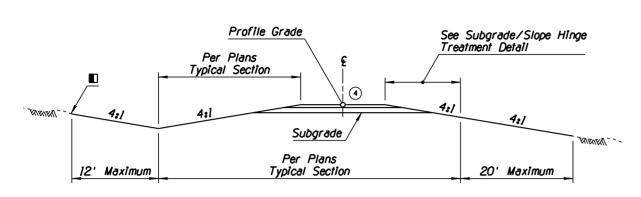


#### MINIMUM SLOPES

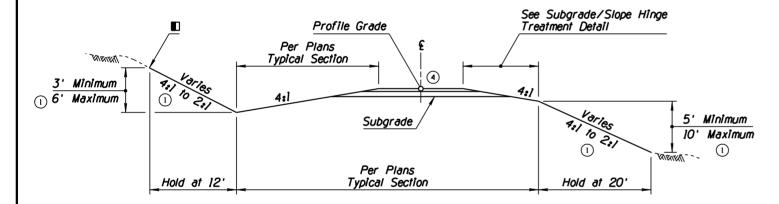


INTERMEDIATE SLOPES

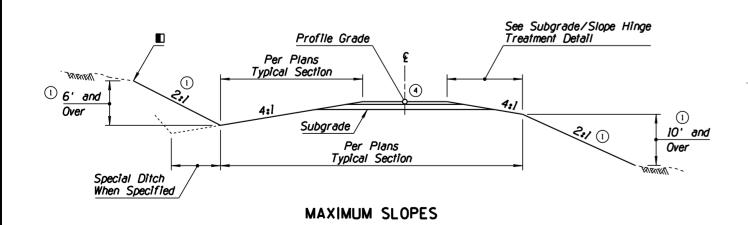

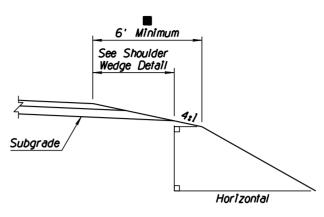


SUBGRADE/SLOPE HINGE TREATMENT DETAIL



W = D x Slope (4:1)
D = Str Sct Depth (Ft) Excluding ACFC
Subgrade = 2 x W + Roadway Width

#### SHOULDER WEDGE DETAIL

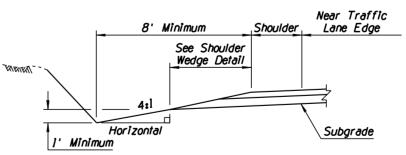


#### MINIMUM DITCH CONDITIONS DETAIL

#### **GENERAL NOTES**

- Roadway width, cut ditch width, cross slope, and pavement structure section will be shown on project plans.
- 2. Pavement structure slope is nominal. Actual slope is controlled by (D). See Shoulder Wedge Detail.
- 3. Slopes beyond the pavement structure, such as embankment and cut slopes, are relative to horizontal.

#### NOTE TO DESIGNERS

- ② USAGE OF THIS STANDARD IS LIMITED IN ACCORDANCE WITH THE ROADWAY DESIGN GUIDELINES CHAPTER 300.
- Required when guardrail is present on the project. Treatment shall be uniform throughout the project length. The 9' requirement may be waived under special conditions on projects without guardrail.



#### SLOPE ROUNDING DETAIL

■ Except in solid rock, or as directed by the Engineer, the intersection of roadway cut slopes with the ground surfaces shall be rounded.

For cuts up to 6', use 5' semi-tangents for slope rounding. For each additional foot of cut add 1' to semi-tangent to 11' maximum.

STATE OF ARIZONA

May Vipaura

DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS


PROVED FOR DISTRIBUTION
SLOPES
MISCELLANEOUS ROADWAYS

REV.


5/07

C-02.30


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED SLOPE DESIGNATIONS	RLF	9/04
2	REVISED EXISTING GROUND-LINE SYMBOLOGY	RLF	9/04
3			
4			

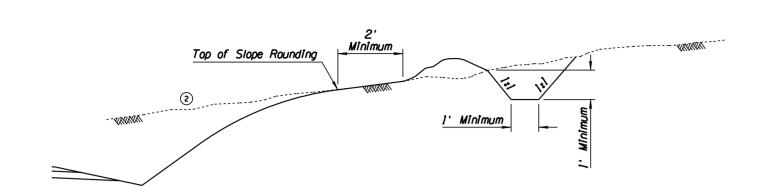

#### CROWN DITCH

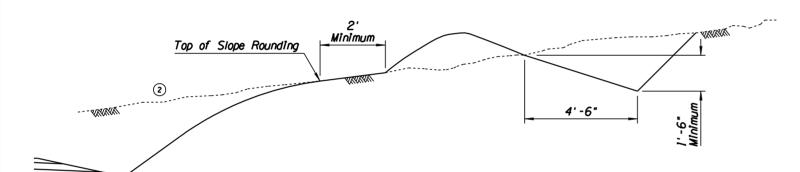



GRADER DITCH

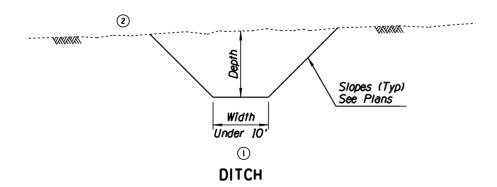

#### GENERAL NOTES


- Dimensions of ditches and channels shall be shown on the plans as bottom width, depth and length.
- Ditches and channels shall be constructed with a minimum grade to prevent erosion. Ditch outlet treatment shall be as provided on plans.

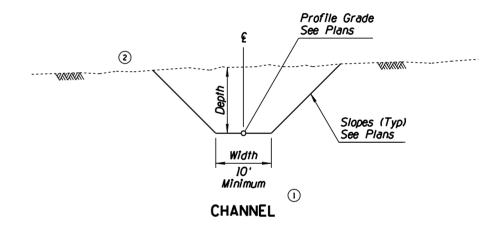

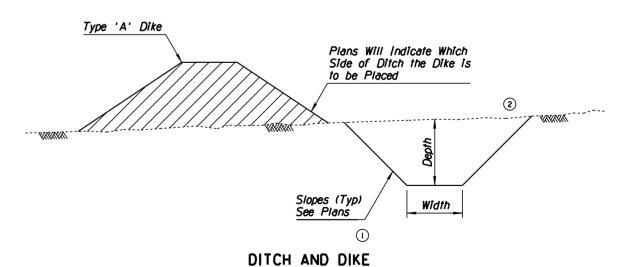


PROVED FOR DESIGN May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
PROVED FOR DISTRIBUTION	DITCHES, CHANNELS, DIKES AND BERMS DITCHES AND CHANNELS	_	NO. -03.10 set 1 of 5

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(1)	DELETED SLOPE TABLE	RLF	9/04
2	2 DELETED GENERAL NOTE 2: REVISED SLOPE DESIGNATIONS		9/04
3			
$\mathbf{A}$			

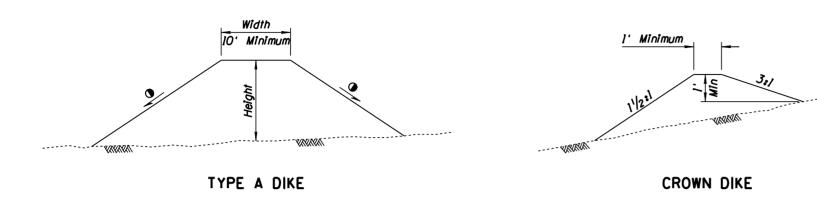

1

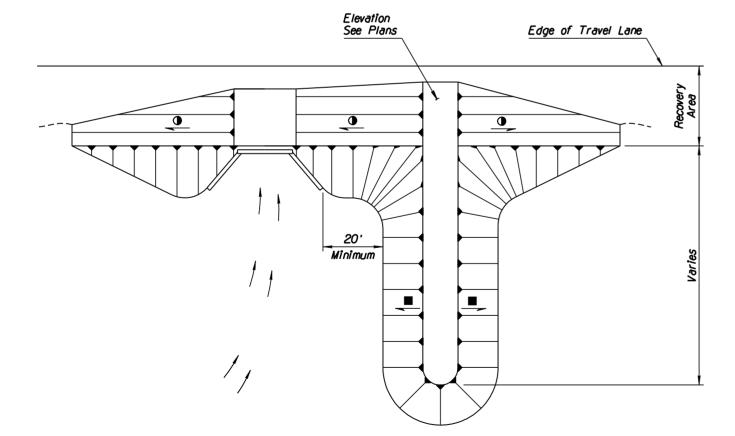


TYPICAL DIKE INSTALLATION AT STRUCTURE

#### GENERAL NOTES


- Dimensions of dikes shall be shown on the plans as top width, height, length and top of dike elevation.
- Slope as Shown on Plans (10:1 Desirable)

  Slope as Shown on Plans



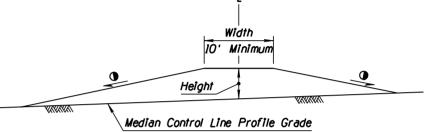

#### TYPE B TRANSVERSE MEDIAN DIKE

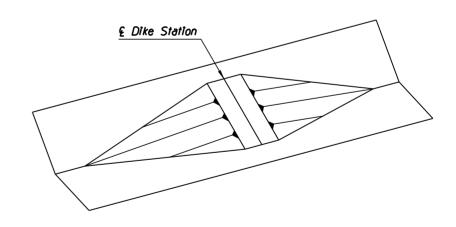


TYPICAL TRANSVERSE MEDIAN DIKE INSTALLATION

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	REV. 5/07
APPROVED FOR DISTRIBUTION	DITCHES, CHANNELS, DIKES AND BERMS DIKES	C-03.10

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(1) 4	ADDED NEW GENERAL NOTE	RLF	9/04
2) F	REVISED SLOPE DESIGNATIONS	RLF	9/04
3)			
4)			
		<u>'</u>	-
	_		

SECTION A-A

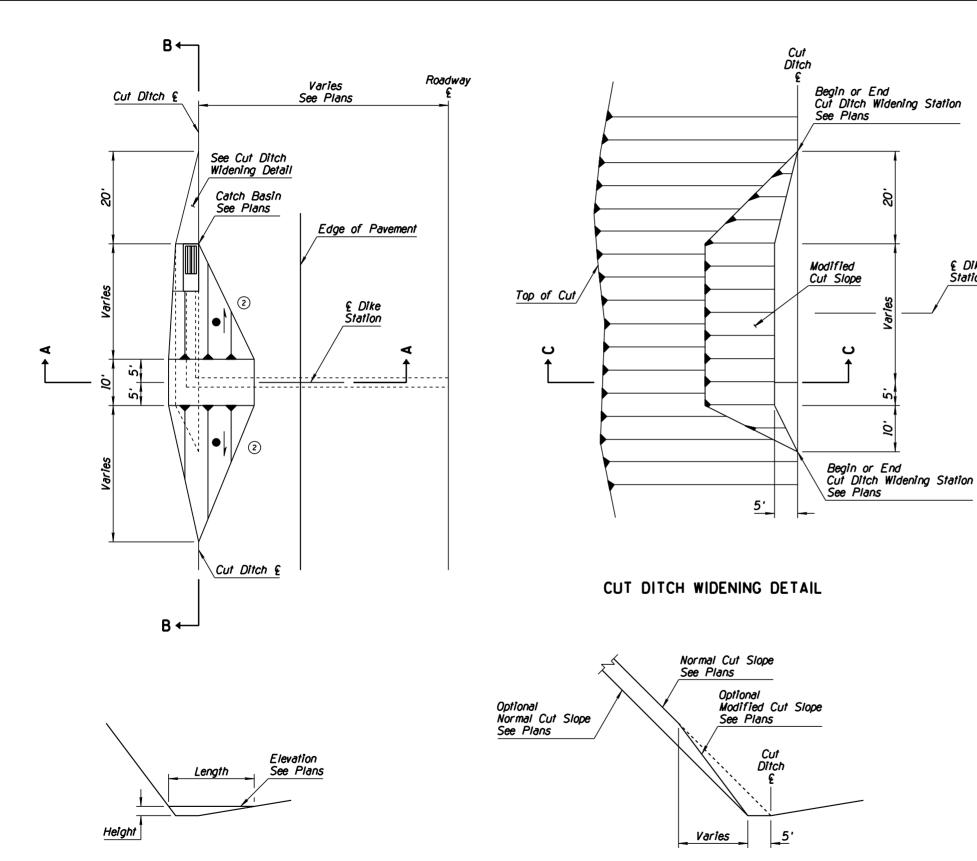



SECTION C-C

#### GENERAL NOTES

- Dimensions for ditch dikes shall be shown on the plans as dike stationing, height, length, dike back slope and top of dike elevation.
- 2. Dimensions for cut ditch widening shall be shown on the plans as beginning and ending stations.
- All slopes are given relative to the grade of the cut ditch at the toe intersection.
- 10:1 Desirable Slope 2

€ Dike Station

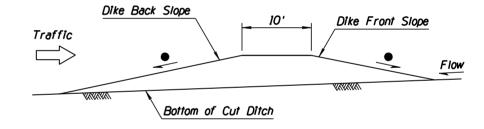

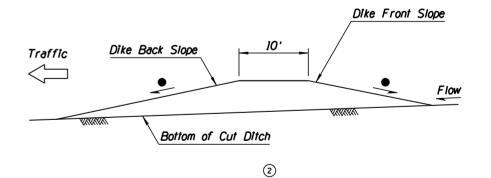

SECTION B-B


May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	DITCHES, CHANNELS, DIKES AND BERMS DITCH DIKE	_	NO. 3-03.10 set 3 of 5

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REVISED SECTION A-A TITLE RLF 7/05  2 DELETED SECTION A-A (WITHOUT END SECTION) RLF 7/05  3 DELETED ORIGINAL GENERAL NOTE 1 & 2 RLF 7/05  4 ADDED END SECTION TO PIPE BERM REQUIREMENT DETAIL RLF 7/05	
Existing Toe of Slope  10:1  10:1  Secondary Area  10:1  Area  10:1  10:	
SKEWED PIPE PLAN	
→A	
Existing Toe of Slope  10:1  Selvent August 10:1  Selvent August 10:1  In the selvent august 10:1  In the selvent	
STRAIGHT PIPE PLAN	
10' Minimum	
2.5' Minimum  D  2.5' Minimum  10:1	

ELEVATION STRAIGHT PIPE


#### GENERAL NOTES

- Berm construction shown is for pipe extensions.
   Berm construction similar for new pipe and multiple pipe installations. See Pipe Berm Requirement Detail.
- If Point A is within the recovery area, then a pipe berm is required and Point B is set at the edge of the recovery area.
- 3. See Std Dwg C-13.15 for pipe backfill and bedding material limits.
- ☑ Single Pipe Installation: D = Outside Diameter of Pipe
- Multiple Pipe Installation: D = Outside Edge to Outside Edge of Pipes

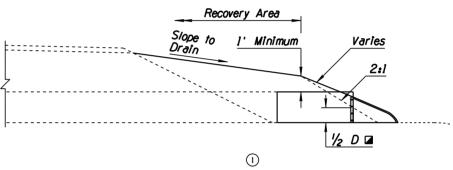


SECTION A-A

2

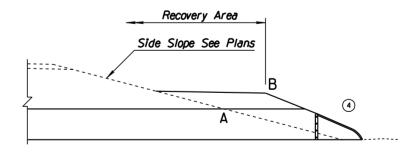

PIPE BERM REQUIREMENT DETAIL


May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	N 5/07
APPROVED FOR DISTRIBUTION	DITCHES, CHANNELS, DIKES AND BERMS PIPE BERMS	C-03.10 Sheet 4 of 5

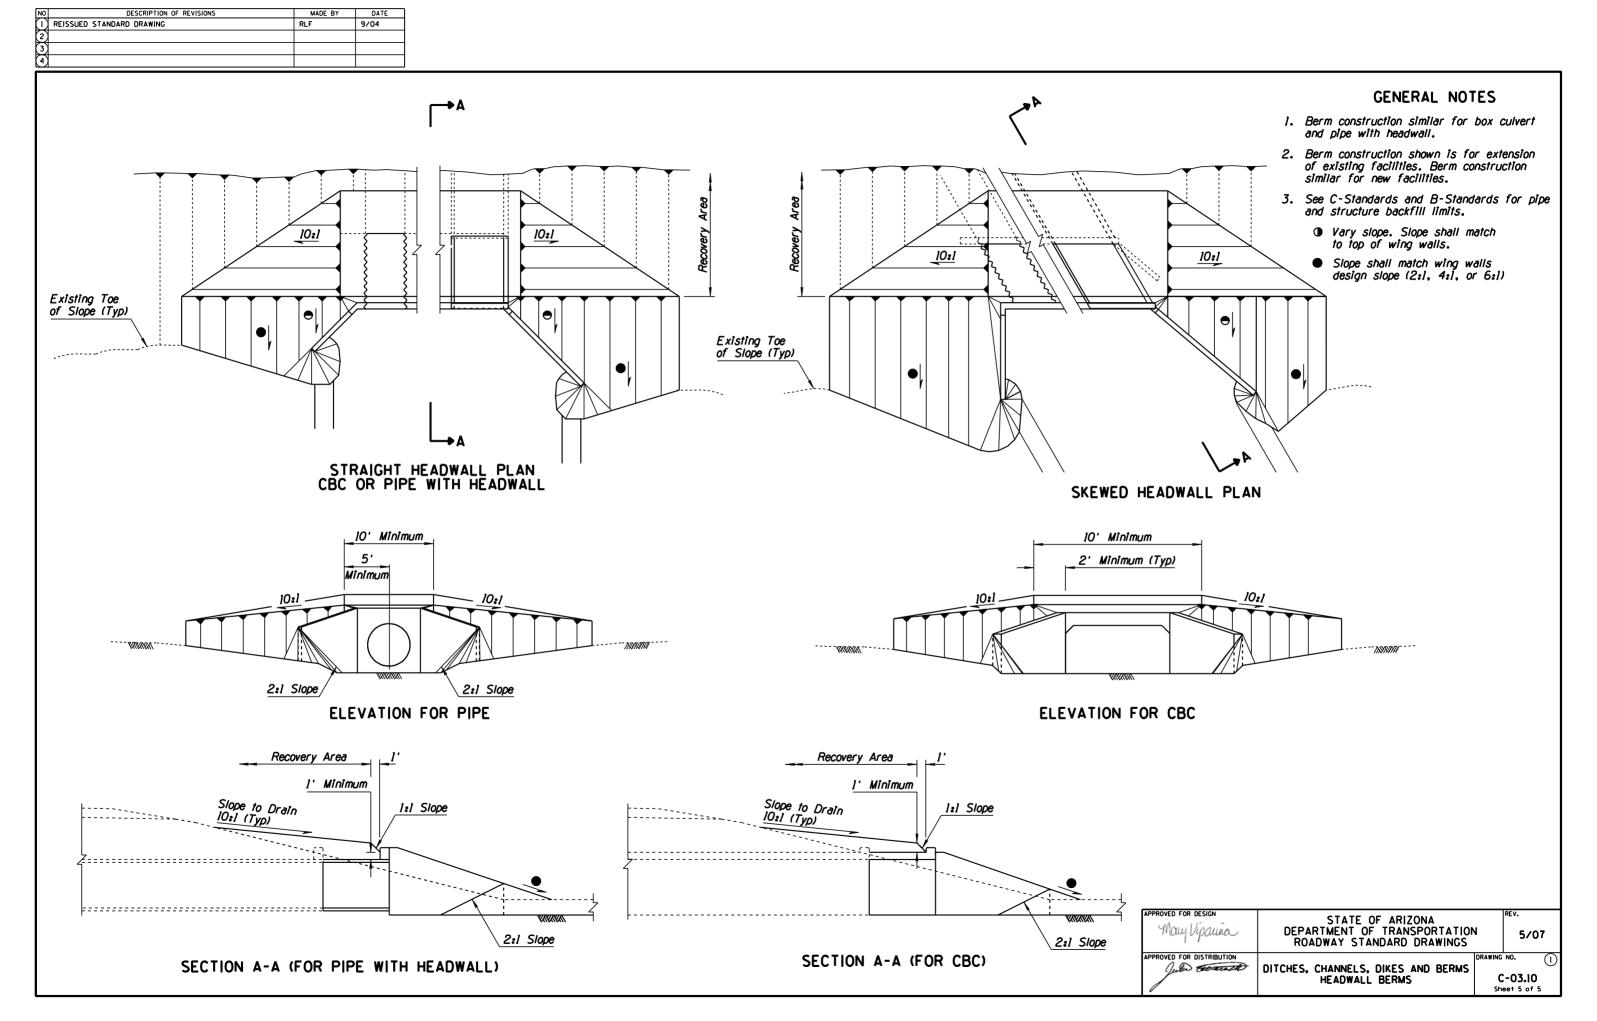

NO         DESCRIPTION OF REVISIONS         MADE BY         DATE           I REISSUED STANDARD DRAWING         RLF         7/05           2 CORRECTED GENERAL NOTE REFERENCE         RLF         5/07           3 MODIFIED PLAN AND SECTION VIEWS         RLF         5/07			
Guardrail Post (Typ)  Grant Typ)  Grant Typ)	Normal or 2' Widened Shoulder Line  1/2" Expansion Joint Preformed Joint Filler  Subgrade Shoulder Slope Break	Embankment Curb (Typ) Std Dwg C-05.10	GENERAL NOTES  1. Location may be adjusted to accomodate guardrall post layout.  2. All concrete shall be Class B. Embankment curb concrete shall be in accordance with the Std Specs.  3. Where rock is encountered the outlet may be omitted, as approved by the Engineer.  4. When outlet is used, the wire mesh shall extend through the joint into the outlet in lieu of bending into the key.  5. Spillway invert slope shall be uniformly downward from A to B. See Section B-B.  6. See Std Dwg C-04.30 for spillway length.  7. See Std Dwg C-10.06 for nested guardrail requirements.
6x6-Wi.4/Wi.4 Wire Mesh  SECTION A-A	1/2" Expansion Preformed Joint	Joint <u>Filler</u>	
SPILLWAY SECTION	8' -0"	Normal or 2' Widened Roadway Width  A  Spillway  2'-9"  1'-0"	
6x6-W1.4/W1.4 Wire Mesh in Apron  6*  6*	Outlet Outlet Spillway Spillwa	6x6-W1.4/W1.4 Wire Mesh Continous Bottom & Sides	OUTLET DETAIL  ROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  SPILLWAY, EMBANKMENT SINGLE INLET  C-04.10 Sheet 1 of 2

NO DESCRIPTION OF REVISIONS MADE BY DATE  I NEW STANDARD DRAWING RLF 7/05  REVISED NOTE REFERENCE RLF 4/06  SUBDUED POST / W-BEAM GRAPHICS RLF 4/06  REVISED GENERAL NOTE RLF 8/06			,
9'-6"	→B Normal or 2' Widened Shoulder Line		GENERAL NOTES
<b>^</b> A		1/2" Expansion Joint Preformed Joint Filler (Typ)	. Location may be adjusted to accomodate guardrail post layout.
Inlet	0-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1		All concrete shall be Class B. Embankment curb concrete shall be in accordance with the Standard Specifications.
Flow	in Flow	Embankment Curb (Typ) Std Dwg C-05.10	. Where rock is encountered the outlet may be omitted, as approved by the Engineer.
Guardrail Post (Typ)		310 Day C 03.10	. When outlet is used, the wire mesh shall extend through the joint into the outlet instead of bending into the key.
→A ¿	Flow	5	. Spillway invert slope shall be uniformly down- ward from <b>A</b> to <b>B</b> . See Section B-B.
		6	. See Std Dwg C-04.30 for spillway length.
3" Minimum 6" Subgrade Shoulder Slope Break  6x6-W1.4/W1.4 Wire Mesh		8" Minimum Post &	All posts within the inlet shall have a "leaveout" for the full depth of the concrete. The "leaveout" shall measure a minimum of 1½ inch in front and ½ inch on the sides, and extend in back to the toe of the curb. After guardrail installation, the "leaveout" shall be filled with a one-sack grout mix or alternate material as approved by the Engineer.  • Length may be 4'-6" or 5'-0".
SECTION A-A	1/2" Expansion Joint Preformed Joint Filler		
3 £ 2'-0"   5   1   1   1   1   1   1   1   1   1		"LEAVEOUT" DETAIL  Guardrail Post  5% "x91/2" Hex HD Bolt ASTM 325 & Nut Install Nut On Traffic Side	
SPILLWAY SECTION			
Wire	8'-0"  B  PLAN  PLAN  W1.4/W1.4  Mesh 12" and Tie	6"x8" Post Sleeve ●	
		POST SLEEVE DETAIL	OUTLET DETAIL
6x6-W1.4/W1.4 Wire Mesh Continous Bottom & Sides	See General Notes 3 & 4	1 Mari Vinguia	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS
SECTION B-E	6" ['-0" 5'-6" 6	APPROVED FOR DISTRIBUTION	N DRAWING NO.

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
I)	NEW GENERAL NOTE	RLF	7/05
2	REVISED SECTION A-A GRAPHICS	RLF	7/05
3)	REVISED INLET PLAN VIEW AND SECTION A-A GRAPHICS	RLF	5/07
4)	DELETED GENERAL NOTE 4 & REARRANGED NOTES 2 - 7	RLF	5/07

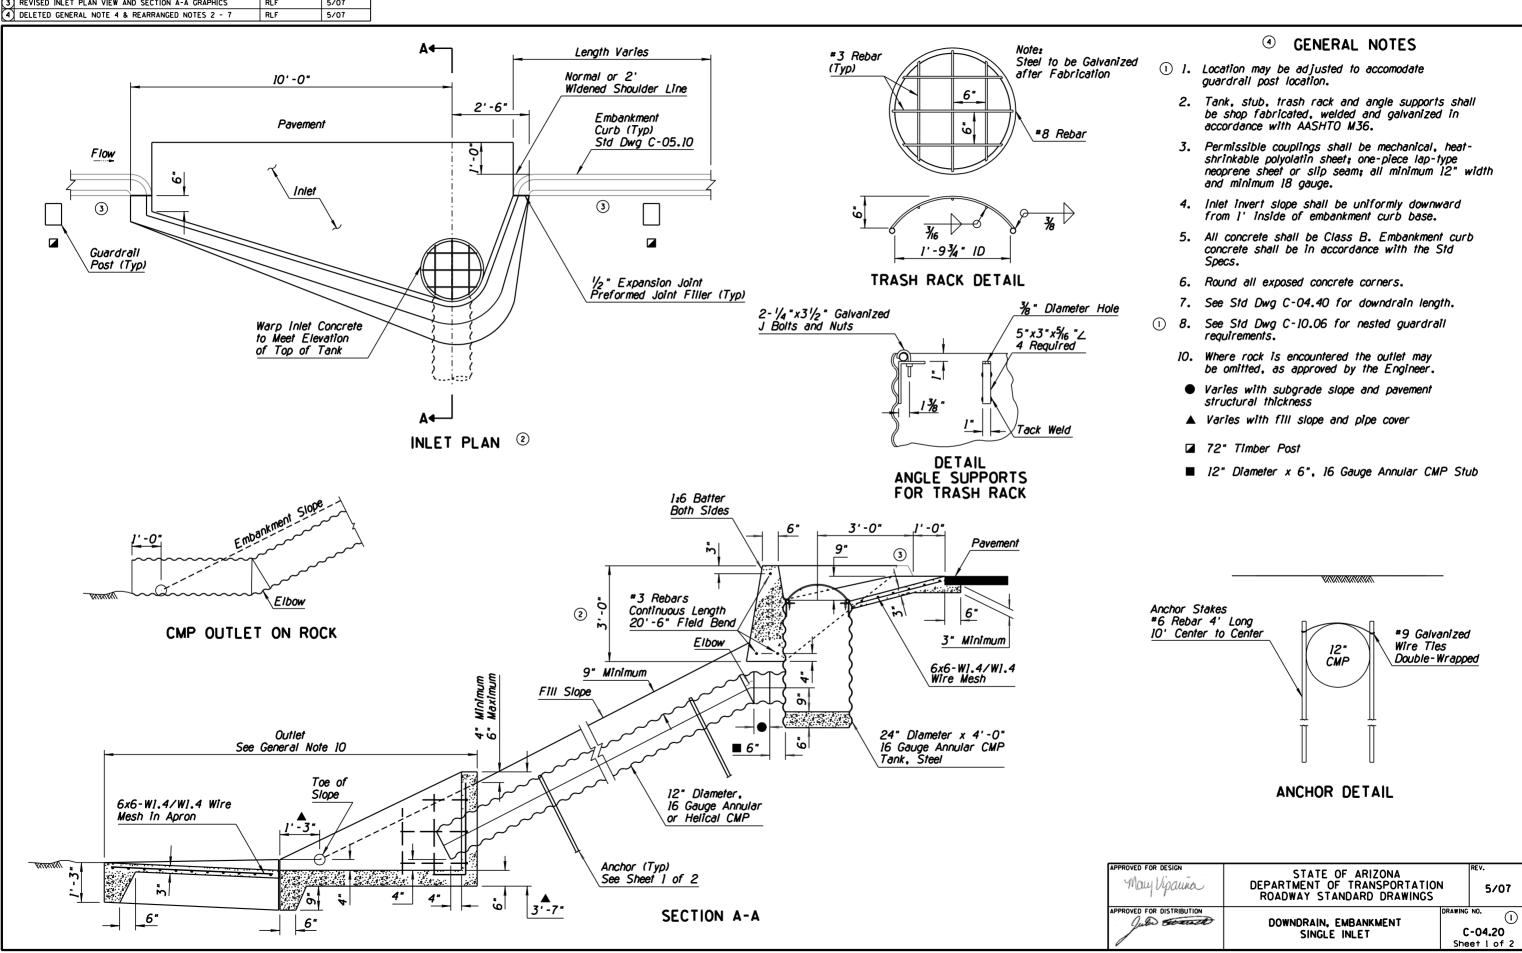

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 NEW STANDARD DRAWING RLF 7/05  2 REVISED INLET PLAN AND SECTION A-A GRAPHICS RLF 5/07  3 REVISED GENERAL NOTE 2 RLF 5/07  4	
$ ightharpoonup \Delta$	GENERAL NOTES
	1. Location may be adjusted to accompdate guardrail post
W-Beam Guardrail (Nested) (♠)	layout.  3 2. All posts within the inlet shall have a "leaveout" for the
Guardrali Post (Typ)  Normal or 2' Widened Shoulder Line  Pavement  Flow  Solution  Flow	full depth of the concrete. The "leaveout" shall measure a minimum of 1½ inch in front and ½ inch on the sides, and extend in back to the toe of the curb. After guardrail installation, the "leaveout" shall be filled with a one-sack grout mix or alternate material as approved by the Engineer.
Inlet	3. See Std Dwg C-10.06 for nested guardrail requirements.
	● - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation
1/2 " Expansion Joint	Varies with subgrade slope and pavement structural thickness
Preformed Joint Filler (Typ)	Std Dwg C-05.10 ▲ Varies with fill slope and pipe cover
Guardrail Post With Sleeve (Typ)	☐ 72" Timber post
See 'Leaveout' Detail / Warp Inlet Concrete	● Length may be 4'-6" or 5'-0" ■ 12" Diameter x 6", 16 Guage Annular CMP Stub
to Meet Elevation of Top of Tank  Trash Rack See Sheet 1 of 2  Guardrail Post  **See Sheet 1 of 2  **See S	2'-0"
INLET PLAN  Install Nut On Traffic Side  Pevement  Pevement  Install Nut On Traffic Side	Flow
#4 Rebars, 1'-0" Centrol Continuous Length 20'-6" Field Bend in Elbow  6"x8" Post Sleeve   #4 Rebars, 1'-0" Centrol Continuous Length in Continuous Length i	ster to Center  Place 11/2" Is. Bend End  -0" Into Floor
6x6-W1.4/W1.4 POST SLEEVE DETAIL  9" Minimum  POST SLEEVE DETAIL	OUTLET HEADWALL AND CONCRETE APRON
Fill Slope  See General Note 10 Sheet 1 of 2  Toe of	1/2 " Minimum (Typ)  8" Minimum
16 Gauge Annular or Helical CMP  6x6-W1.4/W1.4 Win Mesh in Apron	"LEAVEOUT" DETAIL OUTLET DETAIL
Anchor (Typ) See Sheet 1 of 2	APPROVED FOR DESIGN  STATE OF ARIZONA  DEPARTMENT OF TRANSPORTATION  ROADWAY STANDARD DRAWINGS  ROADWAY STANDARD DRAWINGS
SECTION A-A	DOWNDRAIN, EMBANKMENT DOUBLE INLET  DOWNDRAIN ON ORANGE NO.  C-04.20 Sheet 2 of 2

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(I) REIS	SSUED STANDARD DRAWING	RLF	5/07
(2)			
(3)			

#### GENERAL NOTES

1. For spillway details, see Std Dwg C-04.10.

#### NOTE TO DESIGNERS

Use earthwork cross sections for more precise spillway lengths


	APPROXIMATE LENG	TH 0	F SP	ILLWA	Y (F	<b>†)</b>	C-02	2.10 &	C-02	<b>.</b> 20 SL	OPES			
DAVENENT			E	MBANK	MENT	SLOPE								
PAVEMENT STRUCTURAL	6:1		VAF	RIES FI	ROM 6	:1 TO 2	:1				2:1			
THICKNESS	(10)			BANKME	NT HE	IGHT (F	T)	•						
(In)	5 6 7 8	10	12	14	16	18	20	22	24	26	28	30	32	
12	EMBANKMENT CURB	50	51	51	52	52	52	52						
14	AND SPILLWAYS ARE	51	51	52	52	52	52	53	CDU	604.44				
16	NOT USUALLY USED	52	52	52	53	53	53	53			VAYS ARI LY USEL			
18	FOR THIS SLOPE CONDITION. USE THE	53	53	53	53	53	53	53				NDITION.		
20	FOLLOWING EQUATION	53	53	54	54	54	54	54			HE FOLL			
22	WHEN EMBANKMENT	54	54	54	54	54	54	54			TION WH			
24	CURB AND SPILLWAY	59	58	57	57	57	56	56				QUIRED:		
<i>2</i> 6	ARE REQUIRED:	59	58	58	57	57	57	56		APPROX I	HIN FE			
28	APPROXIMATE SPILLWAY LENGTH IN FEET =	60	59	58	58	57	57	57			KMENT			
30	(EMBANKMENT	61	60	59	58	58	57	57		PLUS	PAVEM	ENT		
32	HEIGHT PLUS PAVEMENT	62	60	60	59	58	58	57			TURAL S			
34	STRUCTURAL SECTION	63	61	60	59	59	58	58		IHICKN	ESS) TII	MES 2		
36	THICKNESS) TIMES 6	63	62	61	60	59	59	58						

APPR0	APPROXIMATE LENGTH OF SPILLWAY (F+) C-02.30 SLOPES										
PAVEMENT	EMBANKMENT SLOPE										
STRUCTURAL SECTION	4	:1	VA	RIES I	FROM 4	1:1 TO	2:1		2:1		
THICKNESS (In)				E	MBANK	MENT	HE IGHT	· · · · ·			
(11)	3	4	5	6	7	8	9	10	12	14	
12	12	16	20	21	22	23	23				
14	13	17	21	22	23	23	23	SPILLWAYS ARE NOT USUALLY USED FOR THIS SLOPE CONDITION.			
16	14	18	22	22	23	23	24				
18	14	18	22	23	23	24	24				
20	15	19	23	24	24	24	24	USE THE FOLLOWING  EQUATION WHEN A			
22	16	20	24	24	24	25	25		AY IS REC		
24	16	20	24	25	25	25	25	APPRO.	XIMATE SF	PILLWAY	
26	17	21	25	25	25	25	25		TH IN FEE		
28	18	22	26	26	26	26	26	(EMBANKMENT HEIGHT PLUS PAVEMENT STRUCTURAL SECTION THICKNESS) TIMES 2			
30	18	22	26	26	26	26	26				
32	19	23	27	27	27	27	27				
34	20	24	28	27	27	27	27				
36	20	24	28	28	28	28	27				

C-02.10 AND C-02.20 SLOPES

Spillways are not usually used for these slope conditions

C-02.30 SLOPES

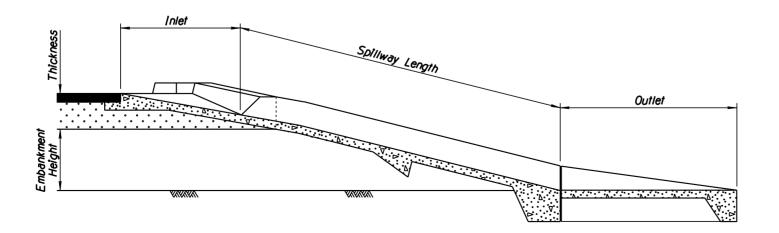

APPROVED FOR DESIGN

May Vigation

DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION

SPILLWAY LENGTH TABLE

C-04.30

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(I) REIS	SSUED STANDARD DRAWING	RLF	5/07
2			
(3)			
$\bowtie$			<del>                                     </del>

#### **GENERAL NOTES**


1. For downdrain details, see Std Dwg C-04.20.

#### NOTE TO DESIGNERS

Use earthwork cross sections for more precise downdrain lengths

#### APPROXIMATE DOWNDRAIN LENGTH (F+) - C-02.10 & C-02.20 SLOPES EMBANKMENT SLOPE PAVEMENT VARIES FROM 6:1 TO 2:1 2:1 6:1 STRUCTURAL SECTION EMBANKMENT HEIGHT (FT) THICKNESS (In) EMBANKMENT CURB AND DOWNDRAINS ARE NOT USUALLY USED FOR THIS SLOPE CONDITION. USE THE FOLLOWING EQUATION WHEN EMBANKMENT CURB AND DOWNDRAINS ARE INSTALLED: APPROXIMATE DOWNDRAIN LENGTH (IN FEET) = (PAVEMENT STRUCTURAL SECTION AND EMBANKMENT HEIGHT MINUS 2) TIMES 6

C-02.10 AND C-02.20 SLOPES

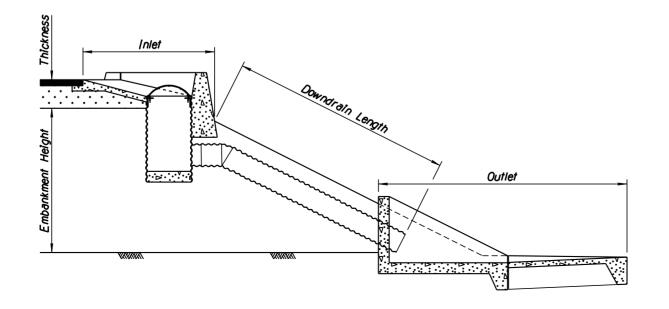


STATE OF ARIZONA
May Vipaura
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

PROVED FOR DISTRIBUTION
DOWNDRAIN LENGTH TABLE

C-04.40

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(I) RE	EVISED PLAN & SECTION VIEW	RLF	9/04
2) A(	DDED NEW GENERAL NOTE	RLF	9/04
(3)			

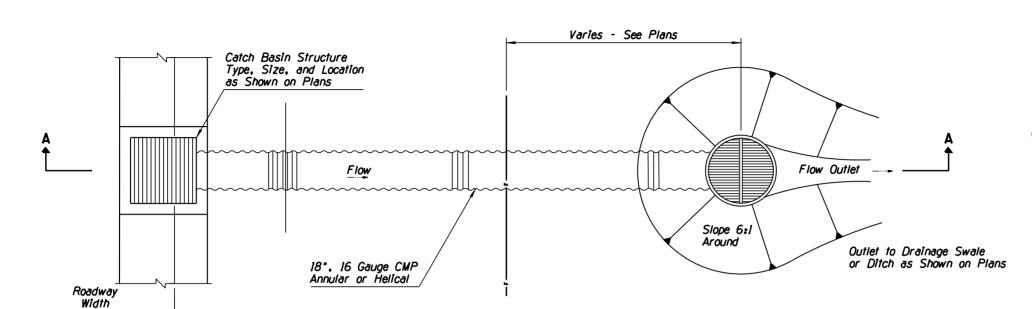


#### GENERAL NOTES

- 1. Stub shall have annular corrugation. Downdrain piping beyond stub may be either annular or helical.
- Couplings shall be mechanical heat-shrinkable polyolatin sheet; one piece lap-type neoprene sheet or slip seam; all 12" minimum width and 18 gauge minimum.
- 3. Maximum Q Allowable = 8 cfs Minimum V Allowable = 1 fps
- 2 4. Concrete shall be Class B.



1

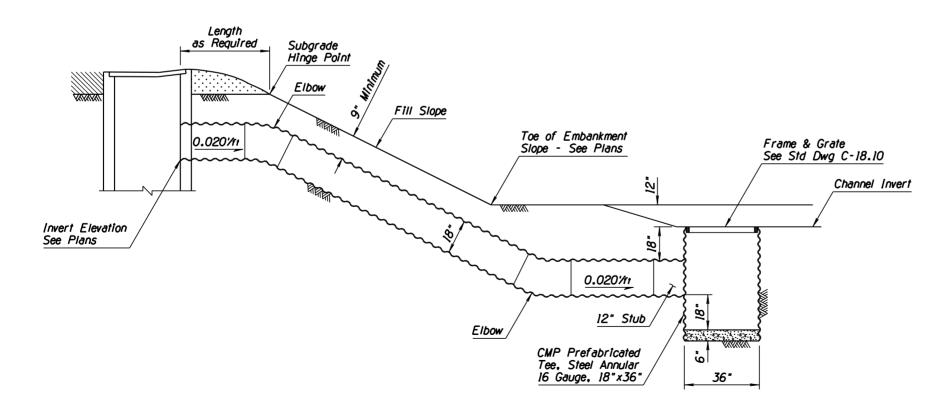

#### SECTION A-A


1

APPROVED FOR DESIGN

STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION
DOWNDRAIN ENERGY DISSIPATOR

C-04.50

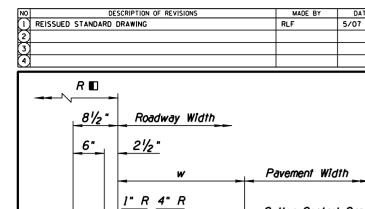

1'-0"

½" R


R ■

1'-6"

Slope See Table

Type C-1


See General Note 2

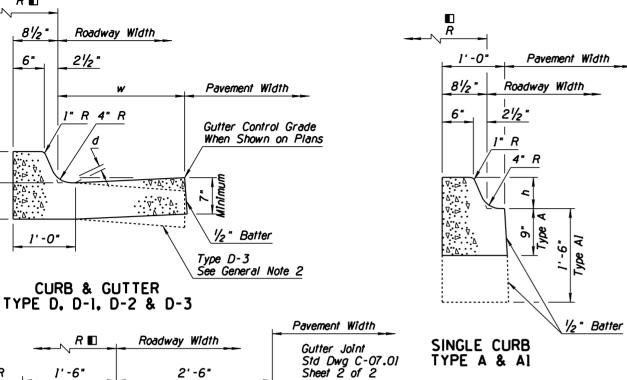

Slope Varies

ė

URBAN FREEWAY CURB & GUTTE					
Curb & Gutter Type	Curb Height h (In)	Slope	Gutter Depression d (In)		
В	6	3:1	2		
С	3	6:1	<del>%</del>		
C-1	3	6:1	N/A		

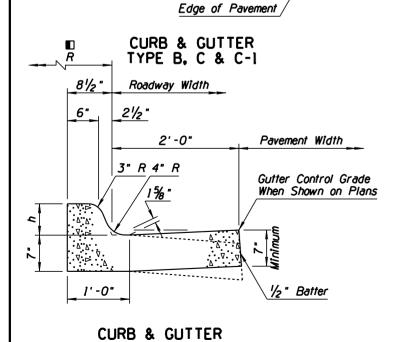


TYPE G

Horizontal


Line


-----

<u>·.⊽.</u> .⊽.⊳. ∀.

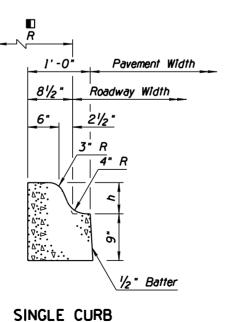


TYPE G






#### **EXPANSION JOINT DETAIL**



#### **VALLEY GUTTER**

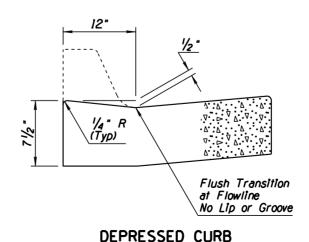


& GUTTER


#### **GENERAL NOTES** SINGLE CURB AND CURB & GUTTER

- 1. Single curb and curb & gutter may be constructed by the use of forms or the concrete may be extruded.
- 2. When the pavement section slopes away from the gutter, the slope of the gutter shall match the pavement cross slope. Therefore, the gutter depression is not applicable.
- 3. Two-inch deep contraction joints shall be placed in the curb and the gutter at locations which match the joints in adjacent PCCP and at approximate 15' centers when adjacent to AC pavement. Joints shall be either hand-tooled or sawn.
- 4. Expansion joints shall be located at tangent points in curb returns, at structures and at maximum 60' intervals. The ½" joint filler shall extend the full depth of the concrete.
- 5. Concrete shall be finished with a steel trowel followed by brushing with a fine brush along the length of the curb and gufter.
- 6. All exposed edges and hand-tooled joints shall be finished with a tool having a 1/4" radius, or as noted on the plans.
- 7. Place AB under single curb, valley gutter, and curb & gutter when shown on plans
  - See Plans (6 or 7 Inch typical)
  - Curb Radius when shown on plans

#### EMBANKMENT CURB

- 1. No additional finishing will be required after extrusion or removal of the forms when the curb presents a neat appearance and the surface is uniform in texture and color.
- 2. The curb shall conform to the cross section as shown except that the horizontal dimensions shall not vary more than  $\frac{1}{2}$ .

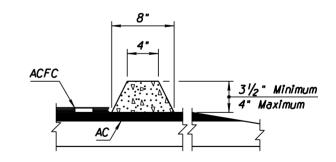

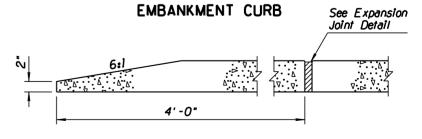


#### **CURB TERMINAL SECTION**


PROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS May Vipauna 5/07 PROVED FOR DISTRIBUTION CURB & GUTTER Jules Estate CURB C-05.10

1


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REISSUED STANDARD DRAWING	RLF	7/05
2			
(3)			
(A)			

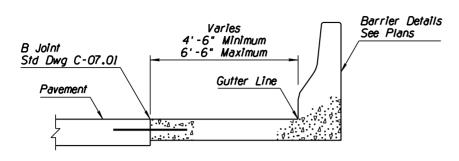

SECTION CONCRETE BARRIER APPLICATION

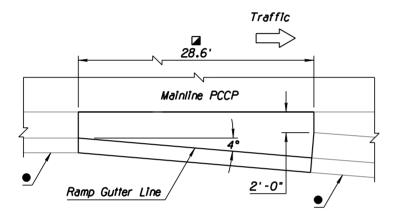


**EXIT** 

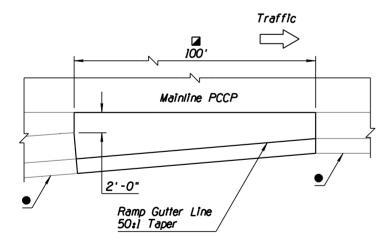



**ENTRANCE** 

TYPE I - TAPER-TYPE GUTTER TRANSITIONS AT RAMPS
PLAN VIEW

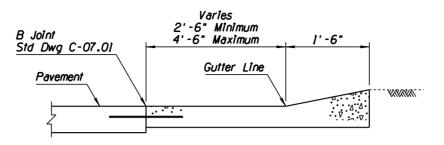

SECTION
CURB & GUTTER APPLICATION

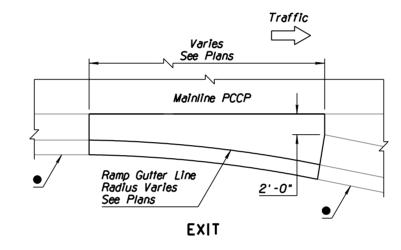

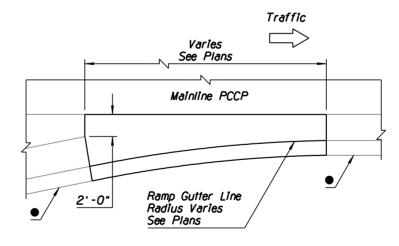

**ENTRANCE** 

#### TYPE 1 - PARALLEL-TYPE GUTTER TRANSITIONS AT RAMPS


#### PLAN VIEW

## PROVED FOR DESIGN STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS PROVED FOR DISTRIBUTION CURB & GUTTER TRANSITIONS C-05.12 Sheet 1 of 3


#### GENERAL NOTES

- 1. All gutter flow lines shall be constructed to an accurate grade.
- 2. See Slotted Drain Std Dwgs C-13.60 and C-15.91 for curb & gutter with slotted drain.
- 3. See Std Dwg C-05.10 for additional general notes and dimensions.
- 4. See Std Dwg C-07.04 for typical curb and gutter transition locations.
- □ Dimension May Vary Where Transition Occurs on Curves, See Plans
  - Type 1 Gutter Transition at Roadway Edge With Angle Point is Applicable With Concrete Half Barrier and Curb & Gutter Applications Curb & Gutter Alternative is Shown
- Curb & Gutter Type B, C or C-1, Std Dwg C-05.10


			Roadway
3	NEVISED NOTE	NCF	4700
2	REVISED NOTE	RLF	4/06
า	REISSUED STANDARD DRAWING	RLF	7/05
	DESCRIPTION OF REVISIONS	MADE BY	r DA1

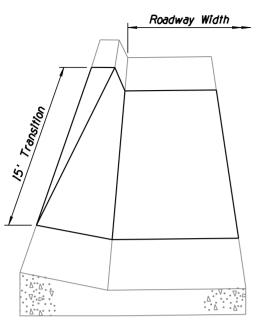


PERSPECTIVE VIEW

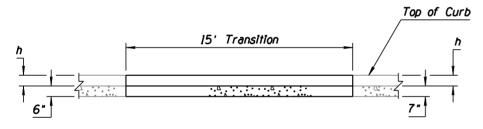


**SECTION B-B** 

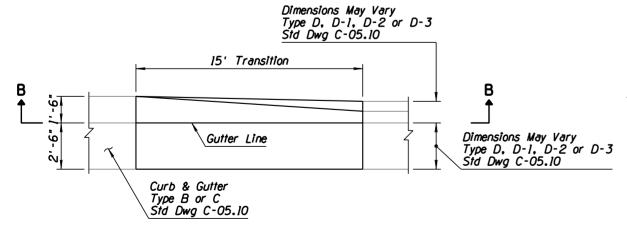


TYPE 2 - CURB & GUTTER TRANSITION
PLAN VIEW

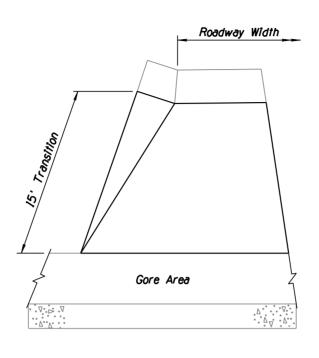

PERSPECTIVE VIEW

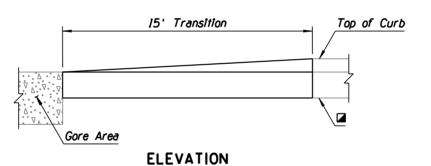


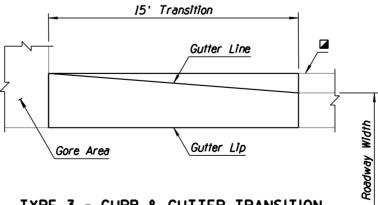


TYPE 3 - CURB & GUTTER TRANSITION AT PAVED GORE

PLAN VIEW

- ▲ Curb Height Varies O" to 7" Maximum in Depressed Curb Area Beyond the End of Barrier. See Plans for Curb Height.

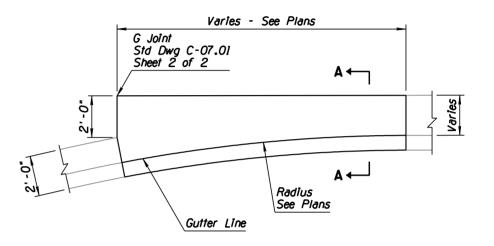

TYPE 4 - CURB & GUTTER TRANSITION



SECTION A-A

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	CURB & GUTTER TRANSITIONS	DRAWING	NO. (1

Sheet 2 of 3

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REISSUED STANDARD RLF 9/04  2 REVISED DIMENSION RLF 7/05  3	
Curb & Gutter Type B, C or C-1 Gutter Width = 4'-6" Std Dwg C-05.10  Curb & Gutter Type B, C or C-1 Std Dwg C-05.10	Curb & Gutter Type B 6° Curb Height 2" Gutter Depression Std Dwg C-05.10  Curb & Gutter Type C or C-1 3° Curb Height % Gutter Depression or Match Roadway Cross Slope Std Dwg C-05.10
TYPE 5 - CURB & GUTTER TRANSITION	TYPE 8 - CURB & GUTTER TRANSITION
Single Curb, Curb & Gutter Type D Series Std Dwg C-05.10  Single Curb, Curb & Gutter Type D Series Std Dwg C-05.10	Dwg C-05.20 Sid Dwg C-05.30
TYPE 6 - SINGLE CURB OR CURB & GUTTER TRANSITION (Curb & Gutter Shown)  Curb & Gutter Type G or D Std Dwg C-05.10 See Plans	TYPE 9 - CURB & GUTTER TRANSITION
Single Curb Type A, A-1 or G, Std Dwg C-05.10 or Non-C Std See Plans  TYPE 7 - CURB & GUTTER TRANSITION	APPROVED FOR DESIGN  Way Vipaura  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION  CURB AND GUTTER TRANSITIONS  C-05.12 Sheet 3 of 3

NO	9/04
2 REVISED NOTATION RLF	
	7 (05
3 ADDED CENERAL NOTE FOR AR PROLIFEMENT DIE	7/05
ADDED OF MENTER HOTE TON AB REGOINEMENT	5/07
4	

0

5'

Expansion Joint

Std Dwg C-05.20 Sheet 2 of 2

2' (Typ)

Sidewalk

3' (Typ)

Contraction Joint

See Plans for Station Location

(2)

Depressed Curb & Gutter

DRIVEWAY WITH SIDEWALK

ADJACENT TO CURB

Required if Driveway Width Over 20'

Expansion Joint Required if Driveway is Concrete


0

5'

Expansion Joint

Std Dwg C-05.20 Sheet 2 of 2

Sidewalk



- 2. Two-inch deep transverse contraction joints shall be placed in driveways if the driveway width is over 20'. If the driveway thickness is greater than 6", then the contraction joint depth shall be T/3, where T is the thickness of the driveway. Joints shall be either formed or sawn. Formed joints shall be finished with a tool having a 1/4" radius. See Sheet 2 of 2 for the Contraction Joint Detail.
- 3. Expansion joints shall be located between driveways and sidewalks and all abutting structures. The ½" joint filler shall extend the full depth of the concrete. See Sheet 2 of 2 for the Expansion Joint Detail.
- 4. Concrete shall be finished by means of a float, then steel trowelled and then broomed with a fine brush in a transverse direction.
- 3 5. Place AB under driveways when shown on plans.

PPROVED FOR DISTRIBUTION

Jules Estate

### LEGEND Minimum slope = 0.01 //rr Maximum slope = 0.02 //rr

Straight grade with downward slope


CONCRETE DRIVEWAYS & SIDEWALKS

DRIVEWAYS


(1)

C-05.20


Sheet 1 of 2

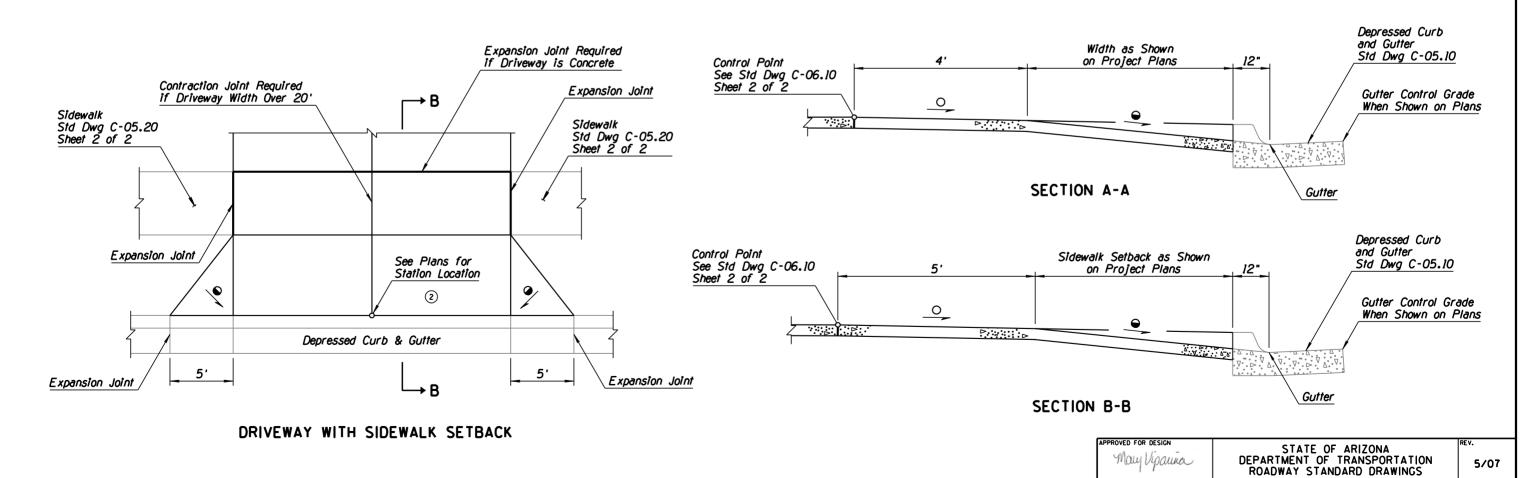


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	NEW GENERAL NOTE 5, REARRANGED 3, 4 & 5	RLF	9/04
2	ADDED SLOPE SPECIFICATIONS & REVISED SECTION VIEWS	RLF	7/05
3	ADDED GENERAL NOTE FOR AB REQUIREMENT	RLF	5/07
(4)			

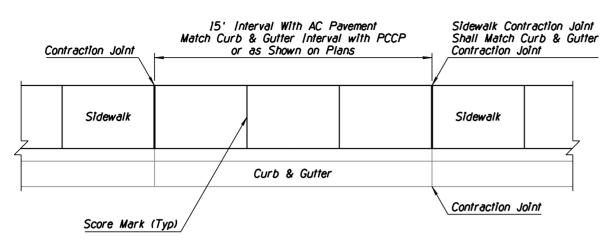


#### SIDEWALK ADJACENT TO CURB

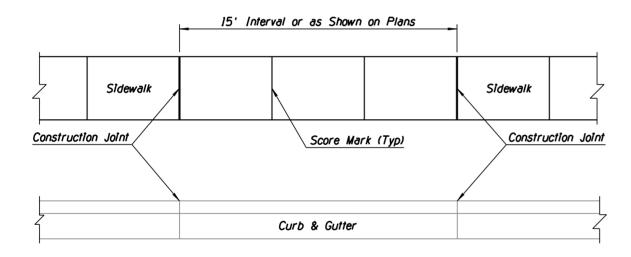

SIDEWALK SETBACK FROM CURB



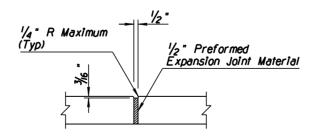

CONTRACTION JOINT DETAIL

**EXPANSION JOINT DETAIL** 


#### GENERAL NOTES

- 1. Unless otherwise specified, sidewalks shall be 4" thick.
- 2. One-inch deep transverse contraction joints shall be placed in side-walks at intervals of approximately 15' or at a spacing that matches adjacent curb and gutter. If the sidewalk is over 7' in width, a 2" deep longitudinal contraction joint shall be placed in the center of the sidewalk. The maximum area of sidewalk without contraction joints or scoring lines shall be approximately 36 square feet. Joints shall be either formed or sawn. Formed joints shall be finished with a tool having a 1/4" radius.
- 3. Score marks shall be \( \frac{1}{4} \) in depth. They shall be placed at 5' spacing when the contraction joint interval is 15' and at 6' spacing when the contraction joint interval is 12'.
- 4. Expansion joints shall be located between sidewalks and driveways and all abutting structures. Expansion joints shall match the joints in the adjacent concrete pavement or existing concrete curb and sidewalk. Maximum length of sidewalk without an expansion joint shall be 60 transverse feet. The ½ joint filler shall extend the full depth of the concrete.
- 5. Concrete shall be finished by means of a float, then steel trowelled and then broomed with a fine brush in a transverse direction.
- ${rac{3}{}}$  6. Place AB under sidewalks when shown on plans.


#### 2 LEGEND

Minimum slope = 0.01 'fr

Maximum slope = 0.02 1/ft

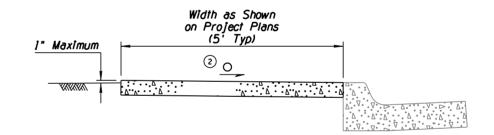


#### CONCRETE SIDEWALK ADJACENT TO CURB

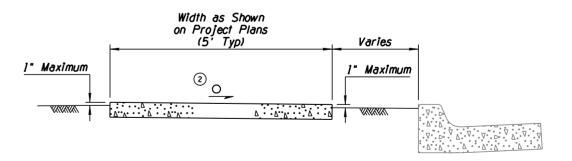


#### CONCRETE SIDEWALK SETBACK FROM CURB

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	N DRAWING N	5/07
July toward	CONCRETE DRIVEWAYS & SIDEWALKS SIDEWALKS	c-	<b>05.20</b> † 2 of 2

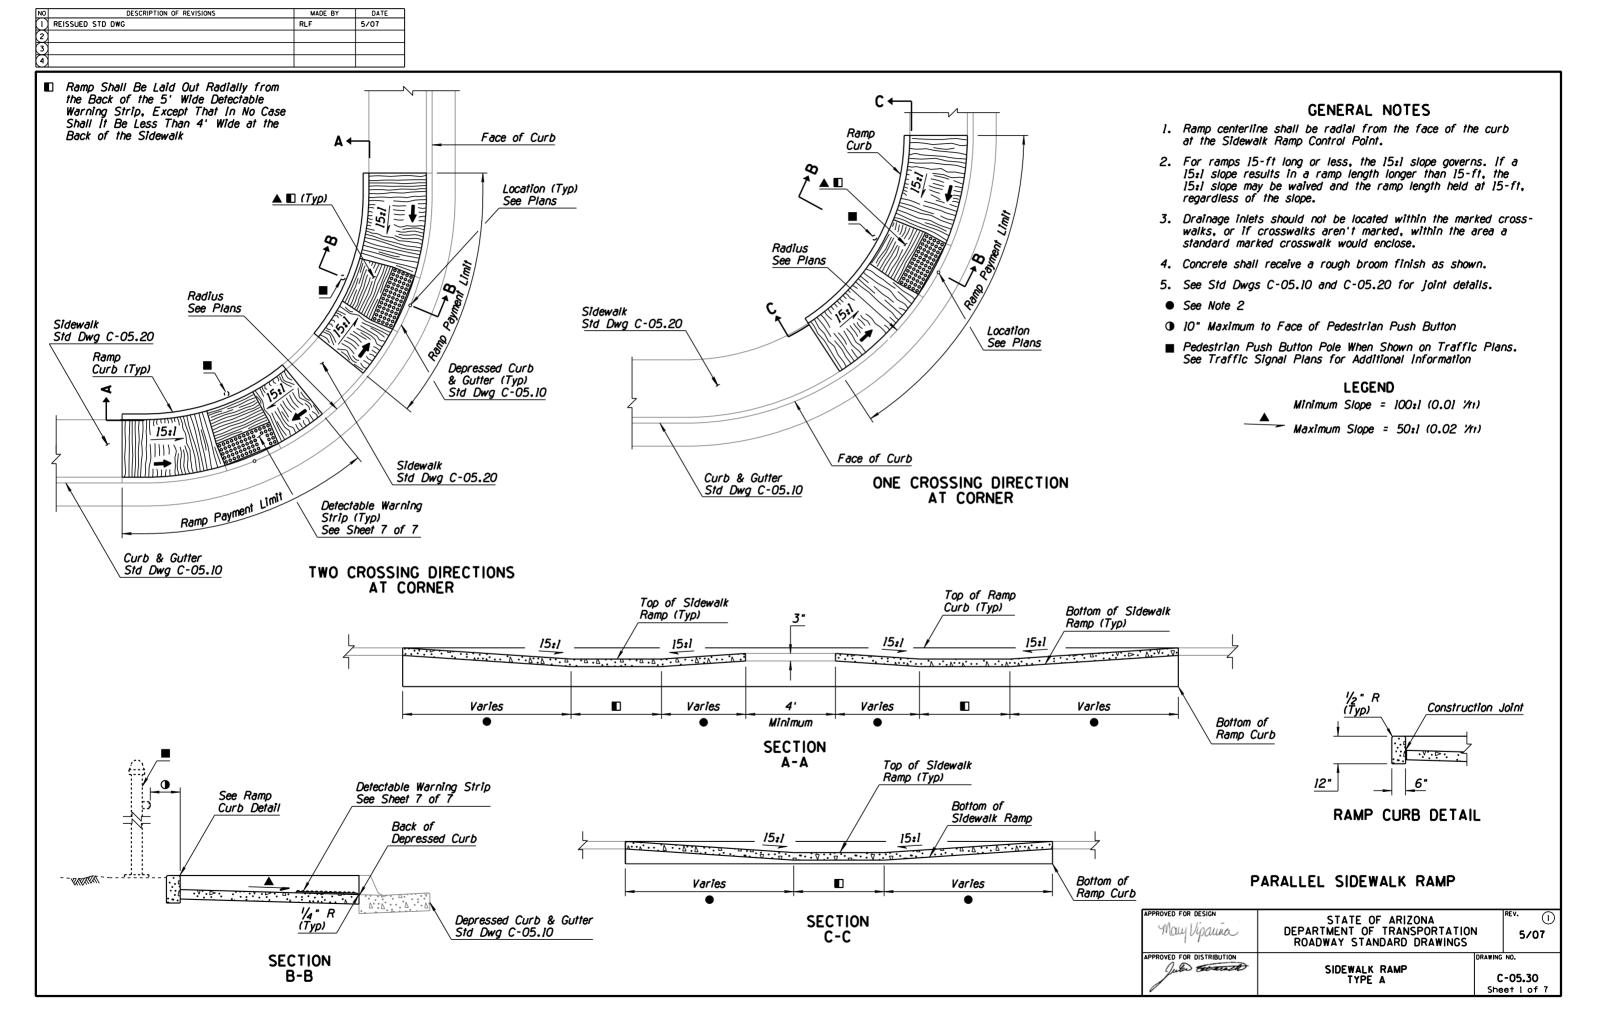

NO DESCRIPTION OF REVISIONS MADE BY DATE  I REVISED GENERAL NOTE 2 RLF II/06  2 REVISED NOTE: REMOVED REFERENCE TO NOTE 3 RLF II/06  3 REVISED CALLOUT: ADDED (TYP) RLF II/06  4 DELETED GENERAL NOTE 7 RLF 5/07					
				GENERAL NOTES	
Sidewalk Curb & Gutter				<ol> <li>Ramp centerline shall be radial from the face of the curb at the sidewalk ramp control point.</li> </ol>	
Sidewalk Curb & Gutter Std Dwg C-05.20 Std Dwg C-05.10	_	~		2. For ramps 15-ft long or less, the 15:1 slope governs. If a 15:1 slope results in a ramp length longer than 15-ft, the 15:1 slope may be waived and the ramp length held at 15-f regardless of the slope.	
				<ol> <li>Drainage inlets should not be located within the marked crosswalks, or if crosswalks aren't marked, within the are a standard marked crosswalk would enclose.</li> </ol>	<del>23</del>
		<b> </b>	1/11/1	<ol> <li>Concrete shall receive a rough broom finish as shown. The slope wings do not receive a broom finish.</li> </ol>	side
5. (Typ)			B Polyment L	<ol> <li>The Engineer may approve replacing the side slope wing will a curb at a location where access to the side of a ramp r is blocked by a pole, utility box, other obstruction, or by non-accessible surface such as a dirt planter strip.</li> </ol>	run I
Radius Q 20			5/	6. See Std Dwgs C-05.10 and C-05.20 for joint details.  ■ Pedestrian Push Button Pole When Shown on Traffic Plans.	Con
See Plans  Depressed Curb	Radius See Plans		Location See Plans	Traffic Signal Plans for Additional Information	. 566
& Gutter (Typ) Std Dwg C-05.10			See Fidis	10" Maximum to Face of Pedestrian Push Button	
				LEGEND  Minimum Slope = 100:1 (0.01 ½1)	
000000000000000000000000000000000000000	1	Face of Curb		Maximum Slope = 50:1 (0.02 ½11)	
Octobrable Warring		Tace or curv			
Detectable Warning Strip (Typ) See Sheet 7 of 7	Sidewalk				
Out a Cutter	Std Dwg C	S-05.20		Detectable Warni	ina Strin
Face of Curb  Location (Typ)  See Plans  Location (Typ)  See Plans		CTION		See Sheet 7 of	7
TWO CROSSING DIRECTIONS AT CORNER	ONE CROSSING DIRE	CTION		48" Landing Length Varies See Note 2  Back of Depressed Cu  Minimum) Depressed Cu  Back of Depressed Cu  Depressed Se Gutter Std Dwg	d Curb
③ Top-Back of Sidewalk (Typ) ③			3) NN/\n	8.6	
Top of Sidewalk Ramp (Typ)		Bottom Ramp (	of Sidewalk	SECTION B-B	
10:1		///////////////////////////////////////	10:1		
VA.V V P A	7	\$ \tag{\frac{1}{2} \tag{\frac{1} \tag{\frac{1}{2} \tag{\frac{1}{2} \tag{\frac{1} \tag{\frac{1}{2} \tag{\frac{1}{2} \tag{\frac{1}{2} \tag{\frac{1}{2} \frac	10		
4					
Varies 5' Chord Varies Va	ies Varies	5' Chord	Varies		
<del>-  -  -  -  -  -  -  -  -  -  -  -  -  -</del>	<del>- -</del>		-	PERPENDICULAR CURB RAME	,
SECTION A-A	N			APPROVED FOR DESIGN STATE OF ARIZONA DEPARTMENT OF TRANSPORTAT ROADWAY STANDARD DRAWING	GS 3,0.
				APPROVED FOR DISTRIBUTION  SIDEWALK RAMP  TYPE B	C-05.30 Sheet 2 of 7

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REVISED GENERAL NOTE 3: SLOPES & LENGTHS	RLF	11/06
2	DELETED GENERAL NOTE 8	RLF	5/07
3			
4			

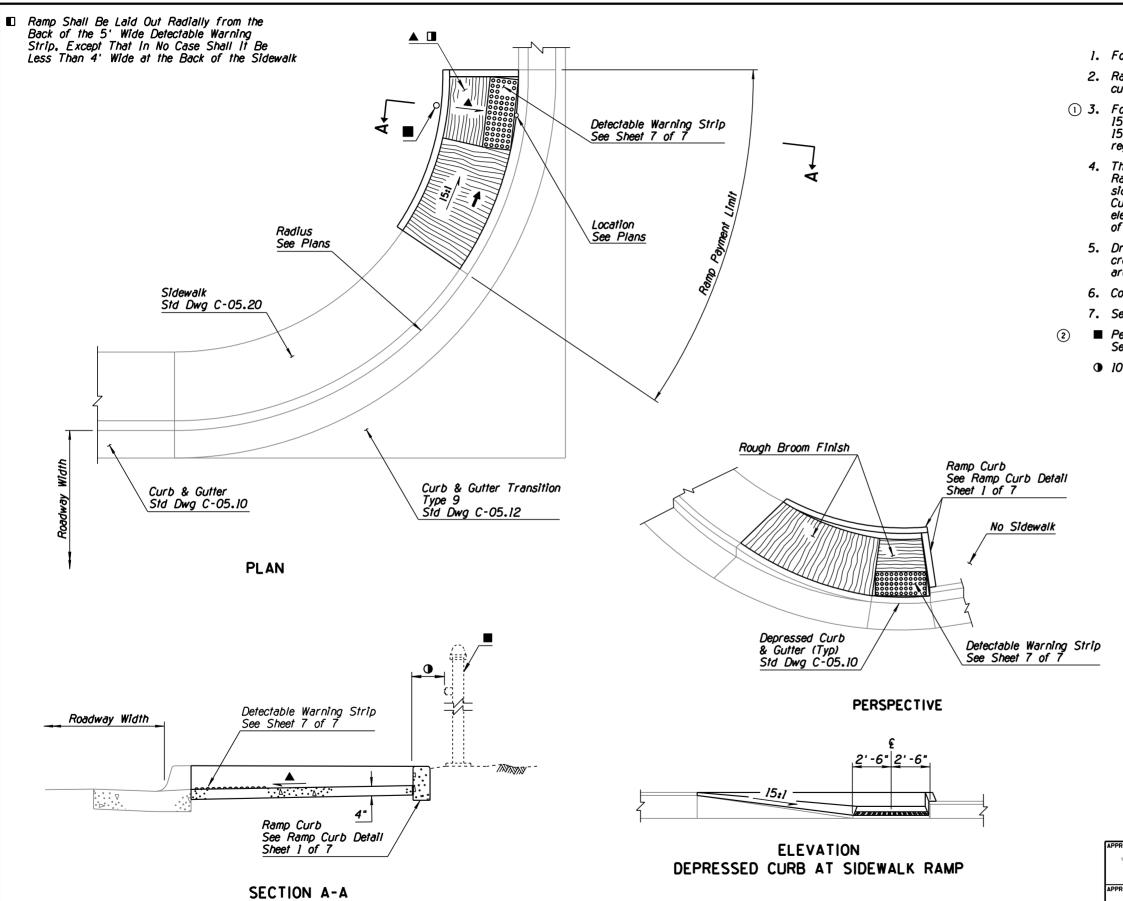

- 1. For use where sidewalk is not continuous.
- 2. Ramp centerline shall be radial from the face of the curb at the Sidewalk Ramp Control Point.
- ① 3. For ramps 15-ft long or less, the 15:1 slope governs. If a 15:1 slope results in a ramp length longer than 15-ft, the 15:1 slope may be waived and the ramp length held at 15-ft, regardless of the slope.
  - 4. The top of the Ramp Curb along the back of the Sidewalk Ramp shall match the elevation of the adjacent back of sidewalk and run parallel to the Sidewalk Ramp. The Ramp Curb along the side of the Sidewalk Ramp shall match the elevation at the back of the Curb & Gutter and the back of Ramp Curb.
  - Drainage inlets should not be located within the marked crosswalks, or if crosswalks aren't marked, within the area a standard marked crosswalk would enclose.
  - 6. Concrete shall receive a rough broom finish as shown.
  - 7. See Std Dwgs C-05.10 and C-05.20 for joint details.
- Pedestrian Push Button Pole When Shown on Traffic Plans. See Traffic Signal Plans for Additional Information
  - 10" Maximum to Face of Pedestrian Push Button

#### **LEGEND**

Minimum Slope = 100:1 (0.01 %t)


Maximum Slope = 50:1 (0.02 %t)

#### SIDEWALK RAMP AT SIDEWALK TERMINUS


May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		FEV. 5/07
APPROVED FOR DISTRIBUTION	1 = 0		NO. - <b>05.30</b> et 3 of 7

DESCRIPTION OF REVISIONS MADE BY DATE REISSUED STANDARD DRAWING RLF 4/06	
DELETED GENERAL NOTE 7 RLF 5/07	
Ramp Shall Be Laid Out Radially from the	GENERAL NOTES
Back of the 5' Wide Detectable Warning Strip, Except That In No Case Shall It Be Less Than 4' Wide at the Back of the Sidewalk	1. For use where sidewalk is not continuous.
	<ol> <li>Ramp centerline shall be radial from the face of the curb at the Sidewalk Ramp Control Point.</li> </ol>
See Sheet 7 of 7  Type D When Shown on Plans See Std Dwg C-05.10	3. The top of the Ramp Curb along the back of the Sidewalk Ramp shall match the elevation of the adjacent back of sidewalk arun parallel to the Sidewalk Ramp. The Ramp Curb along the side of the Sidewalk Ramp shall match the elevation at the back of the Curb & Gutter and the back of Ramp Curb.
Location See Plans	<ol> <li>Drainage inlets should not be located within marked crosswalks, or if crosswalks aren't marked, within the area a standard marked crosswalk would enclose.</li> </ol>
	<ol> <li>Concrete shall receive a rough broom finish as shown.</li> </ol>
Radius See Plans  Depressed Curb	6. See Std Dwgs C-05.10 and C-05.20 for joint details.
Depressed Curb & Gutter (Typ) Std Dwg C-05.10	Pedestrian Push Button Post When Shown on Traffic Plans. See Traffic Signal Plans for Additional Information
Sidewalk Std Dwg C-05.20  Barrier Transition	① 10" Maximum to Face of Pedestrian Push Button
Sid Dwg C-10.76  Ramp Curb See Ramp Curb	Detail LEGEND
Detectable Warning Strip See Sheet 7 of 7  See Sheet 1 of 7	
PERSPECTIVE  Barrier Transition  Barrier Transition  Barrier Transition	24"
Std Dwg C-10.76  Std Dwg C-10.76  Std Dwg C-10.76	<u>1.76</u>
PLAN	Detectable Warning Strip Sheet 7 of 7
Ramp Curb See Ramp Curb Detail Sheet 1 of 7	Sidewalk Ramp
3 Roadway Width	DETAIL
	SIDEWALK RAMP AT SIDEWALK TERMINUS SIDEWALK BEHIND BARRIER
SECTION B-B	APPROVED FOR DESIGN  STATE OF ARIZONA  May Vipaura  DEPARTMENT OF TRANSPORTATION  ROADWAY STANDARD DRAWINGS  REV.  5/07
SECTION A-A	APPROVED FOR DISTRIBUTION  SIDEWALK RAMP  TYPE D  DRAWING NO.  C-05.30  Sheet 4 of 1

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1	REISSUED STD DWG	RLF	4/06
2	REVISED GENERAL NOTE	RLF	4/06
3	DELETED GENERAL NOTE 9	RLF	5/07
4			
$\overline{}$			

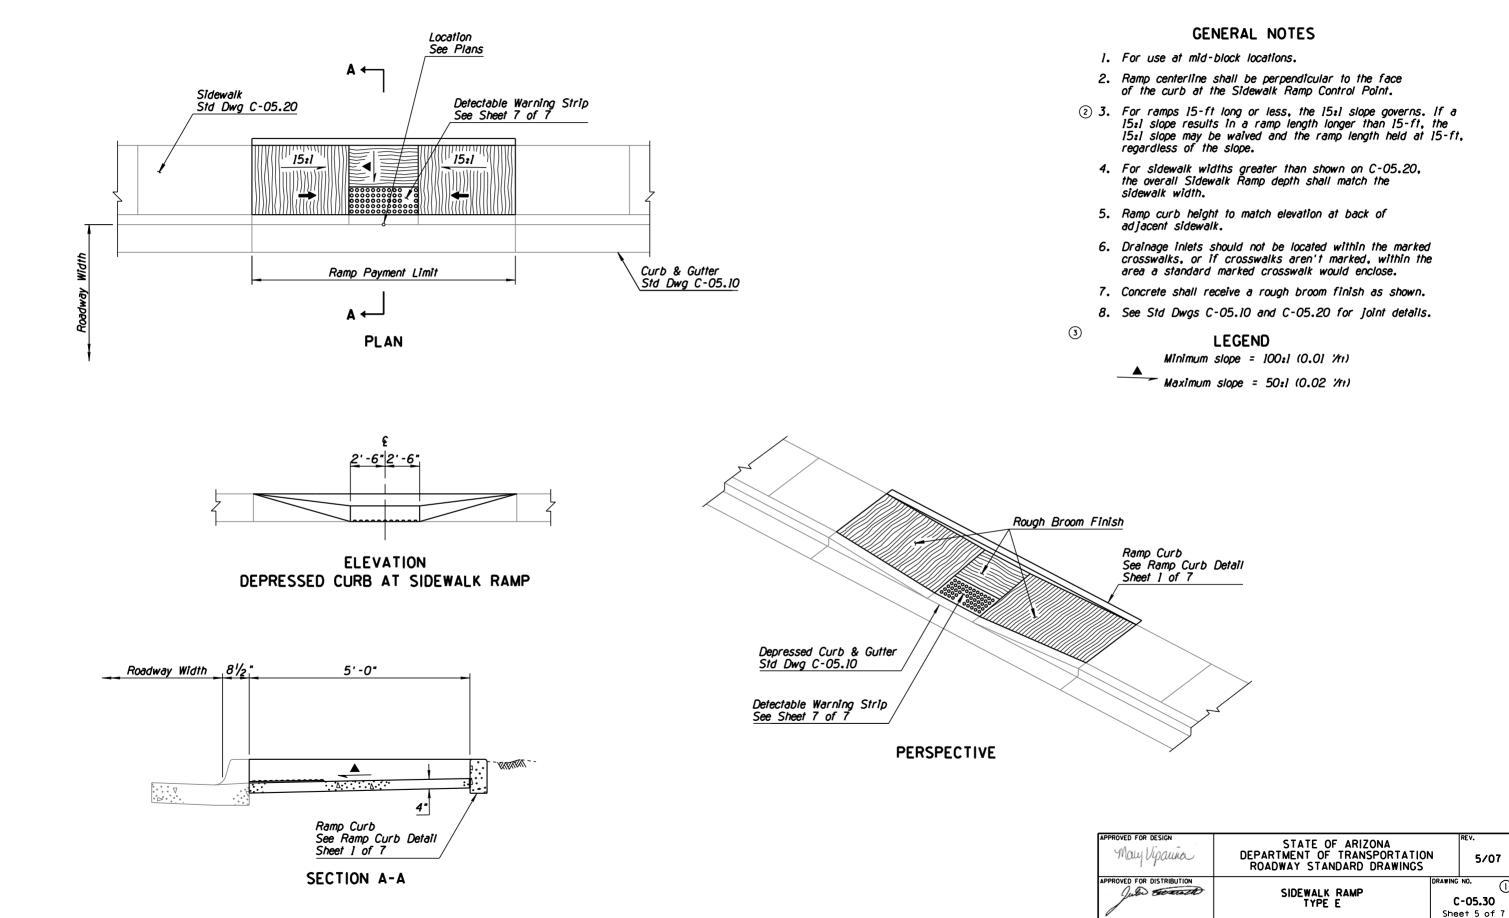


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD AS SHEET 6 OF 7	RLF	9/04
2	ADDED GENERAL NOTE 4	RLF	7/05
3	REVISED NOTE	RLF	7/05
$\mathbf{A}$	DELETED GENERAL NOTE 4	RLF	5/07

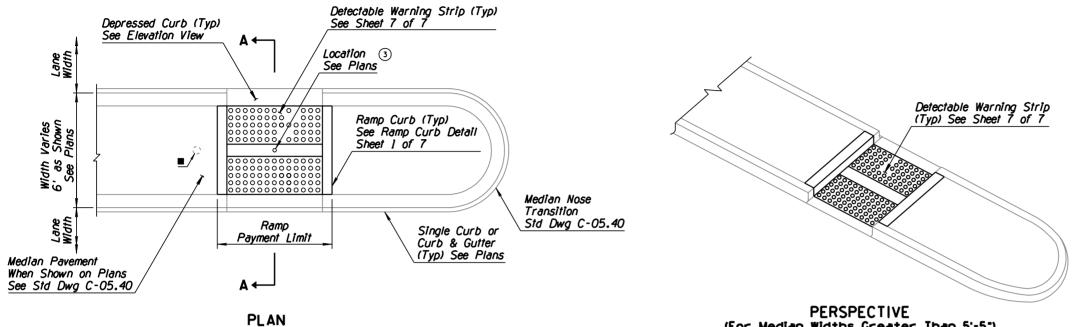


- 1. For median widths 5'-5" and less, the Detectable Warning Strip shall be continuous from back-of-curb to back-of-curb. The Detectable Warning Strip shall not extend beyond the back of curb. Modular units such as bricks or tiles shall be used to construct the Detectable Warning Strip. Partial domes at the edge of the Strip shall be ground flush with the brick or tile surface.
- 2. Use Type Al curb if median is to be landscaped.
- 3. Single curb shown; see plans for Curb & Gutter application.
- 2 Pedestrian Push Button Pole When Shown on Plans. See Traffic Signal Plans for Additional Information
  - 10" Maximum to Face of Pedestrian Push Button


(For Median Widths Greater Than 5'-5")

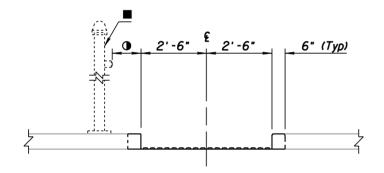


**ELEVATION** DEPRESSED CURB AT SIDEWALK RAMP

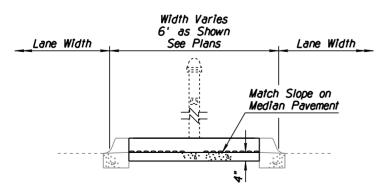

SECTION A-A (For Median Widths Greater Than 5'-5")

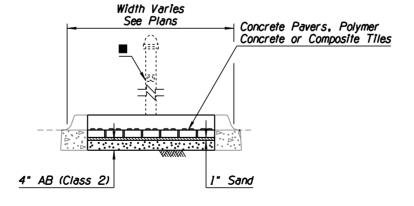

SECTION A-A (For Median Widths Less Than 5'-5")

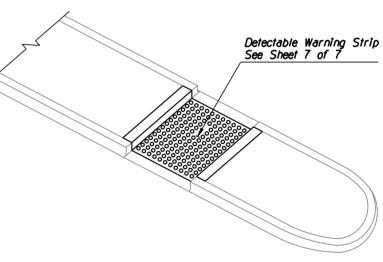


**PERSPECTIVE** (For Median Widths 5'-5" And Less) See Note 1

#### SIDEWALK RAMP AT MEDIAN ISLAND CROSSING


May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		FEV. 5/0	7
APPROVED FOR DISTRIBUTION	SIDEWALK RAMP TYPE F	-	NO. C-05.30 et 6 of	

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	ADDED PLAN & SECTION FOR BRICK OPTION	RLF	4/06
2	REVISED TITLE	RLF	4/06
(3)	ADDED LINE TO REPRESENT THICKNESS	RFL	4/06
(4)	MODIFIED DIMENSION FORMAT TO IN.	RFL	5/07

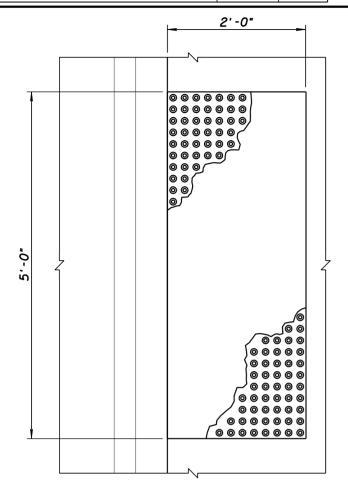


DETECTABLE WARNING STRIP

#### **PLAN**




2 SECTION

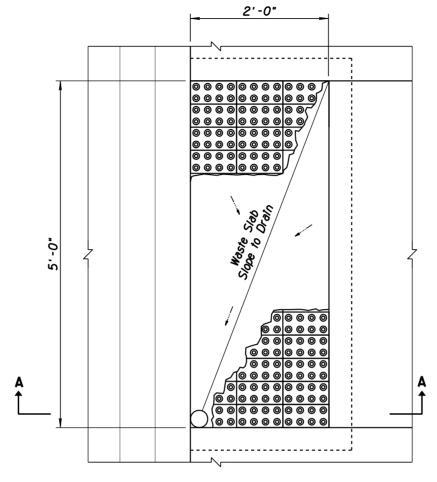

DETECTABLE WARNING STRIP BRICK OPTION

#### PLAN 1

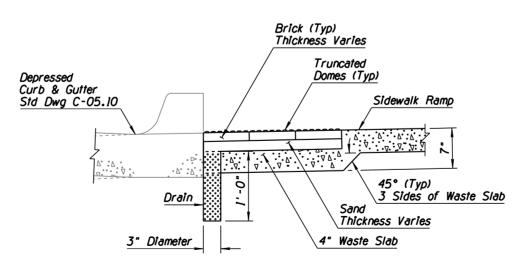

DETECTABLE WARNING STRIP BRICK OPTION

SECTION A-A


### (1)

#### GENERAL NOTES


1. Drain shall be placed in low corner and filled with coarse aggregate (AASHTO N43 Size 7) securely tied in a long-life geotextile sack.


#### **LEGEND**

- "/16" Minimum (Typ) (0.65 in. Minimum ADA Actual)
- $\blacktriangle$  1\%" to 2\%" (Typ) (1.6 in. to 2.4 in. ADA Actual) 4
- $\blacksquare$   $\frac{1}{3}$ " to  $\frac{1}{3}$ " (Typ) (0.9 in. to 1.4 in. ADA Actual) (4)
- 50% to 65% of ■



TEXTURE PATTERN DETAIL





TRUNCATED DOME **ELEVATION** 

5/07

C-05.30

Sheet 7 of 7

(1)

2


TRUNCATED DOME DETAIL 2


#### DETECTABLE WARNING STRIP DETAIL

DETECTABLE WARNING STRIP


May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	
APPROVED FOR DISTRIBUTION	CIDEWALK DAMP	DRAWING

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	REISSUED STANDARD DRAWING	RLF	9/04
2			
3			
4			

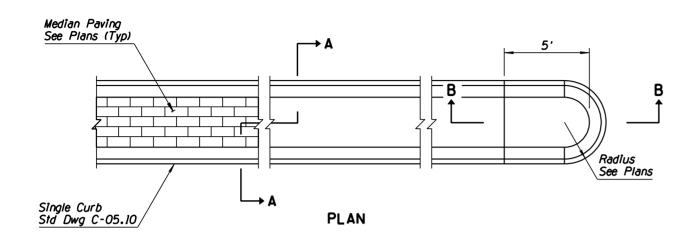

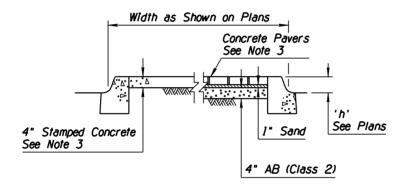


SECTION A-A



**SECTION B-B** 

- Traffic signal foundations, traffic sign foundations and pull boxes for traffic signs and traffic signals shall be installed prior to placement of median paving.
- 2. See Std Dwgs C-05.10 and C-05.20 for joint requirements.
- 3. Decorative median paving may be stamped concrete, concrete pavers, or as specified on the project plans.
- 4. Decorative median paving shall not be placed on a median nose transition or on a median island on a structure.
- A 4"x6" concrete header shall be used to end decorative paving at locations when concrete sidewalk ramps are not present.
- 6. Median nose transitions shall not be placed on departure ends of raised medians.
- 7. See Bridge Group Plans for raised median on structures.
- 8. Median paving shall be Class B concrete.

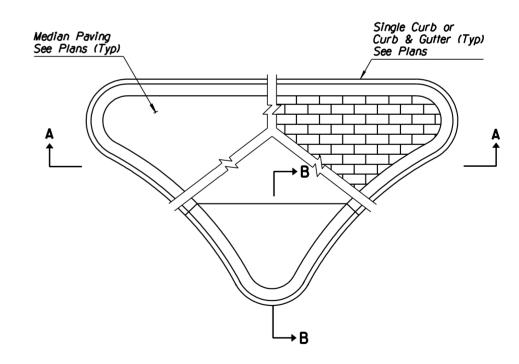


NOSE LAYOUT

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	MEDIAN PAVING AND NOSE TAPER	DRAWING	NO. (1)

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REISSUED STANDARD DRAWING RLF 5/07  2		
3		
See Note 4 See Note 4 Flow Line  Slope See Plans	See Note 4	See Note 4 See
Roadway Width See Plans  Varies - 12'-0" Maximum  See Plans  2'-0"  8'/2"  Ontional Construction Joint  See Note 4  Curb & Gutter Type D-3	To Hinge Point  R/W Line  EXPANSION JOINT  CONTRACTION JOIN  Sidewalk See Note 6  Horizontal Line  1'-3"  9"  0.02 %	· · · · · · · · · · · · · · · · · · ·
See Note 4 Varies Varies	Cement- Treated Slurry  See Note 4  See Note 4  Cement- Treated Slurry  E Slotted Drain Pipe  SECTION B-B  Transition Varies 0" to 2'-0"	<ol> <li>The PCCP surfaces within the bus bay area shall be textured transversly. Surface texturing to conform to Std Spec 401.</li> <li>Transverse weakened-plane joints shall be constructed at a maximum spacing of 15' and shall align with joints in the concrete curb and gutter.</li> <li>For additional data on slotted drains, see Std Dwg C-13.60.</li> <li>For ½" expansion joint with preformed joint fillers, see Detail A.</li> <li>Concrete pad to be poured separately from concrete bus bay pavement.</li> </ol>
varies  Varies  DETAIL B	Transition Std Dwg C-05.12	6. For sidewalk construction details, see Std Dwg C-05.20.  A See Plans: match the adjacent gutter depression  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  FOR DISTRIBUTION CONCRETE BUS BAY  C-05.50

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED NOTE & REMOVED PREVIOUS TYPE B TURNOUT	RLF	9/04
(2)			
(3)			
4			

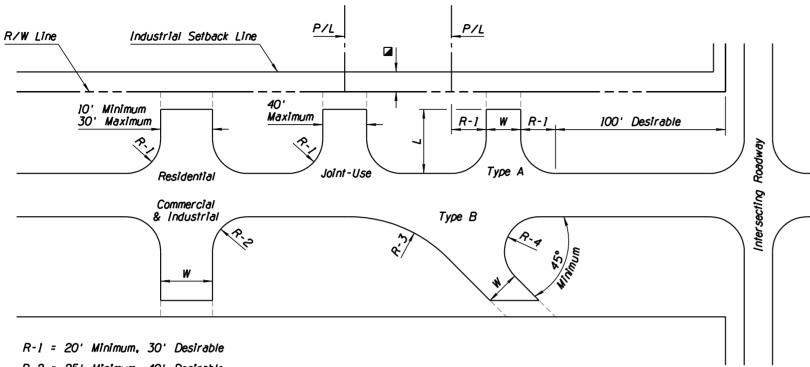

R-2 = 25' Minimum, 40' Desirable


R-3 = 80'

R-4 = 20' Minimum

W = 25' Minimum, 40' Maximum

See Proper City or County Regulation

#### RURAL DEVELOPMENTS

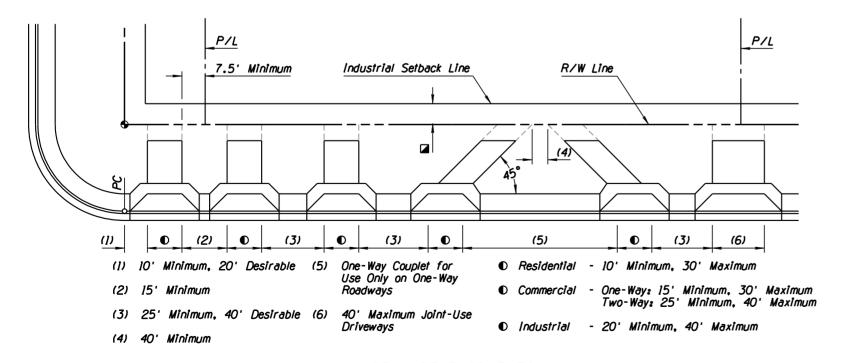

#### **URBAN DEVELOPMENTS**

#### **GENERAL NOTES**

#### 1. Driveway types:


Residential - one providing access to a single family residence, to a duplex, or to an apartment building containing five or fewer dwelling units.

Commercial - one providing access to an office, retail or institutional building or to an apartment building having more than five dwelling units.


Industrial - one directly serving a substantial number of truck movements to and from loading docks of an industrial facility, warehouse or truck terminal.

- 1 2. Joint-use driveways may become desirable for landowners of adjacent properties to service both properties. If this is the case, only one of the two adjacent landowners need apply for the access permit, but a recorded joint-use easment, signed by all parties invloved, must accompany the application form. The property line can be located anywhere, in reference to the driveway, depending on mutual agreement.
- Driveways for high volume traffic generators shall be approved individually by Regional Traffic Engineering or the Traffic Engineering Group.
- Driveways with curb returns in urban areas shall be installed only with the approval of Regional Traffic Engineering or the Traffic Engineering Group.
  - 5. Driveways and depressed curbs shall be located as noted on plans or as directed by the Engineer.
  - 6. Drainage structures shall be provided under driveways where necessary.
  - 7. Dimensions indicated as minimum shall be avoided whenever possible in favor of those indicated as desirable.
- ① 8. The Type "A" turnout is the preferable turnout design. Type "B" shall only be used when absolutely necessary.
  - Paved turnouts & plan notations will be W X L, surface material, type and standard. Example: 20' X 30' ACTO, Type A, Std Dwg C-06.10. Show radius (R) graphically.
- 10. Construction of curb, gutter, sidewalk and drainage facilities in urban areas by the permittee along that portion of the highway frontage under permit application, may be a stipulation of the permit approval if there appears to be reasonable need.
- Excavation or embankment for turnouts shall be included in quantities for main roadways.
- Base material shall be the same as that shown for main roadway, unless otherwise noted.
- 13. Desirable sideslope for rural turnouts is 6:1.




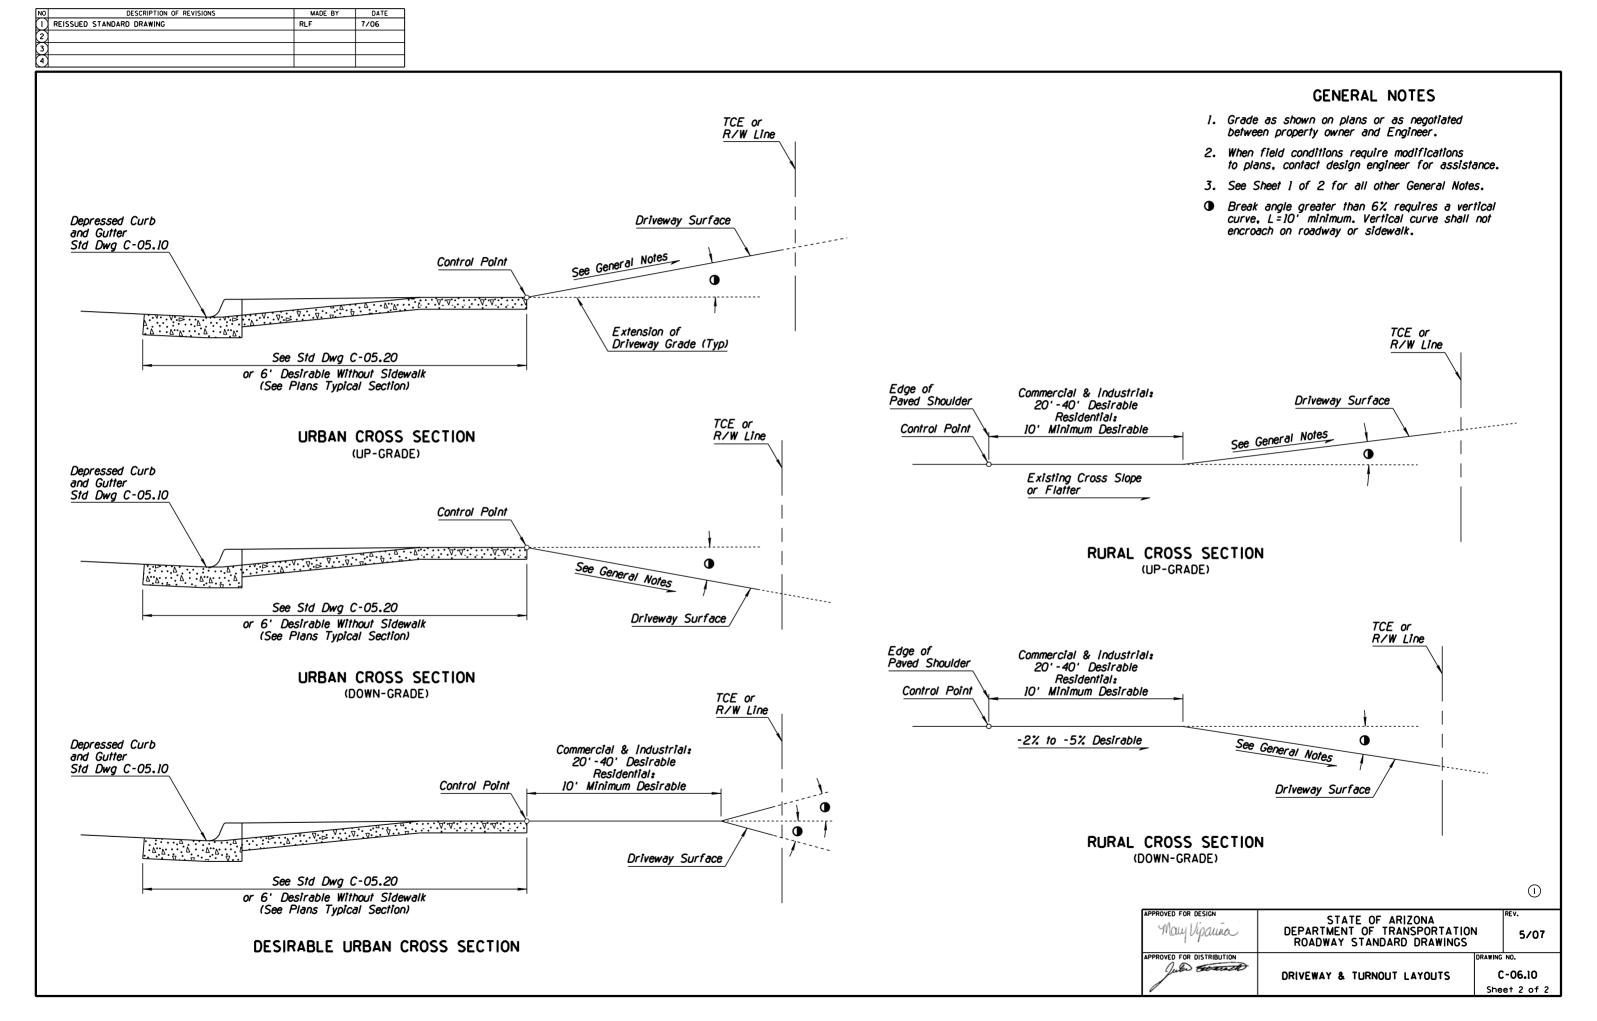


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	ADDED DEFINITION FOR 'PE'	RLF	9/04
2	REVISED DIMENSION FORMAT	RLF	7/05
3	REMOVED 'INITIAL SAWCUT' NOTATION	RLF	7/05
(4)			

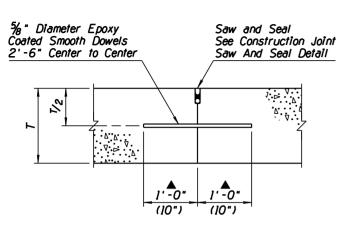


## LONGITUDINAL CONSTRUCTION JOINT LC Joint

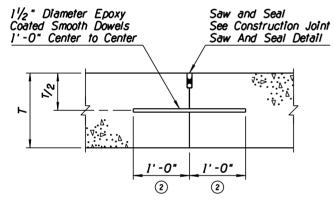


TRANSVERSE CONSTRUCTION JOINT
TO Joint
Non-Skewed & Skewed Joints

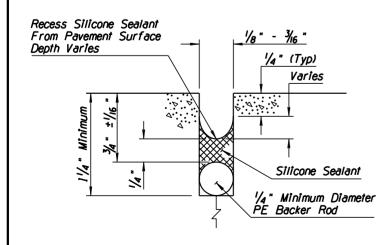


CONSTRUCTION JOINT SAW AND SEAL DETAIL

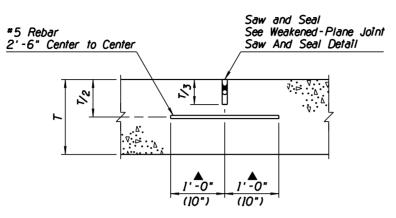

LONGITUDINAL WEAKENED-PLANE JOINT LWP Joint

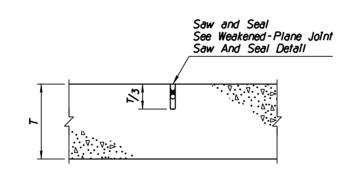

TRANSVERSE WEAKENED-PLANE JOINT
TWP Joint
W/O Load Transfer Dowel Assemblies

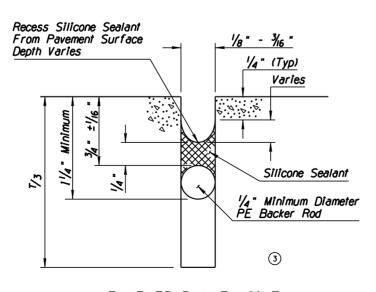

WEAKENED-PLANE JOINT SAW AND SEAL DETAIL

#### **GENERAL NOTES**

- ▲ 1. When load transfer dowel assemblies are required, use dimensions shown in ( )'s. See Assembly Placement And Edge Clearance Detail, Std Dwg C-07.02.
- In slip form type pavement construction, LWP joints shall be used. In fixed form construction either LWP or LC joints may be used.
- 3. K joints shall be constructed around the complete perimeter of miscellaneous structures, or as directed by the Engineer.
- Miscellaneous structures include, but are not limited to, catch basins, sign structure foundations, piers, abutments, barrier transitions, slotted drains and other concrete facilities, constructed within the right-of-way.

#### JOINT ABBREVIATIONS

LWP - Longitudinal Weakened-Plane Joint

TWP - Transverse Weakened-Plane Joint

LC - Longitudinal Construction Joint


TC - Transverse Construction Joint

E, H, K - Expansion Joints

S - AC/PCCP Edge-Seal Joint

T - PCCP Thickness

PE - Polyethylene

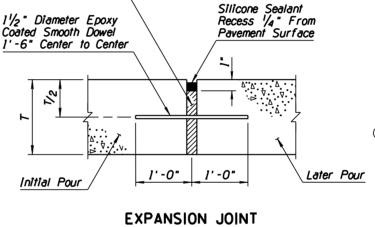

E Joint

**EXPANSION JOINT** 

H Joint

Silicone Sealant

Recess 1/4" From

Pavement Surface

Existina PCCP

1/2" Preformed


Expansion Joint

**PCCP** 

1/2 " Preformed Expansion Joint


Material

Material

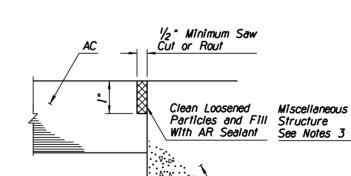



PCCP

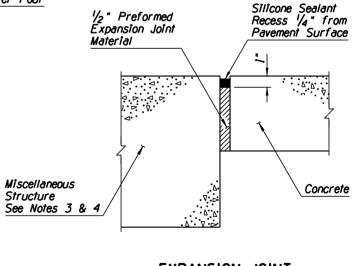

EXPANSION JOINT
K Joint (See Notes 3 & 4)

STATE OF ARIZONA

May Vipaura


DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

DRAWING NO.


PCCP JOINTS


C-07.01
Sheet 1 of 2


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
(	REISSUED STANDARD DRAWING	RLF	7/05
2			
(3)			
(4)			

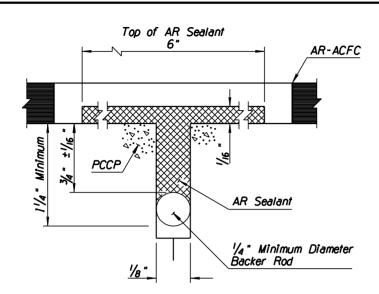


# LONGITUDINAL CONSTRUCTION JOINT DETAIL (WITH AR-ACFC)

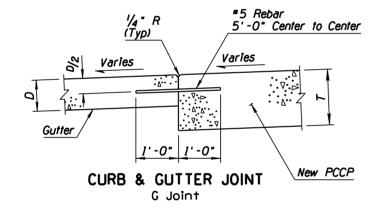

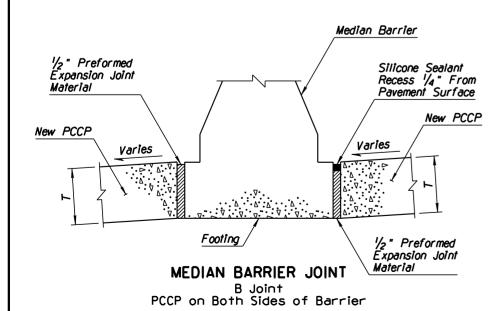

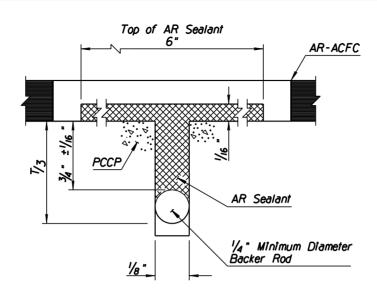

WEAKENED-PLANE JOINT DETAIL (WITH AR-ACFC)

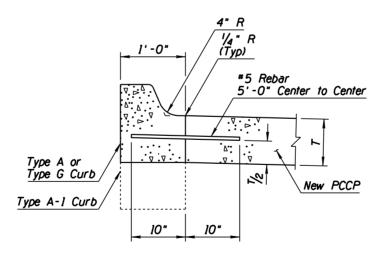

SINGLE CURB JOINT

#### GENERAL NOTES

 Joints are generally shown with pavement sloping toward the joint.


#### JOINT ABBREVIATIONS


G - Gutter Joint

T - PCCP Thickness

D - Gutter Thickness

B - Barrier Joint

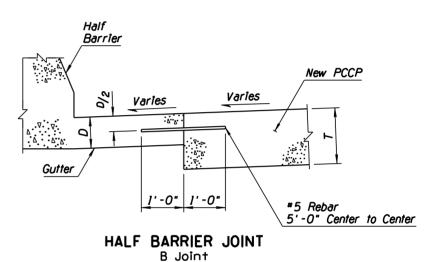


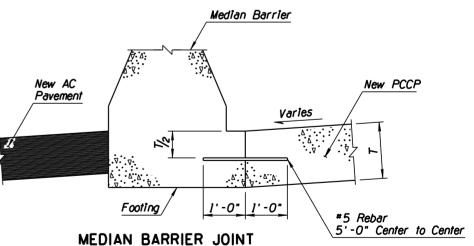


B Joint AC Pavement on Back Side of Barrier


May Vipauna	STATE OF ARIZONA		5/07
APPROVED FOR DISTRIBUTION	PCCP JOINTS	_	NO. -07.01 et 2 of 2

N0	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	MODIFIED TABLE MEASUREMENT FORMAT	RLF	9/04
2	CHANGED REFERENCE TO C-07.04	RLF	4/06
(3)	REVISED TITLE	RLF	4/06
(4)	REVISED GENERAL NOTE 1	RLF	11/06

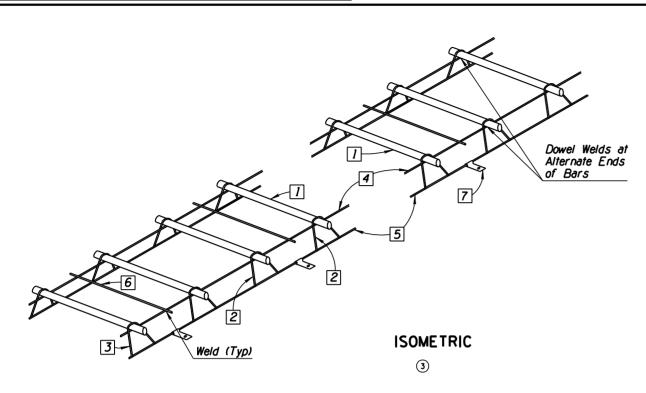


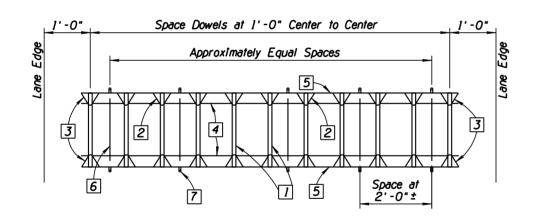


PLAN VIEW LOAD TRANSFER DOWEL ASSEMBLY

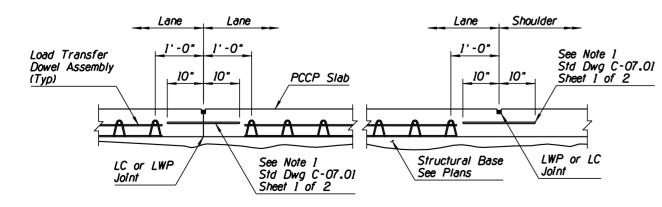


PLACEMENT AND EDGE CLEARANCE DETAIL 3



### ANCHOR STRAP DETAIL



#### END AND INTERMEDIATE LEG DETAIL

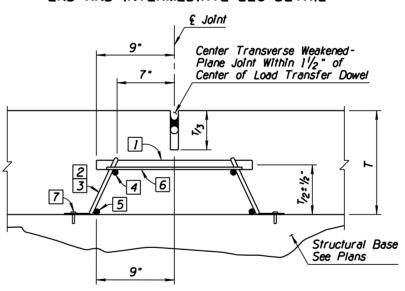

TRANSVERSE WEAKENED-PLANE JOINT WITH LOAD TRANSFER DOWEL ASSEMBLY

DIMENSION TABLE

Lane Width (Ft)

12 14 16

(Ft-In)) 10-4 12-4 14-4

#### **GENERAL NOTES**

- 4 1. Load transfer dowel assemblies shall be used with non-skewed, mainline PCCP joints.
  - Load transfer dowel assemblies are to be placed at each transverse weakened plane joint on the traveled lanes as shown on the plans.
- ② 3. See Std Dwgs C-07.01 through C-07.04 for additional information.
- 2 4. See plans or Std Dwgs C-07.03 through C-07.04 for transverse joint spacing.
  - 5. See plans for pavement thickness less than 12" or greater than 14".

Load transfer dowel assembly shall be assembled from the following materials:
(See Quantity Table)

- Dowel bars  $1\frac{1}{2}$ " diameter x 1'-6" plain round bars with coating. See Special Provisions.
- 2 Intermediate legs 2 gauge or W-5.5 wire.
- 3 End legs 2 gauge or W-5.5 wire.
- Upper space bar 2 gauge or W-5.5 wire x ①. (See Dimension Table)
- 5 Lower space bar 2 gauge or W-5.5 wire x 🖜 . (See Dimension Table)
- 6 Tie bars W-1.5 wire x 16".
- 7 Anchor strap 1"x3" steel strap, 0.079 thick.
  Place with a 1½" minimum length steel nail for LCB, 4" minimum length steel nail for ACB or AB, 0.145 diameter ASTM A227 Class 1 with ½" head or washer.


QUANTITY TABLE					
Item No	Lan	e Width	(Ft)		
770	12	14	16		
1	11	13	15		
2	18	22	26		
3	4	4	4		
4	2	2	2		
5	2	2	2		
6	5	6	7		
7	10	12	14		


May Vipaura	STATE OF ARIZONA		5/07
APPROVED FOR DISTRIBUTION	A STAND I DANICEED DOWEL ACCEMBLY		NO. -07 <b>.</b> 02

		Direction	on of
<u>ও</u>	REVISED TITLE	RLF	9/04
$\stackrel{\checkmark}{\leftrightarrow}$	REVISED JOINT ANGLE FOR CURB & GUTTER	RLF	9/04
	ADDED GENERAL NOTES 1 & 9	RLF	9/04
NO	DESCRIPTION OF REVISIONS	MADE BY	DATE

PLAN

**24' PCCP** 

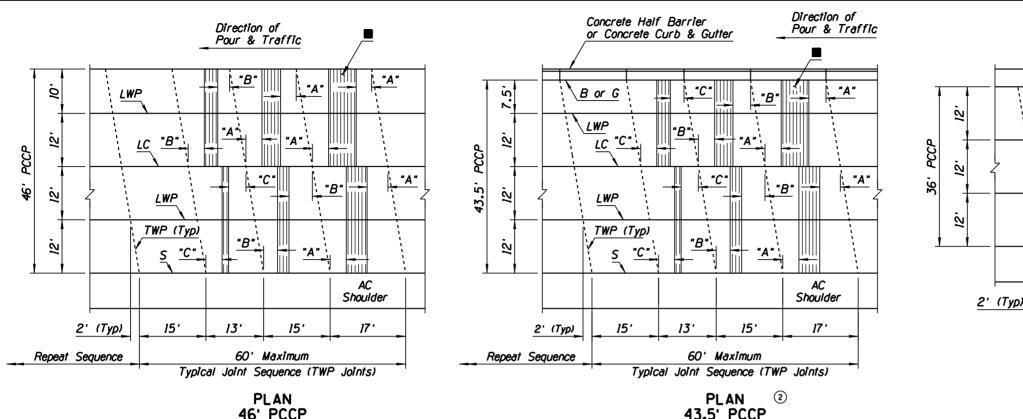

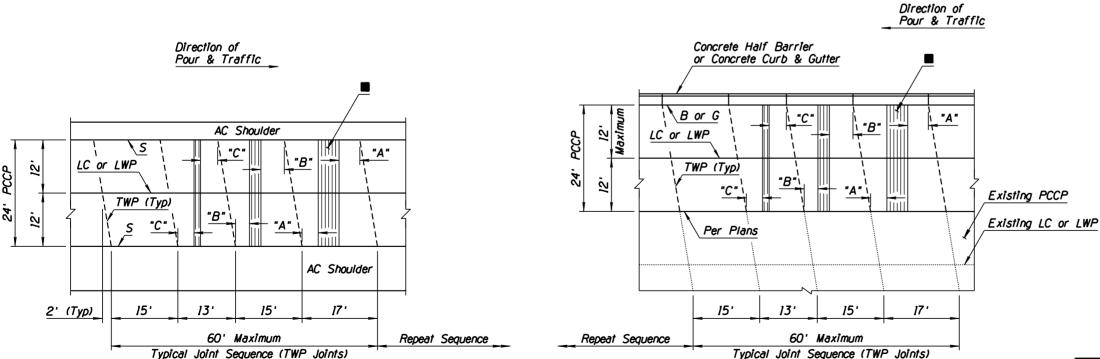

PLAN <sup>2</sup>

**24' PCCP** 

(WIDENING)

Direction of Pour & Traffic

AC Shoulder

TWP (Typ)

LC or LWP

Shoulder

2' (Typ)

15'

13'

15'

17'

60' Maximum

Repeat Sequence

Typical Joint Sequence (TWP Joints)

#### PLAN 36' PCCP

#### GENERAL NOTES

- 1. LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - 2. Skewed PCCP joints shall be used when load transfer dowel assemblies are not required.
  - 3. "A" shall equal 4' minimum (Typ)
  - "B" shall equal 3' minimum (Typ)
    "C" shall equal 2' minimum (Typ)
  - 4. See Std Dwg C-07.01 for PCCP joints and additional notes.
  - All transverse joints shall align with joints in adjacent slabs.
  - 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
  - 7. At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.
  - 8. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
- ① 9. LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.
  - Transverse Construction Joint (TC) Allowable Limits (Typ)

APPROVED FOR DESIGN

STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION
PCCP JOINT LOCATIONS
MAINLINE SKEWED JOINTS


REV.

5/07


5/07

5/07

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED JOINT ANGLE FOR CURB & GUTTER	RLF	9/04
3	REVISED TITLE	RLF	9/04
4			

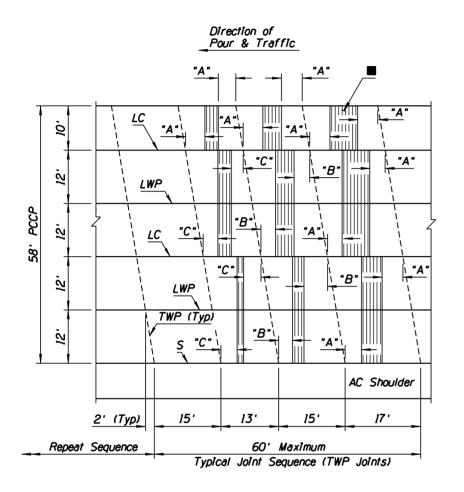

PLAN 58' PCCP

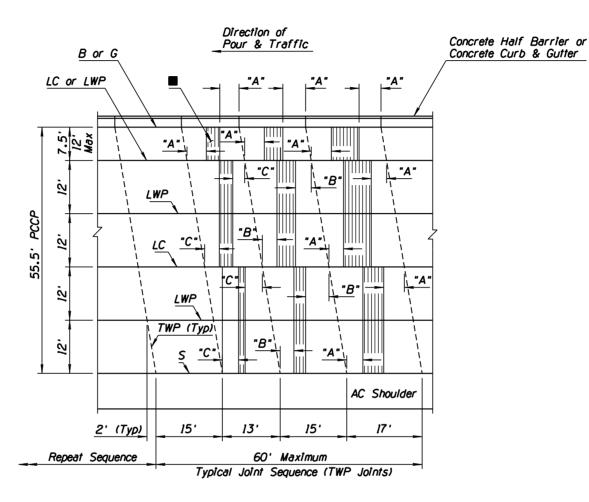

PLAN 2 55.5' PCCP

- 1. LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - 2. Skewed PCCP joints shall be used when load transfer dowel assemblies are not required.
  - 3. "A" shall equal 4' minimum (Typ)
    "B" shall equal 3' minimum (Typ)
    "C" shall equal 2' minimum (Typ)
  - 4. See Std Dwg C-07.01 for PCCP joints and additional notes.
  - 5. All transverse joints shall align with joints in adjacent slabs.
  - 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
  - 7. At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.
  - 8. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
- LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.
  - Transverse Construction Joint (TC) Allowable Limits (Typ)

APPROVED FOR DESIGN

STATE OF ARIZONA

DEPARTMENT OF TRANSPORTATION


ROADWAY STANDARD DRAWINGS

PCCP JOINT LOCATIONS


MAINLINE SKEWED JOINTS

3 Sheet 2 of 8

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED JOINT ANGLE FOR CURB & GUTTER	RLF	9/04
3	REVISED TITLE	RLF	9/04
4			

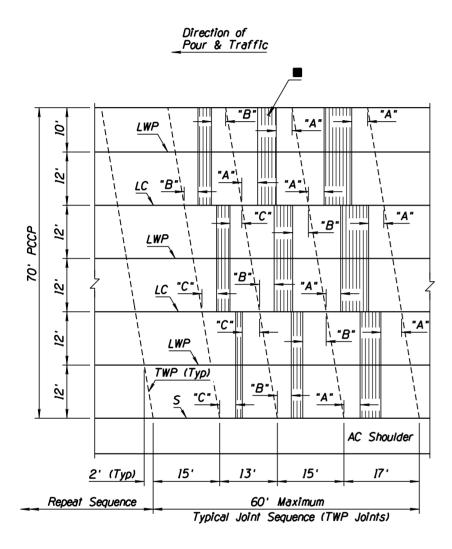

PLAN 70' PCCP

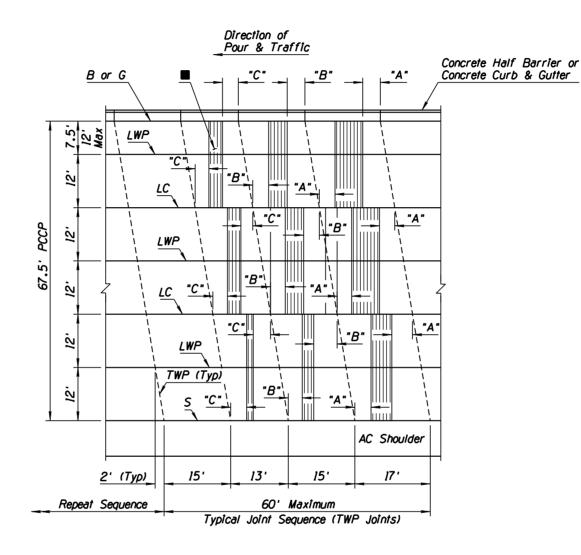

PLAN 67.5' PCCP

#### GENERAL NOTES

- LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - 2. Skewed PCCP joints shall be used when load transfer dowel assemblies are not required.
- 3. "A" shall equal 4' minimum (Typ)
  "B" shall equal 3' minimum (Typ)
  "C" shall equal 2' minimum (Typ)
- 4. See Std Dwg C-07.01 for PCCP joints and additional notes.
- 5. All transverse joints shall align with joints in adjacent slabs.
- 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
- 7. At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.
- 8. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
- 9. LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.
  - Transverse Construction Joint (TC) Allowable Limits (Typ)

APPROVED FOR DESIGN

STATE OF ARIZONA


DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION

PCCP JOINT LOCATIONS
MAINLINE SKEWED JOINTS

3 C-07.03
Sheet 3 of 8

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED JOINT ANGLE FOR CURB & GUTTER	RLF	9/04
3	REVISED TITLE	RLF	9/04
4			

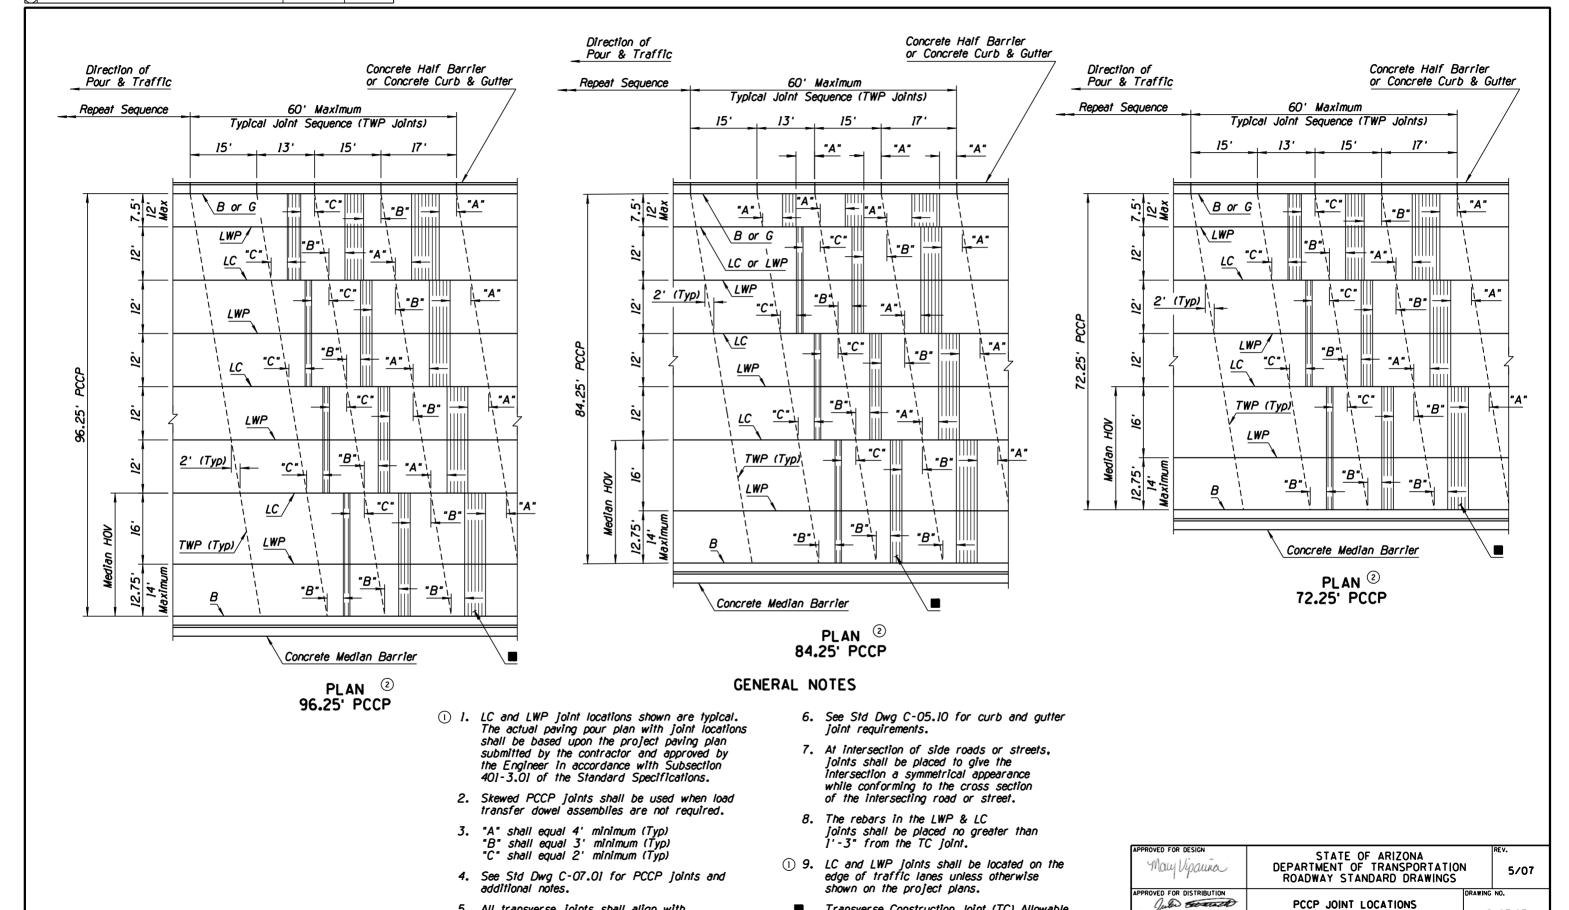

Transverse Construction Joint (TC) Allowable

Limits (Typ)

C-07.03


Sheet 4 of 8

MAINLINE SKEWED JOINTS


5. All transverse joints shall align with

joints in adjacent slabs.


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED TITLE	RLF	9/04
(3)			
4			

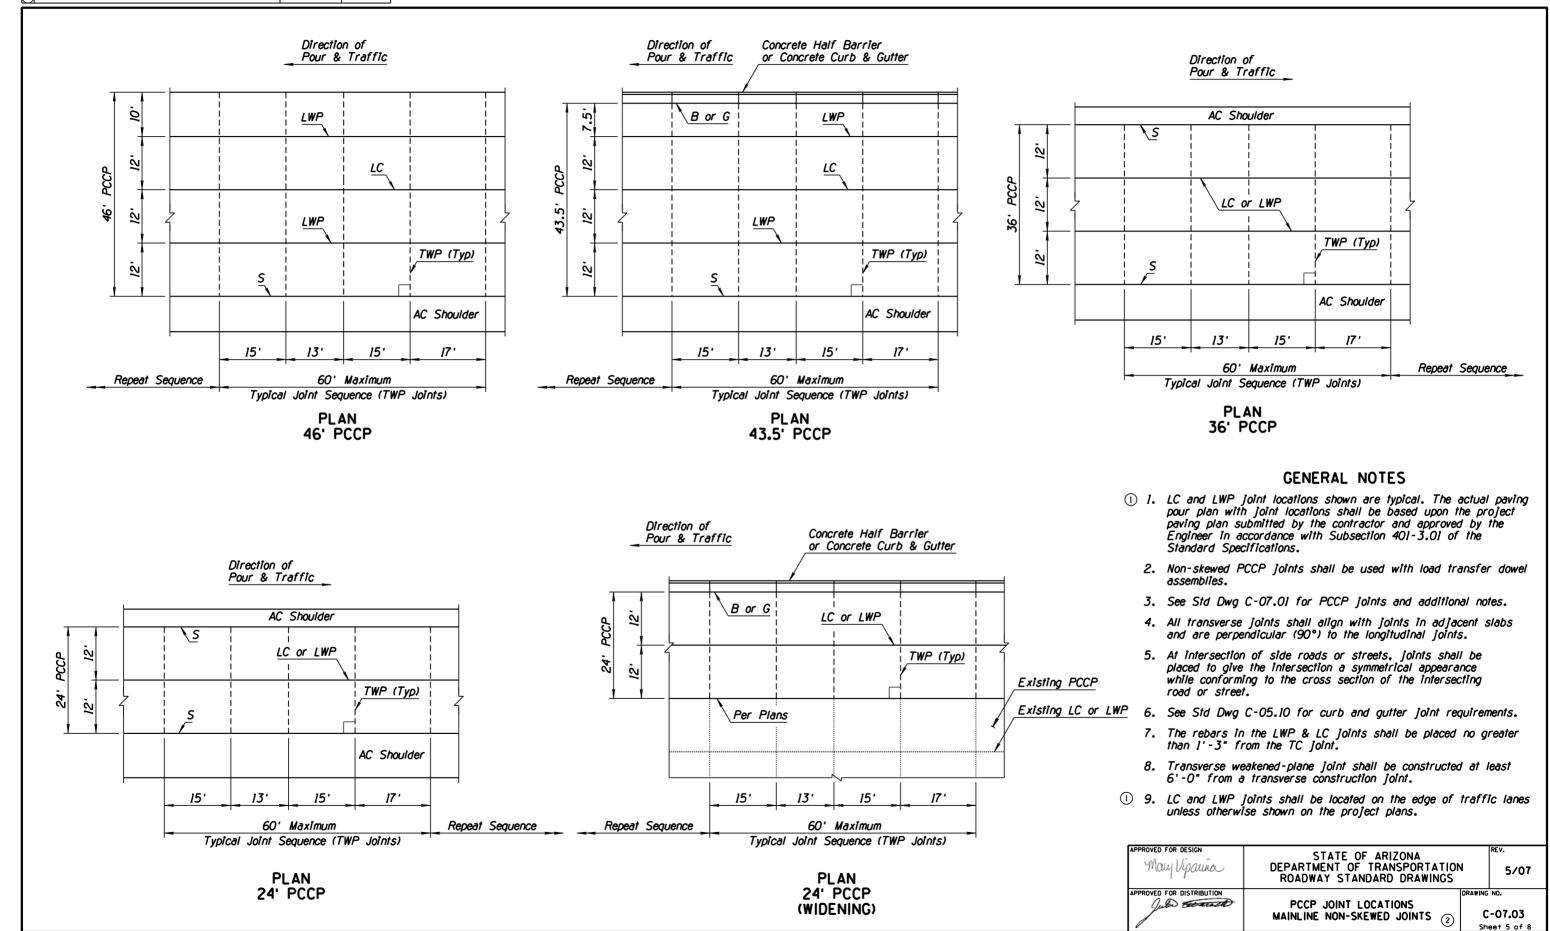

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2		RLF	9/04
(3)			
$\mathbf{r}$			

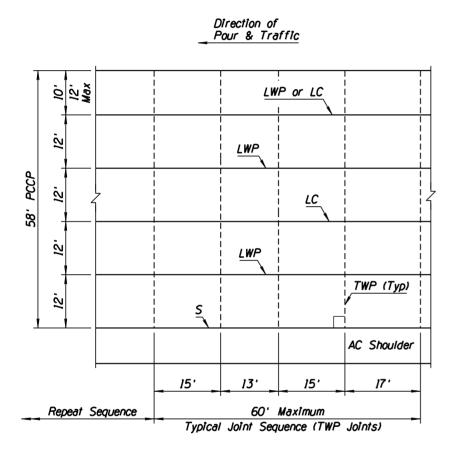

PLAN 58' PCCP

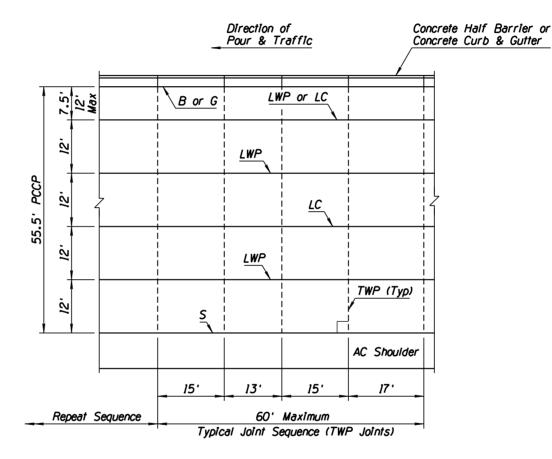

PLAN 55.5' PCCP

- LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - 2. Non-skewed PCCP joints shall be used with load transfer dowel assemblies.
  - 3. See Std Dwg C-07.01 for PCCP joints and additional notes.
  - 4. All transverse joints shall align with joints in adjacent slabs and are perpendicular (90°) to the longitudinal joints.
  - 5. At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.
  - 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
  - 7. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
  - 8. Transverse weakened-plane joint shall be constructed at least 6'-0" from a transverse construction joint.
- LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.

APPROVED FOR DESIGN

STATE OF ARIZONA


DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS


PCCP JOINT LOCATIONS
MAINLINE NON-SKEWED JOINTS (2)

ORAWING NO.

C-07.03

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED TITLE	RLF	9/04
(3)			

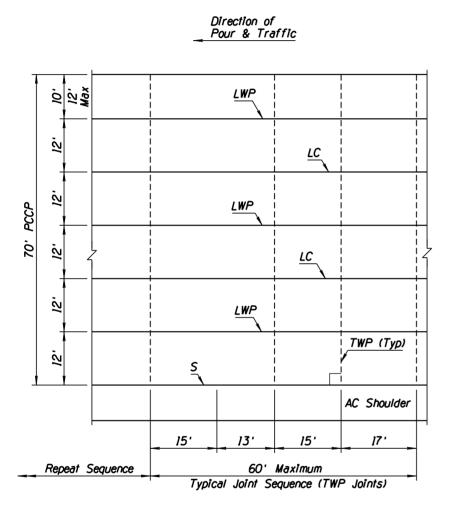


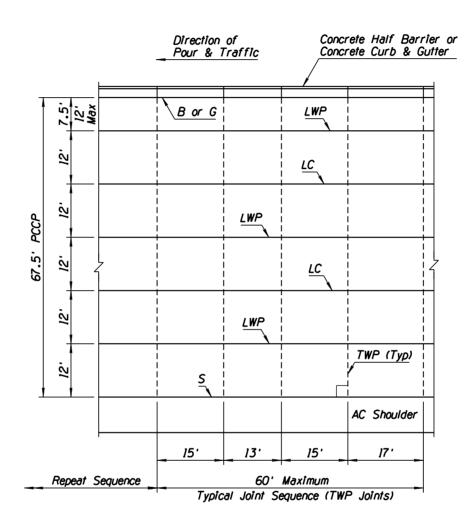


PLAN 70' PCCP

PLAN 67.5' PCCP

- LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the confractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - 2. Non-skewed PCCP joints shall be used with load transfer dowel assemblies.
  - 3. See Std Dwg C-07.01 for PCCP joints and additional notes.
  - All transverse joints shall align with joints in adjacent slabs and are perpendicular (90°) to the longitudinal joints.
  - 5. At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.
  - 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
  - 7. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
  - 8. Transverse weakened-plane joint shall be constructed at least 6'-0" from a transverse construction joint.
- ① 9. LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.



NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	ADDED GENERAL NOTES 1 & 9	RLF	9/04
2	REVISED TITLE	RLF	9/04
(3)			
4			

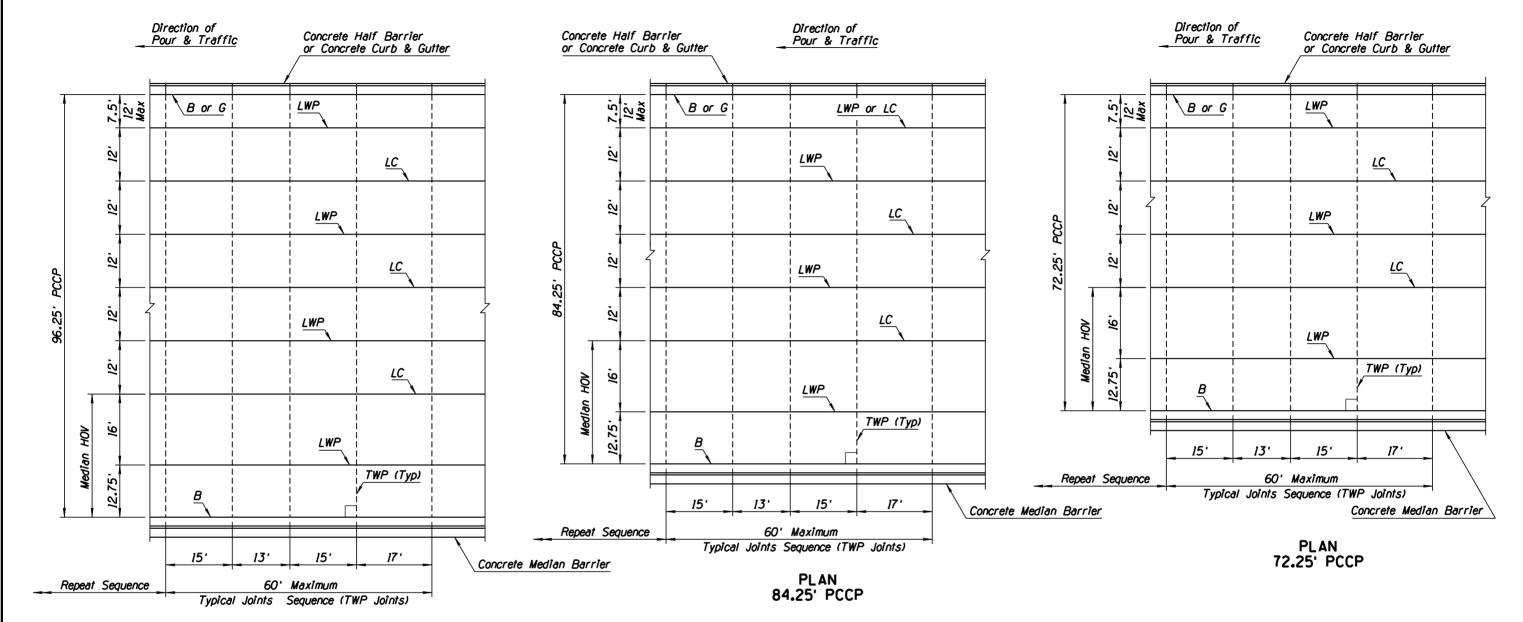



#### PLAN 96.25' PCCP


- LC and LWP joint locations shown are typical. The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.
  - Non-skewed PCCP joints shall be used with load transfer dowel assemblies.
  - 3. See Std Dwg C-07.01 for PCCP joints and additional notes.
  - All transverse joints shall align with joints in adjacent slabs and are perpendicular (90°) to the longitudinal joints.
  - At intersection of side roads or streets, joints shall be placed to give the intersection a symmetrical appearance while conforming to the cross section of the intersecting road or street.


- 6. See Std Dwg C-05.10 for curb and gutter joint requirements.
- 7. The rebars in the LWP & LC joints shall be placed no greater than 1'-3" from the TC joint.
- 8. Transverse weakened-plane joint shall be constructed at least 6'-0" from a transverse construction joint.
- LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.


May Vipauna	STATE OF ARIZONA			
PPROVED FOR DISTRIBUTION	PCCP JOINT LOCATIONS MAINLINE NON-SKEWED JOINTS (2)	C-07.03 Sheet 8 of 8		

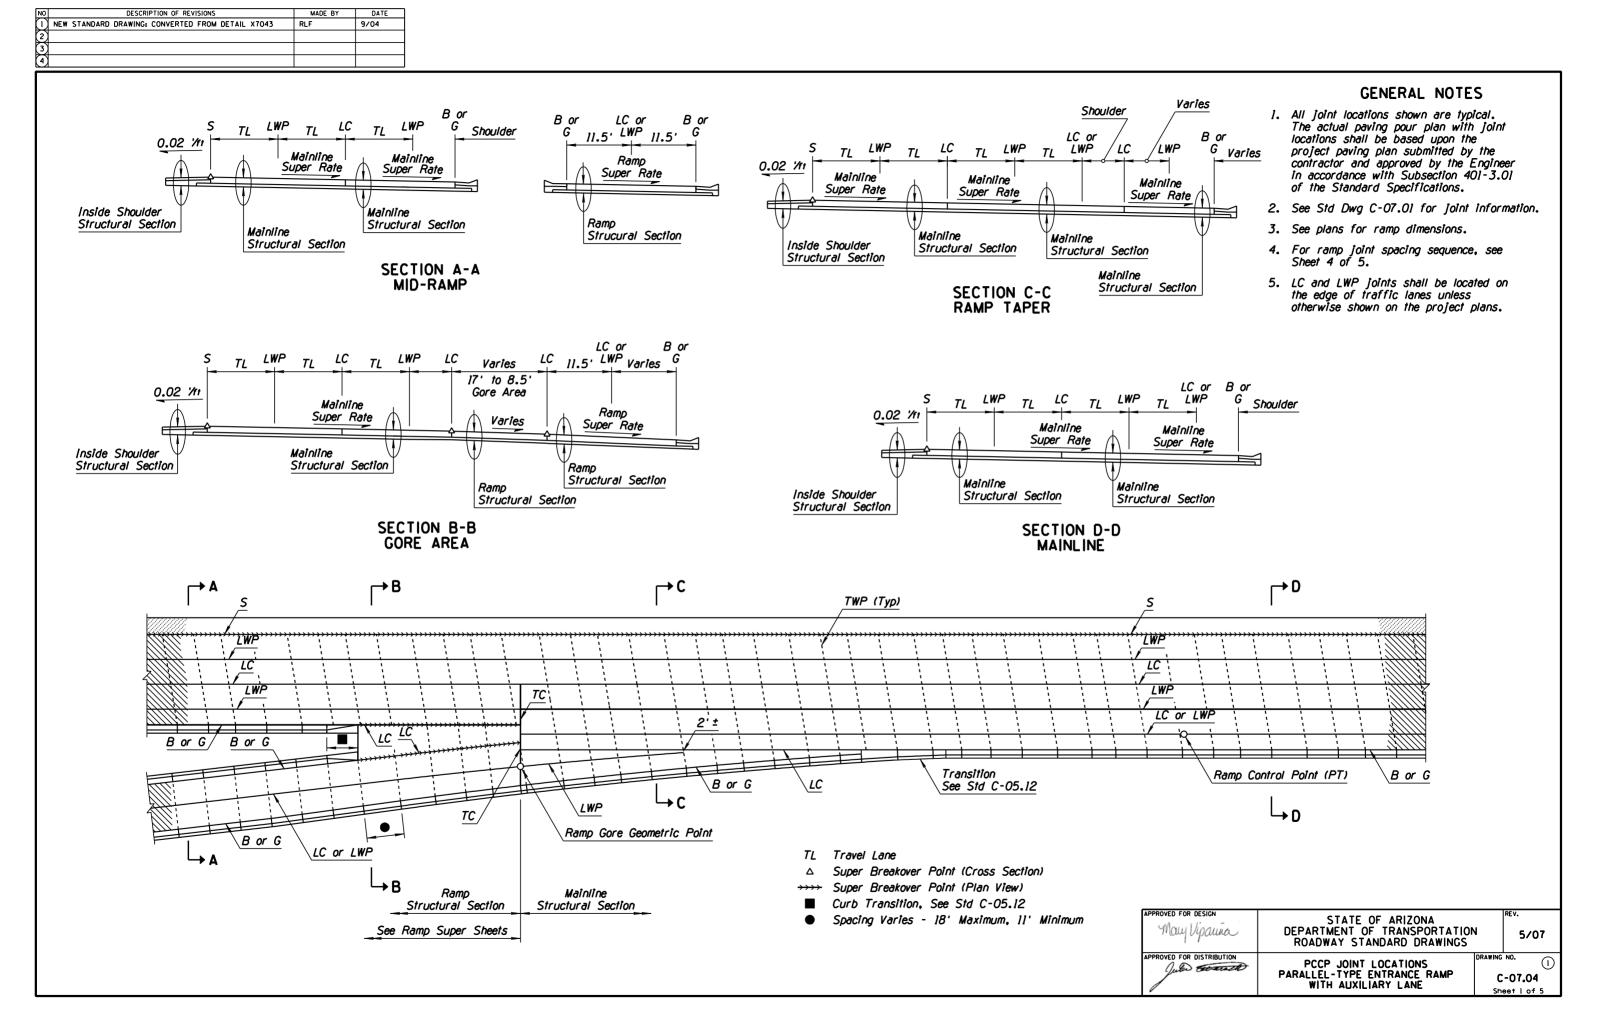


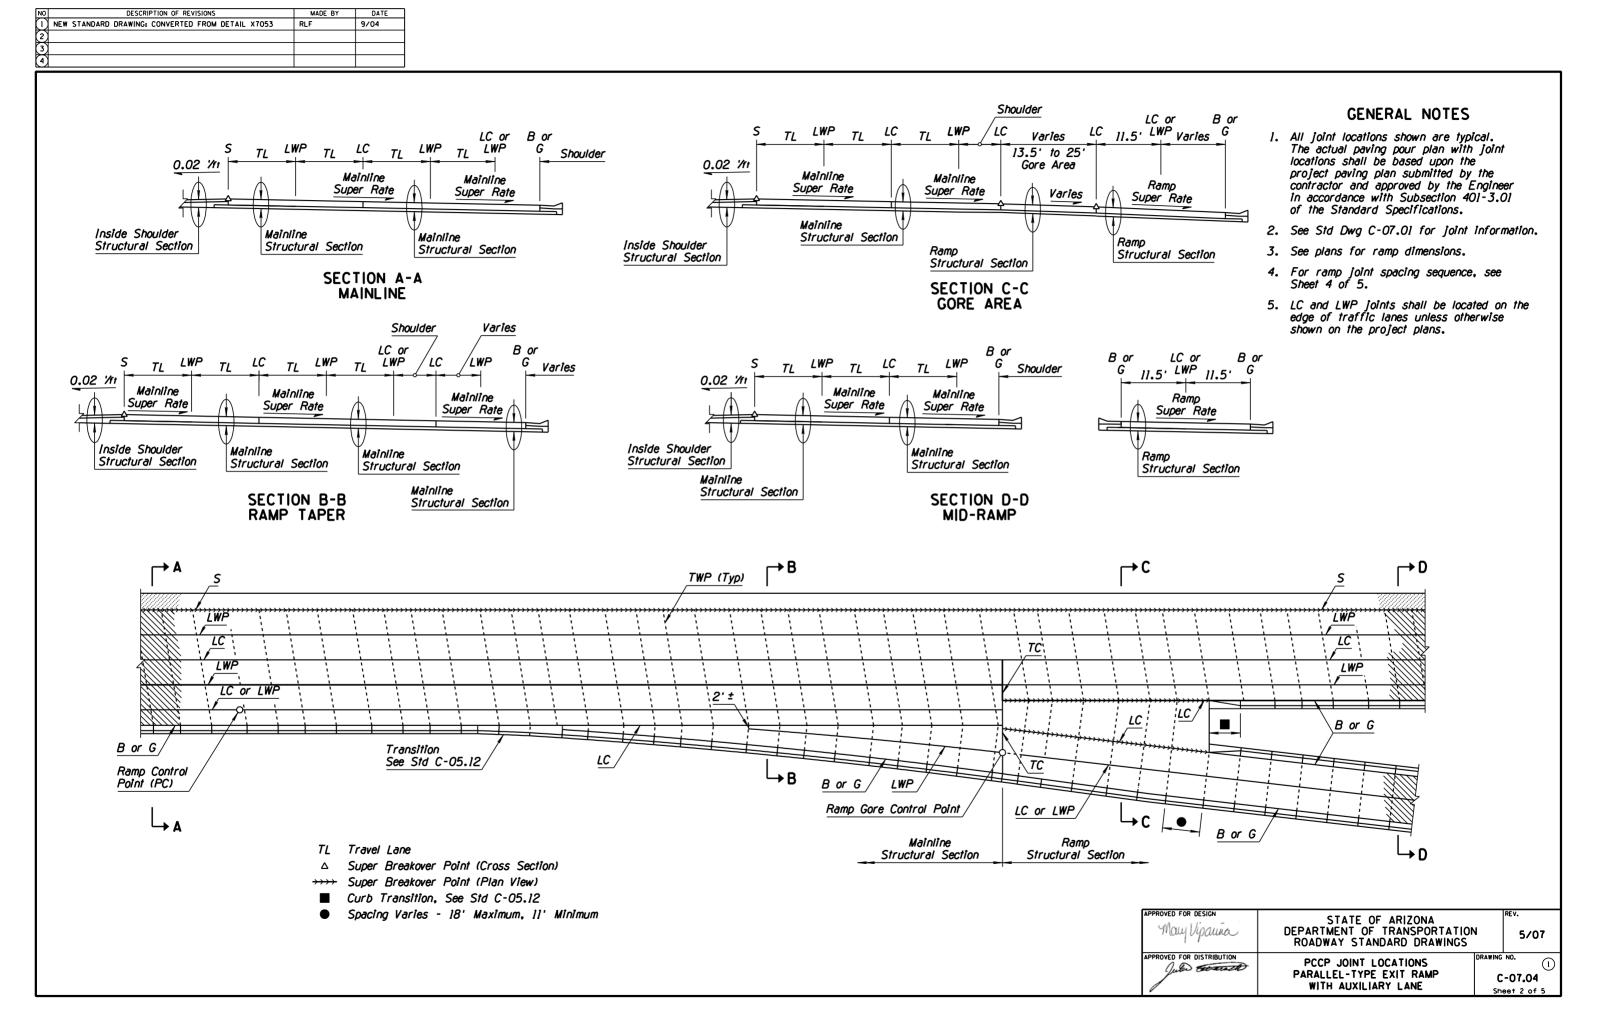

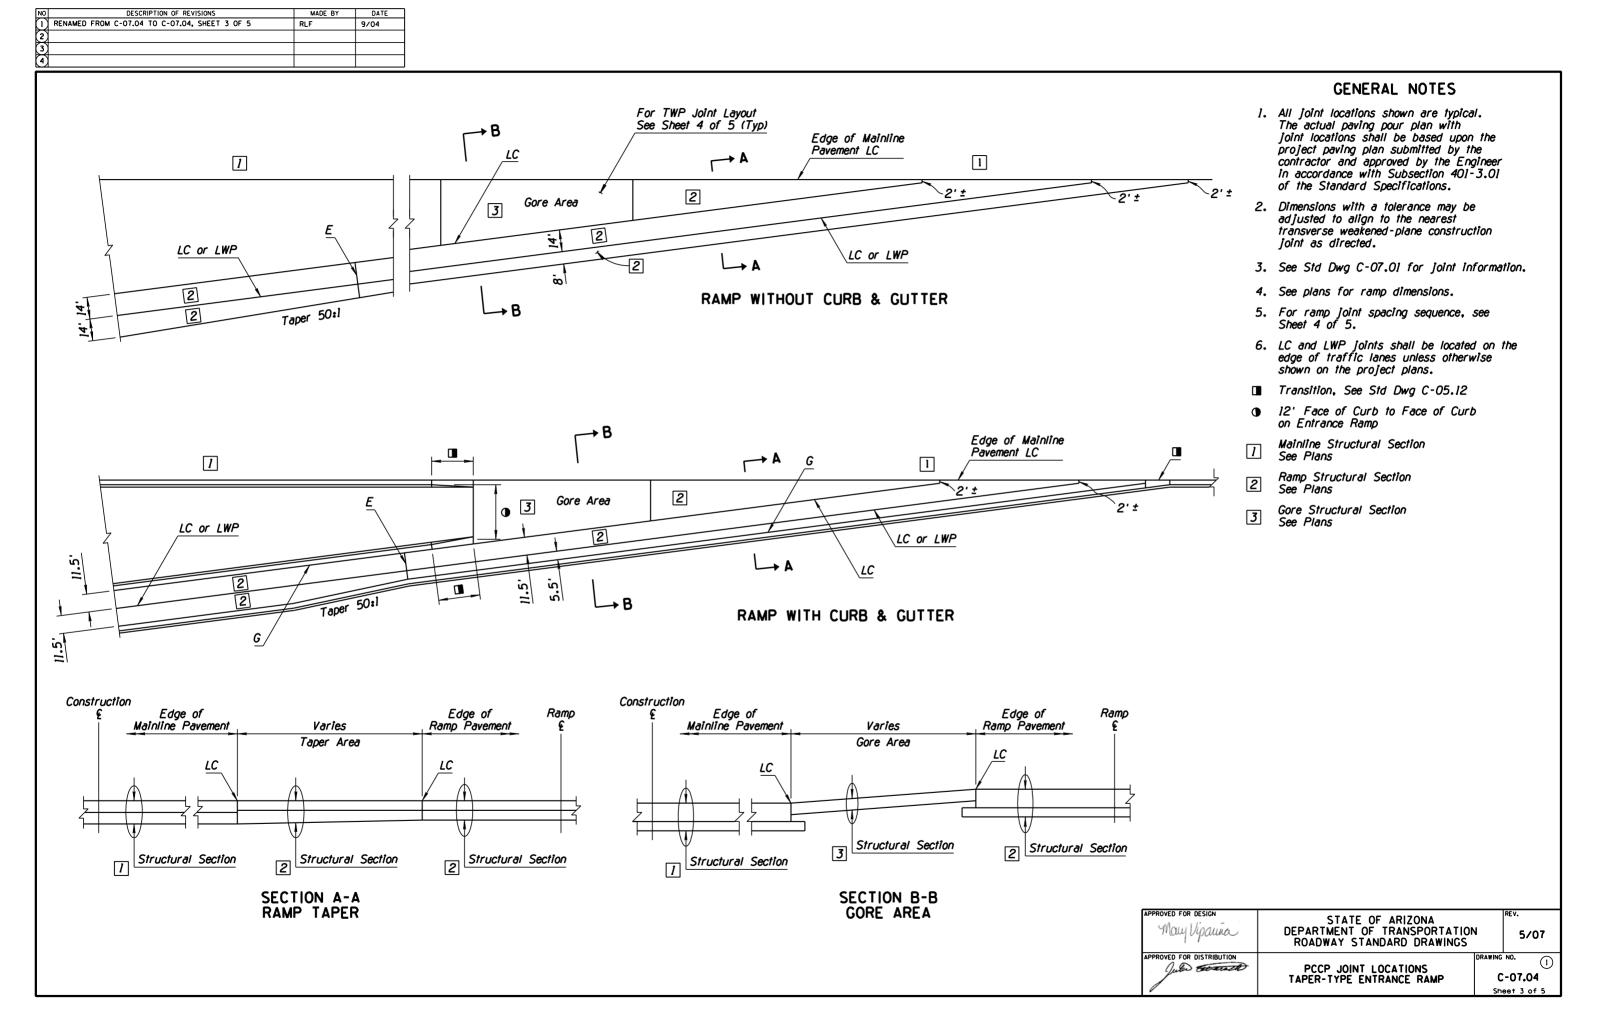




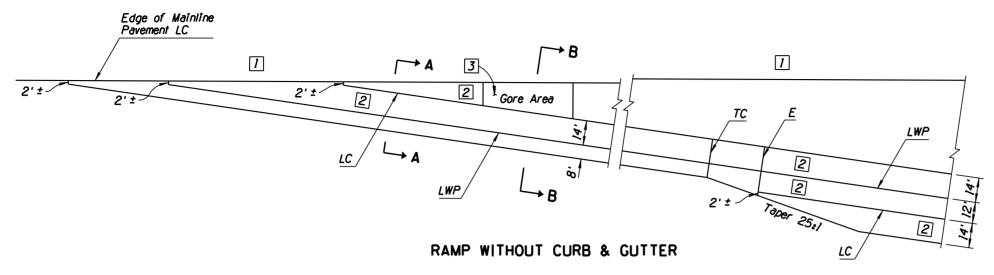

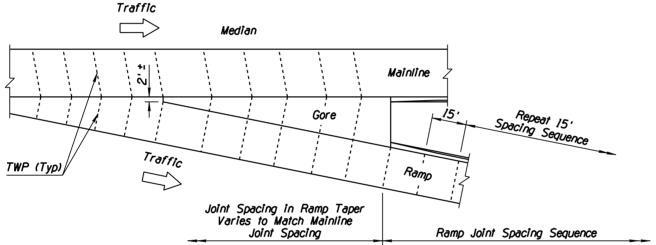

## TYPICAL TRANSVERSE WEAKENED-PLANE JOINT LAYOUT AT GORE AREAS

Exit Ramp Shown Entrance Ramp Similar

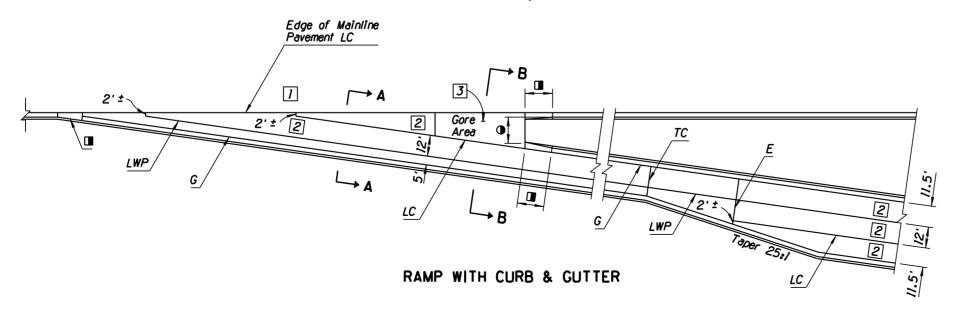

#### **GENERAL NOTES**

- 1. All joint locations shown are typical.
  The actual paving pour plan with
  joint locations shall be based upon the
  project paving plan submitted by the
  contractor and approved by the Engineer
  in accordance with Subsection 401-3.01
  of the Standard Specifications.
- Dimensions with a tolerance may be adjusted to align to the nearest transverse weakened-plane construction joint as directed.
- 3. See Std Dwg C-07.01 for joint information.
- 4. See plans for ramp dimensions.
- **■** Transition, See Std Dwg C-05.12
- 20' Face of Curb to Face of Curb on Exit Ramp
- Mainline Structural Section See Plans
- 2 Ramp Structural Section See Plans
- Gore Structural Section See Plans

APPROVED FOR DESIGN

STATE OF ARIZONA

DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION

PCCP JOINT LOCATIONS
TAPER-TYPE EXIT RAMP

C-07.04
Sheet 4 of 5


NO   DESCRIPTION OF REVISIONS   MADE BY   DATE	
14' 14' TWP (Typ)	GENERAL NOTES
TC or TWP  Joint Control Point  LWP  LWP	<ol> <li>All joint locations shown are typical.         The actual paving pour plan with joint locations shall be based upon the project paving plan submitted by the contractor and approved by the Engineer in accordance with Subsection 401-3.01 of the Standard Specifications.     </li> </ol>
G Type 4	2. See Std Dwg C-07.01 for joint information.
Joint Control  LC or LWP  See Note 5	<ol> <li>The ratio of transverse to longitudinal joint spacing shall be greater than <sup>2</sup>/<sub>3</sub> but not more than 1½.</li> </ol>
LWP (Typ)  Joint Control Point  G  S  Type 6	4. LC and LWP joints shall be located on the edge of traffic lanes unless otherwise shown on the project plans.
□ Type 4	5. See Plans for Crossroad Paving Type E or H Joint if PCC Paving S Joint if AC Paving
	6. Transverse joints shall be perpendicular (90°) to the longitudinal joints, except as shown at the ramp terminal.
TC or TWP	▲ 6' Minimum
	● Varies - 18' Maximum 11' Minimum
LC/	■ Varies - 12' when adjacent gutter widths are 2' or less - 15' when adjacent gutter widths are greater than 2'
LC or LWP (Typ)  AC Pavement	are greater than 2°
	☐ Transition, See Std Dwg C-05.12
	♦ Varies - 12' Typical or As Shown on Plans
	17' Mäximum
<u>□ Type 9</u>	
□ Type 2 LWP (Typ)	
TWP (Typ)   See Note 5	
Joint Control Point  LC or LWP	
TC or TWP	
LWP Joint Control Point	
Type 2	
$G = \mathcal{F}_{\mathcal{A}} $	
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	STATE OF ARIZONA  OUT VIPALIA  DEPARTMENT OF TRANSPORTATION  ROADWAY STANDARD DRAWINGS  ROADWAY STANDARD DRAWINGS
APPROVE	D FOR DISTRIBUTION (2) DRAWING NO.
	PCCP JOINT LOCATIONS CROSSROAD AND RAMP TERMINI C-07.04 Sheet 5 of 5

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REVISED NOTE PNB 10/95 2 DELETED TYPE E VIEW RLF 7/05 3 MODIFIED STANDARD SPECIFICATION REFERENCE RLF 7/05 4			
AC Pavement Match Existing Pavement by Type and Thickness  2" Mi	AC Pavement Match Existing Pavement by Type and Thickness  inimum  Trench Width	## Thoroughly and Paint With Grout    Class P Concrete	<ol> <li>I. Bedding per Section 501 of the Standard Specifications.</li> <li>2. Asphalt concrete shall be in accordance with the requirements of the Standard Specifications.</li> <li>3. 12" lip is required on the sides of trenches that are not parallel at the center line of the street.</li> <li>4. Type D requires 9" of AB at top of trench when there is an existing base.</li> <li>1. See Std Dwg C-13.15 for typical pipe installation.</li> </ol>
TYPE A	TYPE B	TYPE C	LEGEND
AC Pavement Match Existing Pavement by Type and Thickness  12"  12"  TYPE D	2 2	Surface Outside of Trench Lines Damaged During Construction Shall Be Restored to Original Thickness and Condition  6" Minimum  AB or Decomposed Granite Per Section 303 or 803 of the Standard Specifications	Compacted Backfill or Slurry Per Section 501 of the Standard Specifications  AB, Granular Backfill or Native Backfill Per Sections 303 and 501 of the Standard Specifications  AB Per Sections 303 and 501 of the Standard Specifications  3
		TYPE F	
Sawcut Line (Typ)  Varies  12" AB or Existing Subgrade Whichever Is Greater  12" Trench 12"	Sawcut Line (Typ)  Bituminous Pavement  Total Thickness to Match Existing	Same Surface as Existing Pavement Unless Otherwise Noted  2"  Utility Concrete	APPROVED FOR DESIGN STATE OF ARIZONA REV.
TYPE G		TYPE H	DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION TRENCH BACKFILL C-07.06

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	DELETED PLAN VIEW AND SECTION	RLF	9/04
2	REVISED & RENAMED SECTION	RLF	9/04
(3)	REMOVED TITLE	RLF	11/04
(A)	REVISED SECTION GRAPHICS	RLF	7/05





- 1. Paved gore area shall be Class S Concrete, f'c = 4000 PSI or AC as shown on plans.
- 2. See Std Dwgs C-07.01 and C-07.04 for joint layout and details.

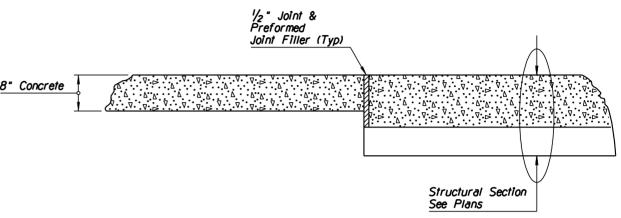


SECTION A-A

1

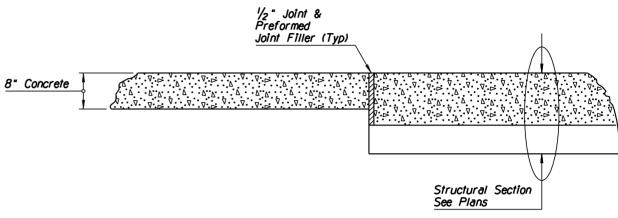

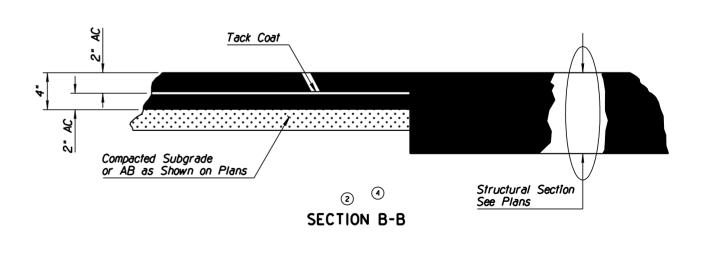



May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07	
APPROVED FOR DISTRIBUTION	PAVED GORE AREA	DRAWING	no. -08.20

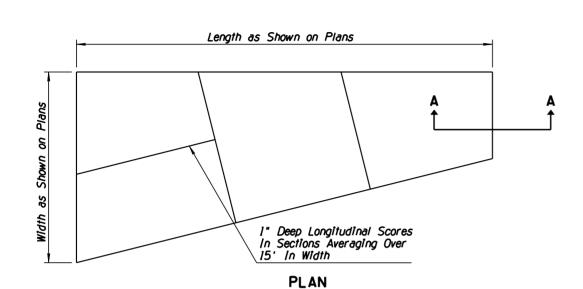


CONCRETE GORE AREA WITH ABUTTING CONCRETE PAVEMENT


1

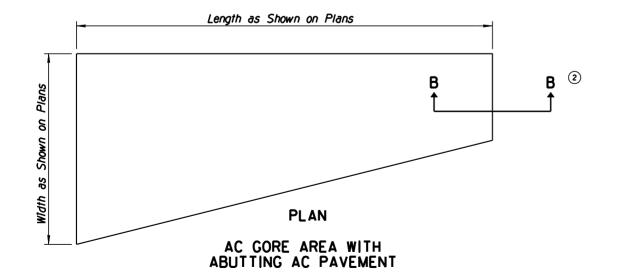

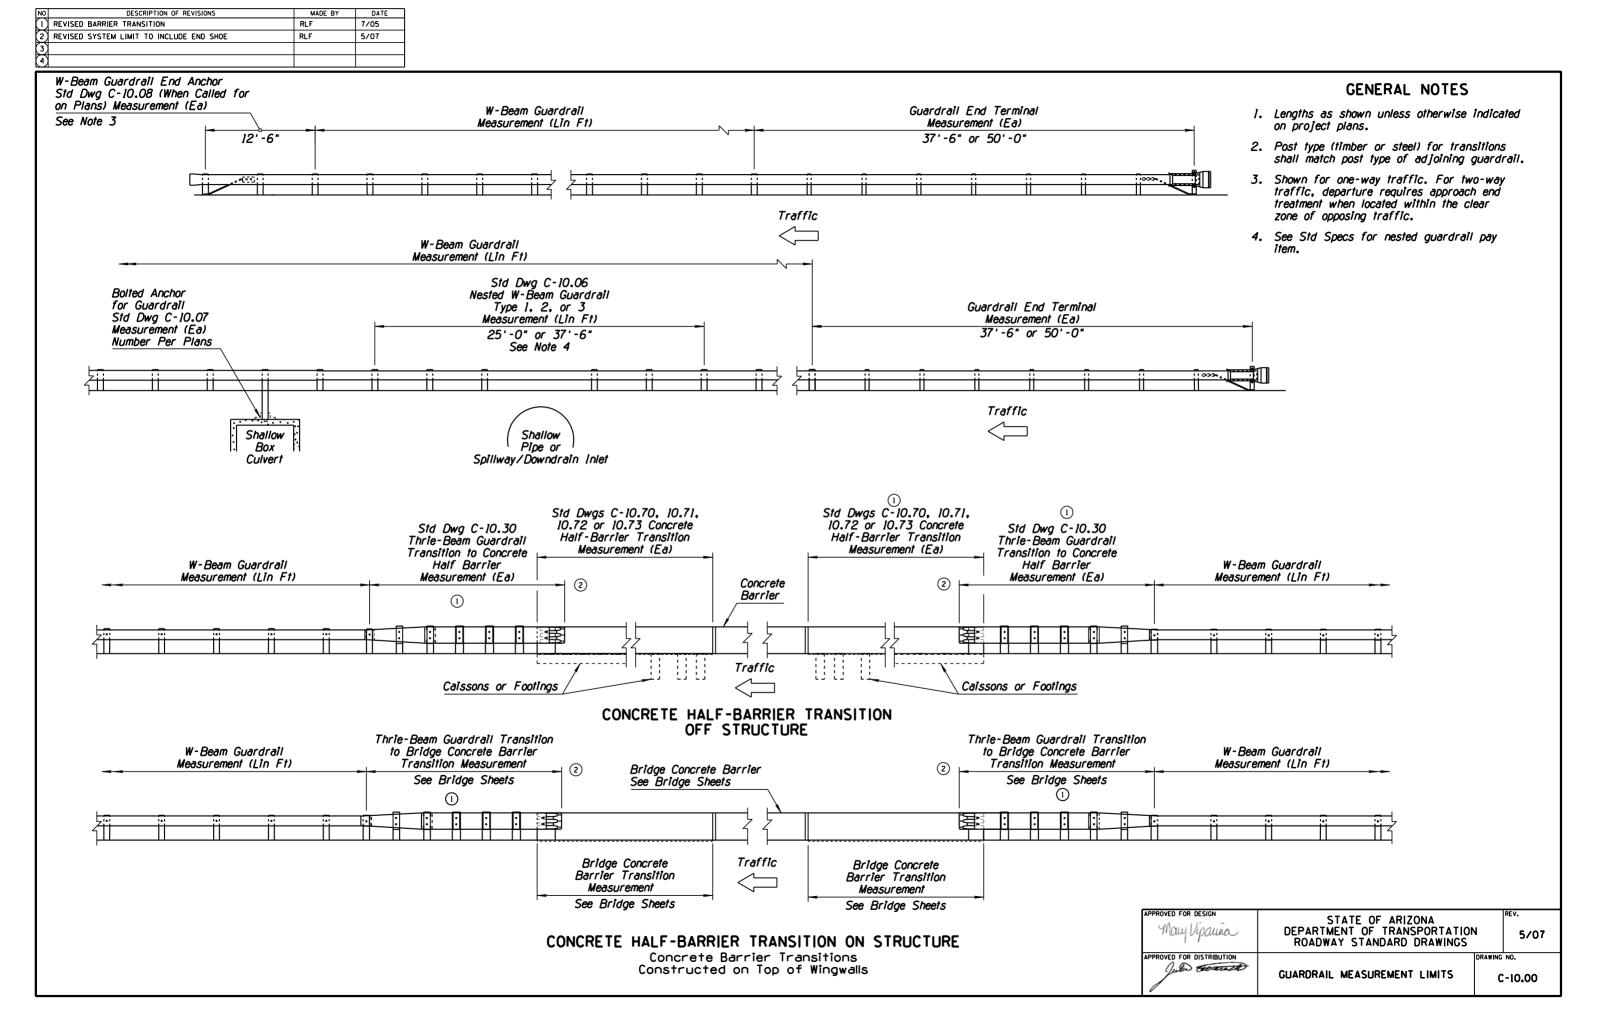


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED PLAN VIEW GRAPHICS/REMOVED WIDTH DIMENSION	RLF	9/04
2	REVISED GENERAL NOTES 3 & 4	RLF	9/04
3	MODIFIED STANDARD DRAWING TITLE	RLF	9/04
4	REVISED SECTION VIEW TITLE	RLF	7/05

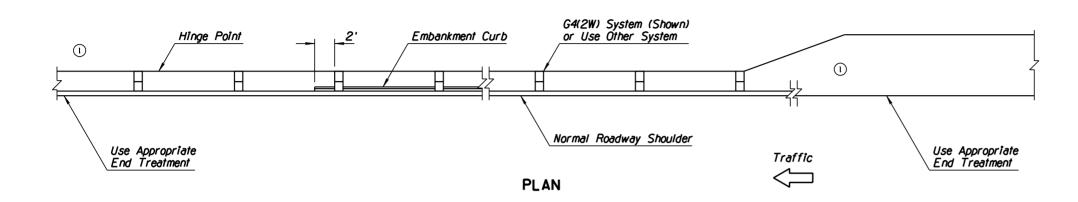

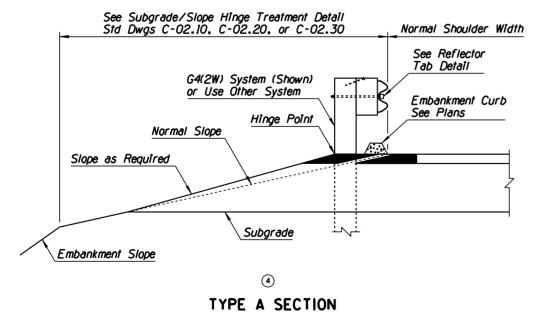


- All embankment curb shall be protected by guardrail.
- 2. Guardrail shall extend beyond the limits of embankment curb.
- 2 3. See Std Dwg C-10.00 for measurement limits.
- ② 4. See Std Specs 703, 905 and 1012-3 for reflector tab and snow marker materials, reflective sheeting, and spacing requirements.
  - ▲ Top of Rail = 28" See General Note I Std Dwg C-10.03




REFLECTOR TAB DETAIL

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	GUARDRAIL INSTALLATION TYPE A AND REFLECTOR TAB	DRAWING	no. -10.01


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED PLAN VIEW GRAPHICS/REMOVED WIDTH DIMENSION	RLF	9/04
2	REVISED GENERAL NOTES 3 & 4	RLF	9/04
(3)	REVISED STANDARD DRAWING TITLE	RLF	9/04
4	REVISED SECTION VIEW TITLE	RLF	7/05

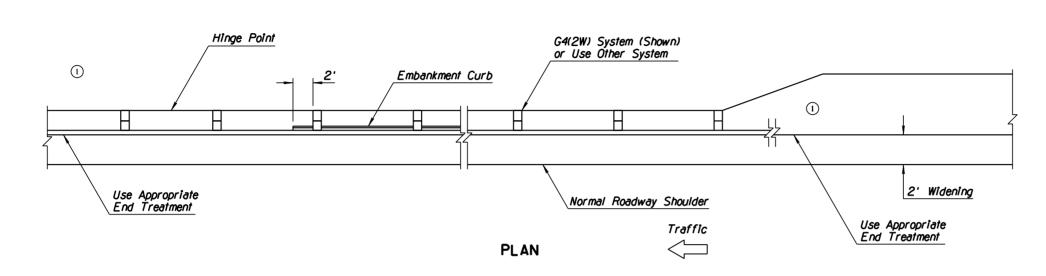

- All embankment curb shall be protected by quardrail.
- 2. Guardrail shall extend beyond the limits of embankment curb.
- 2 3. See Std Dwg C-10.00 for measurement limits.
- ② 4. See Std Specs 703, 905 and 1012-3 for reflector tab and snow marker materials, reflective sheeting, and spacing requirements.
  - ▲ Top of Rail = 28" See General Note I Std Dwg C-10.03



REFLECTOR TAB DETAIL

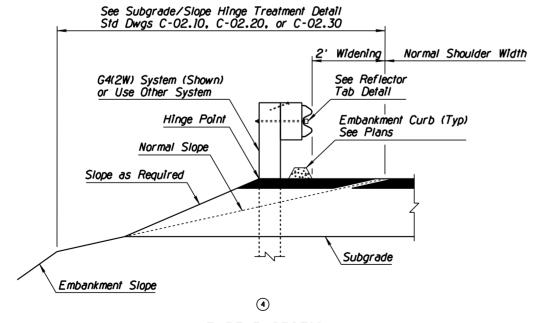


T١	•	D	0	CI	C (	СТІ	וחו	N١
	ı	Г	В	3	ᄓ	CTI	יטו	N


May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07
APPROVED FOR DISTRIBUTION	GUARDRAIL INSTALLATION 3 DRAWN TYPE B AND REFLECTOR TAB	C-10.02


NO DESCRIPTION OF REVISIONS MADE BY DATE  1) REVISED DESIGNATION RLF 9/04  2) REVISED GENERAL NOTE 1 & ADDED GENERAL NOTE 2 RLF 9/04  3) RENAMED STD DRAWING FROM C-10.20 AND REVISED TITLE RLF 9/04  4) REMOVED 29 INCH DIMENSION RLF 7/05		
G4( W) SYSTEM (8"x8")  I6d Galvanized Common Nail, 2 Per Block  Traffic  PLAN	the relevance of an arrange of a arrang	GENERAL NOTES  control height for guardrail em is 28" to the top of rail, sured at the face of rail from normal finished shoulder ntion.  drail shall be lapped in the direction djacent traffic.  Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation
6'-3"    A'/4"   A'/4"	6'-3"  4'/4"  4'/4"  6"  2"  2"  2"  38S)  ELEVATION  G4(2W) SYSTEM (6"×8")	
8" 8"  Note: The state of the	SECTION G4(2W)  8" 8" 8" 8" 8" 8" 8" 8" 8" 8" 8" 8" 8"	STATE OF ARIZONA RTMENT OF TRANSPORTATION DWAY STANDARD DRAWINGS  W-BEAM GUARDRAIL G4(1W) AND G4(2W) CKED-OUT TIMBER POST  G2 (3) C-10.03

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	REVISED DESIGNATION	RLF	9/04
2	REVISED GENERAL NOTES 1 & 2	RLF	9/04
3	RENAMED STD DRAWING FROM C-10.21 & REVISED TITLE	RLF	9/04
4	REMOVED 29 INCH DIMENSION	RLF	7/05

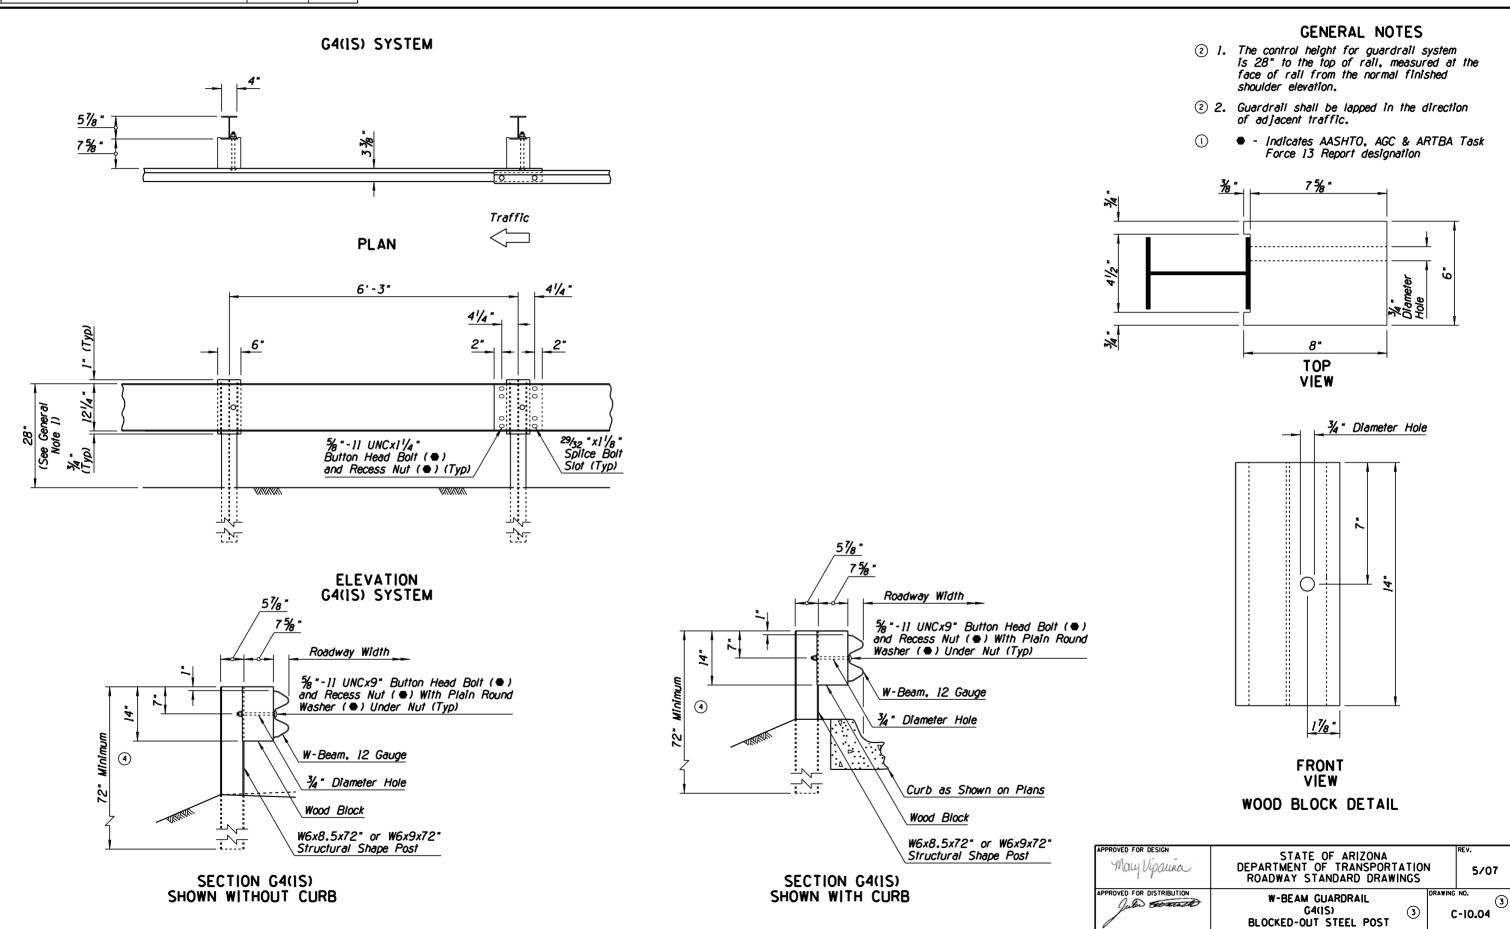

N0	DESCRIPTION OF REVISIONS	MADE BY	DATE
(1)	REVISED DESIGNATION	RLF	9/04
2	DELETED REFERENCE TO TYPE B-1 CURB & GUTTER	RLF	9/04
3	ADDED GENERAL NOTE 2	RLF	9/04
(4)	RENAMED STD DWG FROM C-10.22, SHEET I & MODIFIED TITLE	RLF	9/04

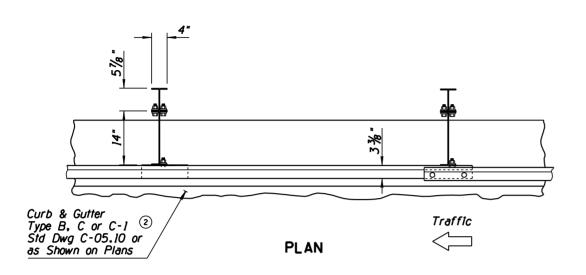

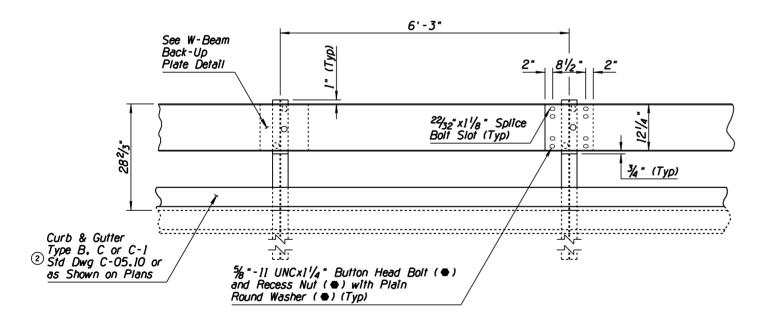


#### **ELEVATION**


#### G4(IS-MODIFIED)

#### GENERAL NOTES

- Height of curb shall not exceed 4 inches.
- 3 2. Guardrail shall be lapped in the direction of adjacent traffic.
- - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation




#### W-BEAM BACK-UP PLATE DETAIL

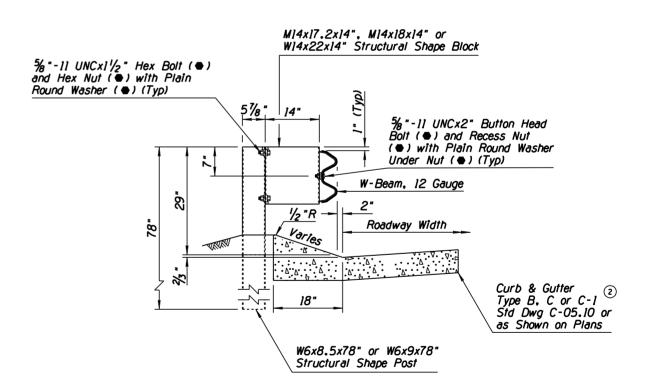

SECTION

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07
APPROVED FOR DISTRIBUTION	W-BEAM GUARDRAIL 4 G4(MODIFIED) WITH FREEWAY CURB AND GUTTER	C-10.05 Sheet 1 of 2


NO DESCRIPTION OF REVISIONS MADE BY DATE  1 DELETED REFERENCE TO TYPE B-1 CURB & GUTTER RLF 9/04  2 REVISED DESIGNATION RLF 9/04  3 RENAMED STD DWG FROM C-10.22, SHEET 2 & REVISED TITLE RLF 9/04  4				
G4(IW-MODIFIED)	Retainer Strap (Typ) 6-10d Galvanized Common Nails See Retainer Strap Detail	<del>6"  </del>	G4(2W-MODIFIED)	Retainer Strap (Typ) 6-10d Galvanized Common Nails See Retainer Strap Detail
		3%.		© PENERAL NOTES  ② □ Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation
	raffic	Curb & Gutter Type B, C or C-1 Std Dwg C-05.10 or as Shown on Plans	PLAN Traffic	41/ *
8" 2" 2"	4 <sup>1</sup> / <sub>4</sub> " 29/32"x1 <sup>1</sup> / <sub>8</sub> " Splice Bolt Slot (Typ)	(gyT) -1 6"	2"	29/32 "x1 1/8" Splice Bolt Slot (Typ)
%"-11 UNCx1'/4" Button Head Bolt (♠)  in the state of th	%%.	3/4"   %"-11 UI and Reces	NCx1¼" Button Head Bolt (♠) s Nut (♠) (Typ)	
Curb & Gutter ELEVATION Type B, C or C-1  ① Std Dwg C-05.10 or		Curb & Gutter Type B, C or C-1 ① Std Dwg C-05.10 or	·	\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\
Wood Block Wood Block Wood Block Wood Block	<u>Wood Blo</u> ¾" Dîameter Hole	as Shown on Plans	G4(2W-MODIFIED)	
%"-11 UNCx24" Button F and Recess Nut (♠) With Washer (♠) Under Nut (T W-Beam, 12 Gauge	Head Bolt ( • ) Plain Round Typ)	%"-11 UNC and Recess Washer (●) W-Beam, 12 Ga		2"x12"x20 Gauge Galvanized Steel Strap With Punched Holes
Roadway Width    Varies   Roadway Width   Curb	& Gutter B, C or C-1 Owg C-05.10 or hown on Plans	Varies Roadway Widt	Curb & Gutter Type B, C or C-1 Std Dwg C-05.10 or as Shown on Plans	RETAINER STRAP DETAIL
SECTION G4(1W-MODIFIED)		SECTION G4(2W-MODIF)	APPROV	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  ED FOR DISTRIBUTION W-BEAM GUARDRAIL G4(MODIFIED) WITH FREEWAY CURB AND GUTTER  STATE OF ARIZONA DPARTMENT OF TRANSPORTATION STATE

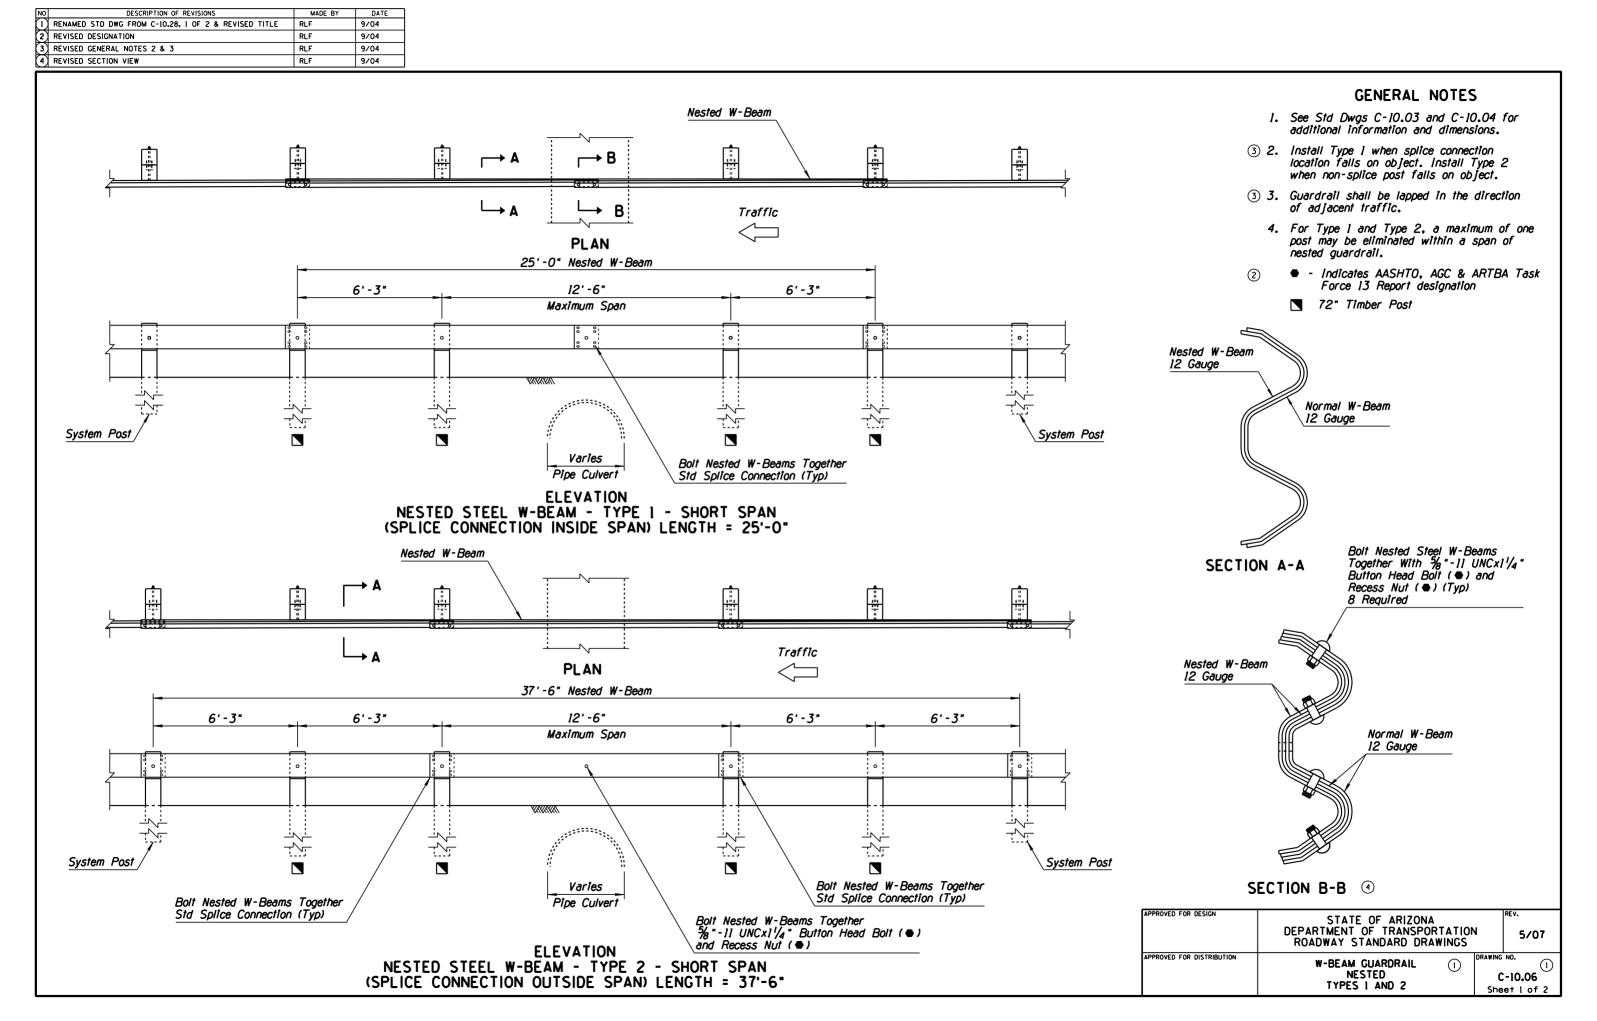


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	RENAMED STD DWG FROM C-10.28, 2 OF 2 & REVISED TITLE	RLF	9/04
2	ADDED GENERAL NOTE 3	RLF	9/04
3	ADDED DESIGNATION	RLF	9/04
$\mathbf{r}$			

- Use Type 3 Nested W-Beam to span downdrain or spillway inlets as shown in the plan view.
- Use Type 3 Nested W-Beam to span multiple obstructions as shown in the elevation view.
- 2) 3. Guardrail shall be lapped in the direction of adjacent traffic.
  - For Type 3, a maximum of two posts may be eliminated within a span of nested quardrail.
    - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation
    - 72" Timber Post

See Sheet 1 of 2 for Sections A-A and B-B

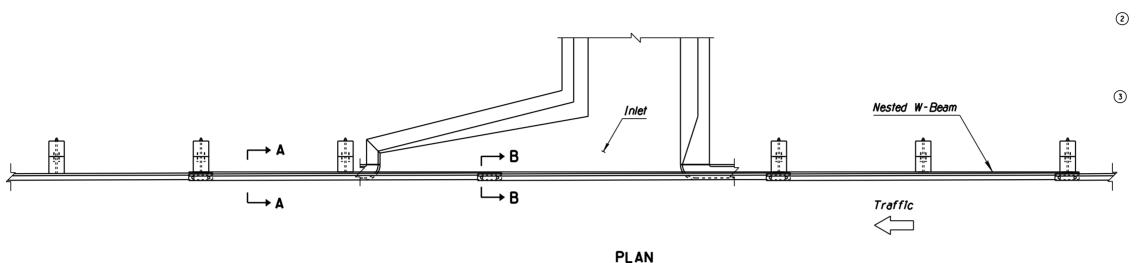

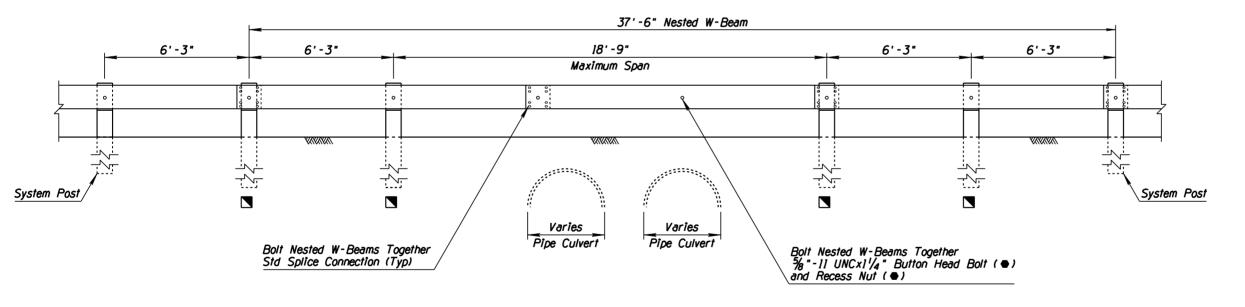


### ELEVATION

NESTED STEEL W-BEAM - TYPE 3 - LONG SPAN LENGTH = 37'-6"

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPO ROADWAY STANDARD DRA	5/07	
APPROVED FOR DISTRIBUTION	W-BEAM GUARDRAIL NESTED TYPE 3	1)	 NO. (1) C-10.06 et 2 of 2

DESCRIPTION OF REVISIONS	MADE BY	DATE							
RENAMED FROM C-10.29, 1 OF 2 & REVISED TITLE	RLF	9/04							
ADDED GENERAL NOTE 2	RLF	9/04							
REVISED GENERAL NOTE I	RLF	9/04							
									GENERAL NOTES
								3	<ol> <li>See Std Dwgs C-10.03 and C-10.04 for additional information and dimensions.</li> </ol>
								② 2	<ol> <li>Guardrail shall be lapped in the direction of adjacent traffic.</li> </ol>
									72" Timber Post
			1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1		# 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0	10 10 10 10 10 10 10 10 10 10 10 10 10 1	W-Beam	<u>-</u>
				<u>                                      </u>	PLAN	Traffic			

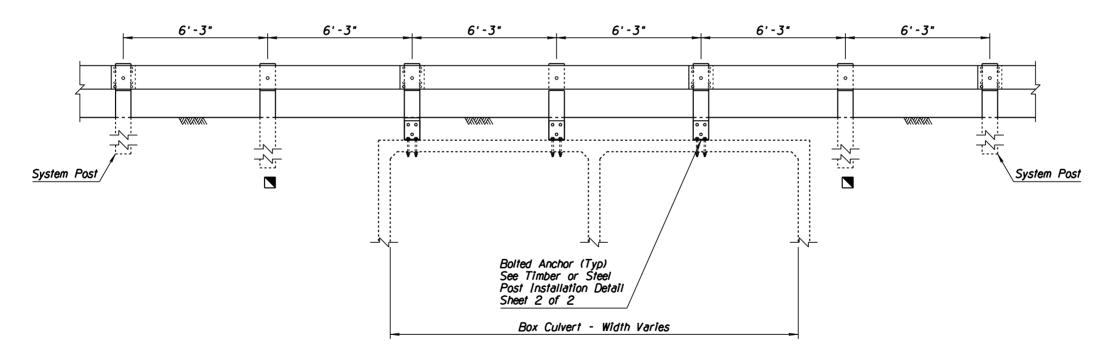


### **ELEVATION**

BOLTED ANCHOR
BOX CULVERT INSTALLATION

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORT ROADWAY STANDARD DRAW			5/07
APPROVED FOR DISTRIBUTION	W-BEAM GUARDRAIL BOLTED ANCHOR	() DF	_	NO. (1) -10.07 et 1 of 2

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	RENAMED STD DWG FROM C-10.29, 2 OF 2 & REVISED TITLE	RLF	9/04
(2)	REVISED DESIGNATION	RLF	9/04
(3)	REVISED LENGTH	RLF	7/05
4			

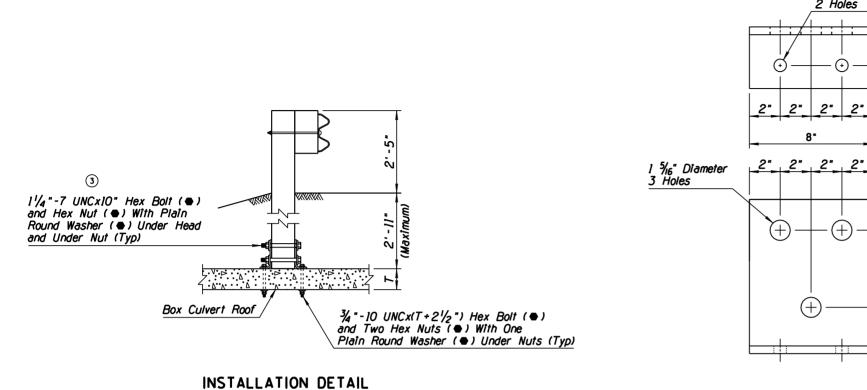



ູ້ນ

(Maximum)


ROVED FOR DESIGN

May Vipauna

PROVED FOR DISTRIBUTION

Jules Estate

<sup>13</sup>/<sub>16</sub>" Diameter 2 Holes

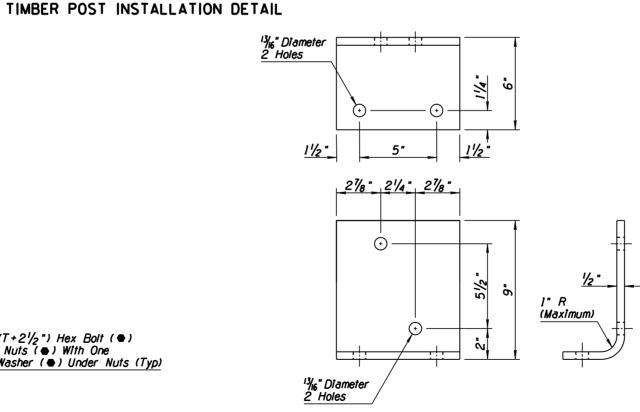


# Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation


**GENERAL NOTES** 

Bracket may be made of one piece hot bent, or two pieces welded together.

2. Short timber posts anchored to box culvert roof shall be 8" x 8" only.

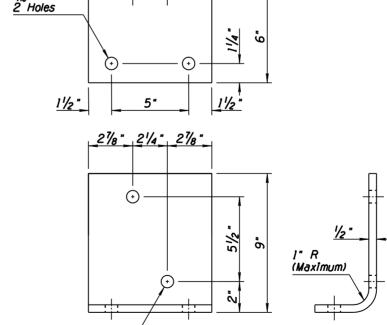

## BRACKET DETAIL

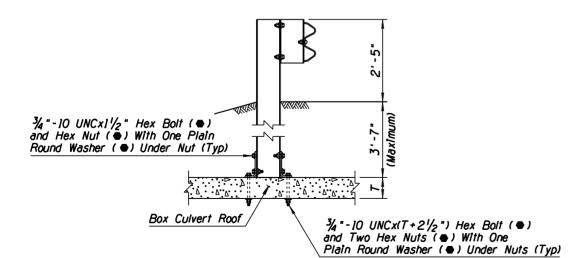


INSTALLATION DETAIL

BOLTED ANCHOR
STEEL POST INSTALLATION DETAIL


**BOLTED ANCHOR** 

STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS 5/07 (1) W-BEAM GUARDRAIL BOLTED ANCHOR C-10.07 Sheet 2 of 2

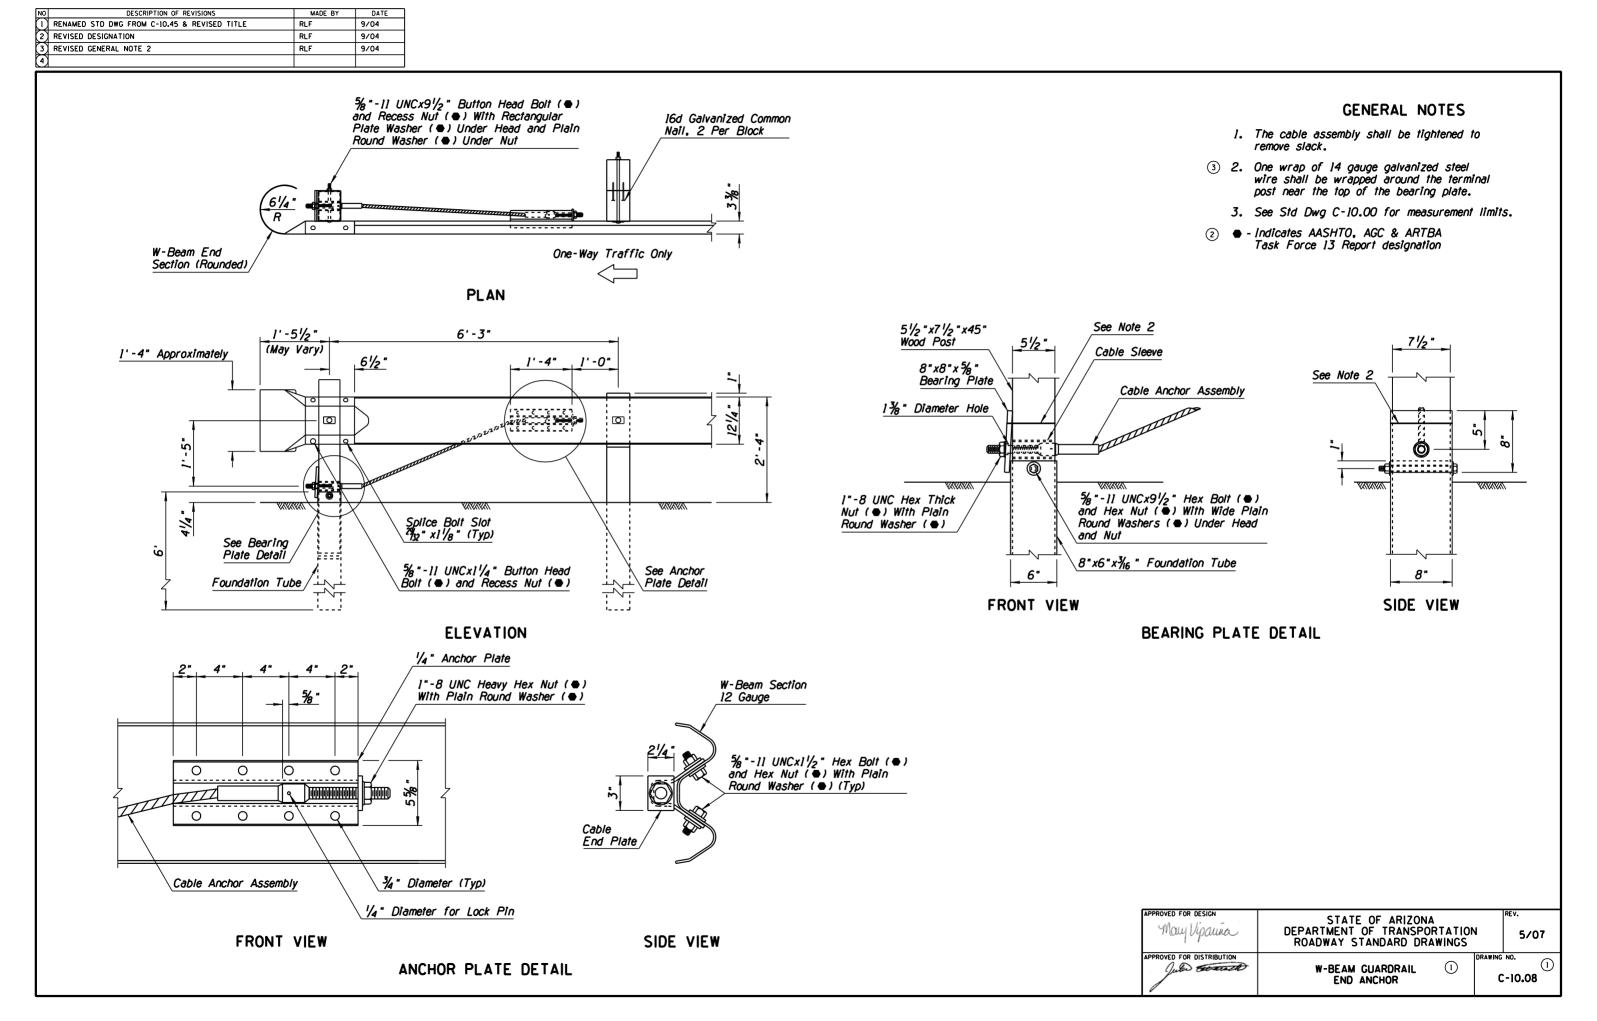


NO DESCRIPTION OF REVISIONS MADE BY DATE  1 RENAMED STD DWG FROM C-10.24 & REVISED TITLE RLF 9/04  2 REVISED DESIGNATION RLF 9/04  3 REVISED PLAN, ELEVATION & SECTION VIEWS RLF 9/04  4	
	GENERAL NOTES  ② • - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation
G9 SYSTEM  5%  Traffic  PLAN  3	TOP VIEW  TOP VIEW  FRONT SIDE VIEW  THRIE BEAM BACK-UP PLATE DETAIL  3  TOP VIEW  TIMBER BLOCK DETAIL  3
See Thrie Beam Back-Up Plate Detail  6'-3"  2"  8½"  2"  8½"  2"  Spilice Bott  Solic (Typ)	See Timber Block Detail  56"-   UNC Button Head Bolt (•) and Recess Nut (•) With Plain Round Washer (•) Under Nut (Typ) No Washer Under Bolt Head (Typ)  Thrie Beam 12 Gauge  W6x9 Structural Shape Post
ELEVATION G9 SYSTEM	(G9) SECTION A-A  APPROVED FOR DESIGN  May Vipaura  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION THRIE-BEAM GUARDRAIL  G9 BLOCKED-OUT STEEL POST  THE CONTROL OF TRANSPORTATION THRIE-BEAM GUARDRAIL  C-10.20

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REMOVED (A325) REQUIREMENT	RLF	12/04
2	REVISED BARRIER TRANSITION CALLOUT	RLF	7/05
3	REISSUED AS STANDARD DRAWING C-10.30, SHEET 1 OF 2	RLF	7/05
(4)	REVISED SYSTEM LIMIT TO INCLUDE END SHOE	RLF	5/07

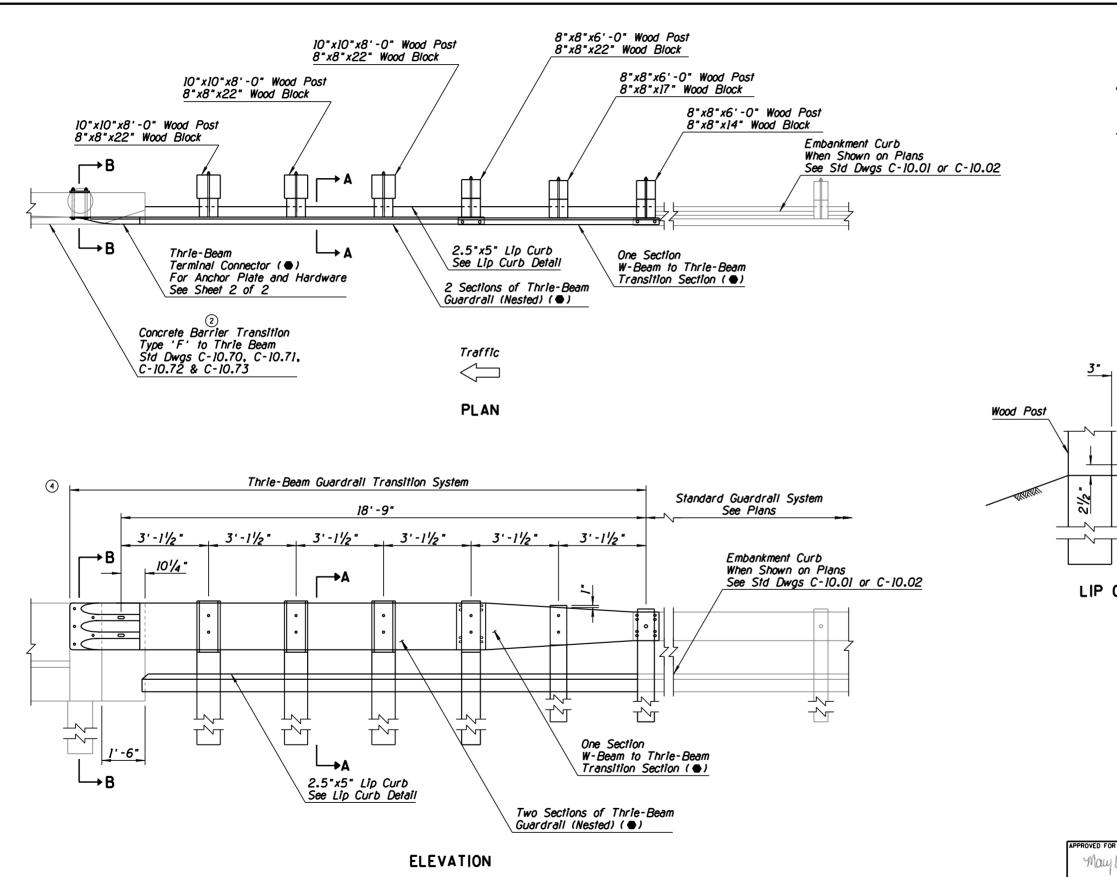

- 1. Curbing is not required when drainage flows transversely away from barrier.
- 2. Treatment at back of lip curb modified for constructability purposes. Front slope and height of lip curb shall not be exceeded.
- 3. Thrie-beam terminal connector to thrie-beam splice shall be lapped in the direction of adjacent traffic.
  - - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation

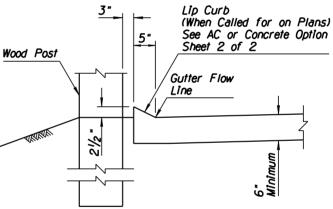


LIP CURB DETAIL


PROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS May Vipauna 5/07 PROVED FOR DISTRIBUTION GUARDRAIL TRANSITION, THRIE BEAM TO CONCRETE HALF BARRIER 32" TYPE 'F' (3) Jules Esterach C-10.30

Sheet 1 of 2

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	NEW STANDARD DRAWING	RLF	7/05
2			
(3)			
$\Box$			

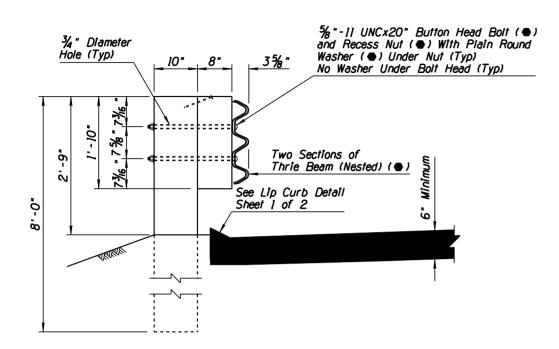




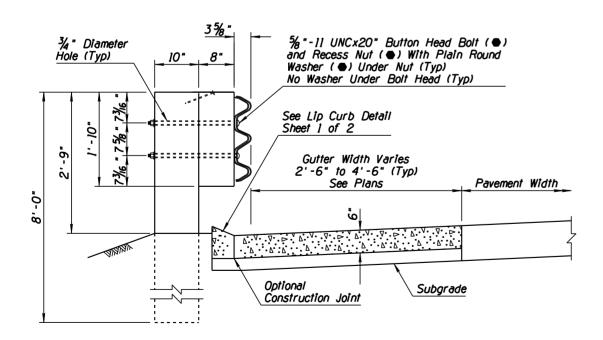

SECTION A-A CONCRETE OPTION

- 1. Anchor Plate shall conform to ASTM specification A36. Bolts, washers and Anchor Plate shall be galvanized or, at the contractors option, stainless steel bolts and washers may be used.
- Two-inch deep contraction joints shall be placed in the curb and the gutter at locations which match the joints in adjacent PCCP and at approximate 15' centers when adjacent to AC pavement. Joints shall be either hand-tooled or sawn.
  - - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation



1" Diameter Sleeve (Typ)

> No Washer Under Bolt Head (Typ)

Roadway Width

11%"

SECTION B-B

Anchor Plate See Detail A


2'-8"

7/8"-9 UNCx14" Hex Bolt (A325) (♠) and Hex Nut (A325) (♠) With Plain Round


Washer (♠) (Under Nut) (Typ)

5 Required

ANCHOR PLATE - DETAIL A



Sheet 2 of 2

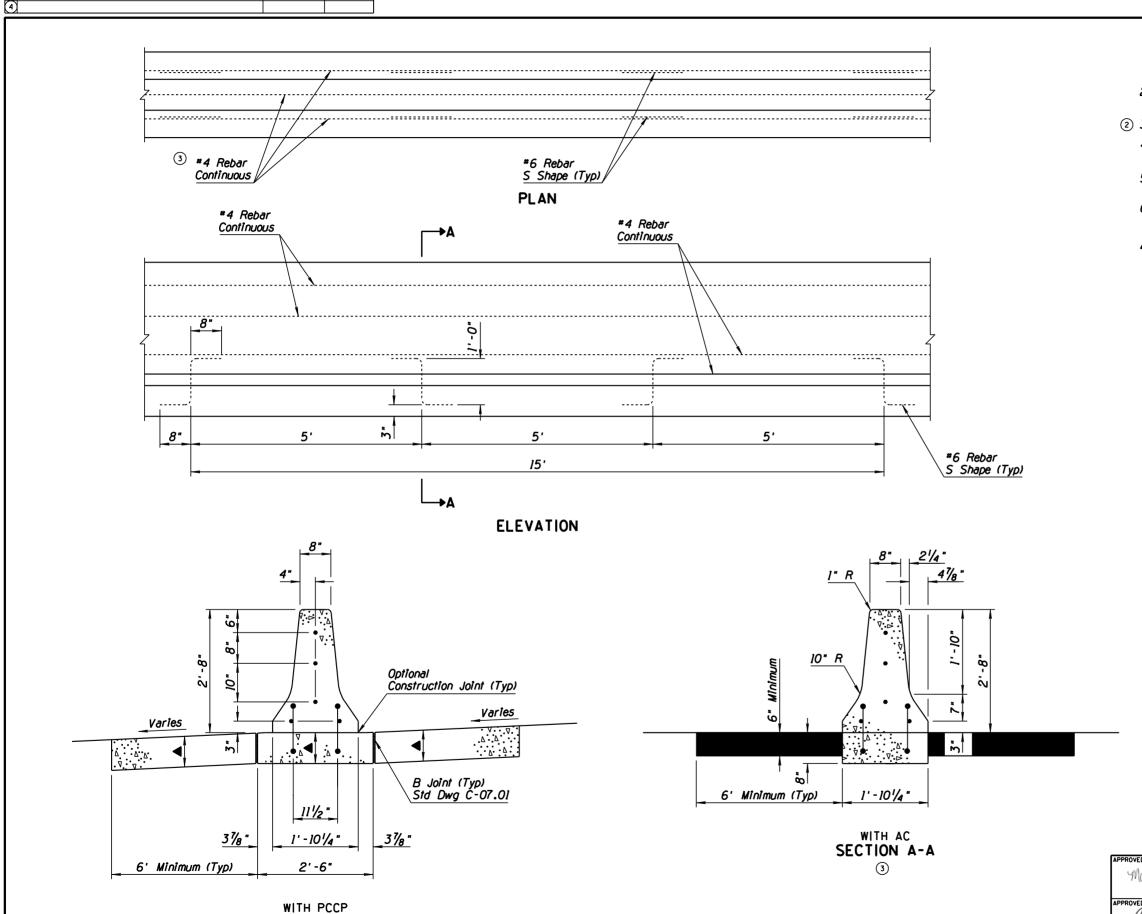

DESCRIPTION OF REVISIONS

1) RENAMED STD DWG C-10.66 & REVISED TITLE

2 REVISED GENERAL NOTE 3

3 RELOCATED # 4 REBARS

MADE BY

RLF

RLF

DATE

9/04


9/04


9/04

SECTION A-A 3

### **GENERAL NOTES**

- Median Barrier shall be constructed by the slip form or formed cast-in-place method.
- When obstacles prevent the use of slip form equipment, stationary forms shall be used.
- 2) 3. Concrete shall be Class S. f'c = 4000 PSI.
  - 4. If the footing and barrier are cast monolithically, \*6 S shape rebars are not required.
  - 5. Barrier width shall not exceed the barrier footing width nor overhang the adjacent pavement.
  - 6. # 4 Rebar shall extend 12" past the construction joint at the completion of the day's pour.
  - ▲ Depth to match adjacent PCCP thickness (8" minimum).



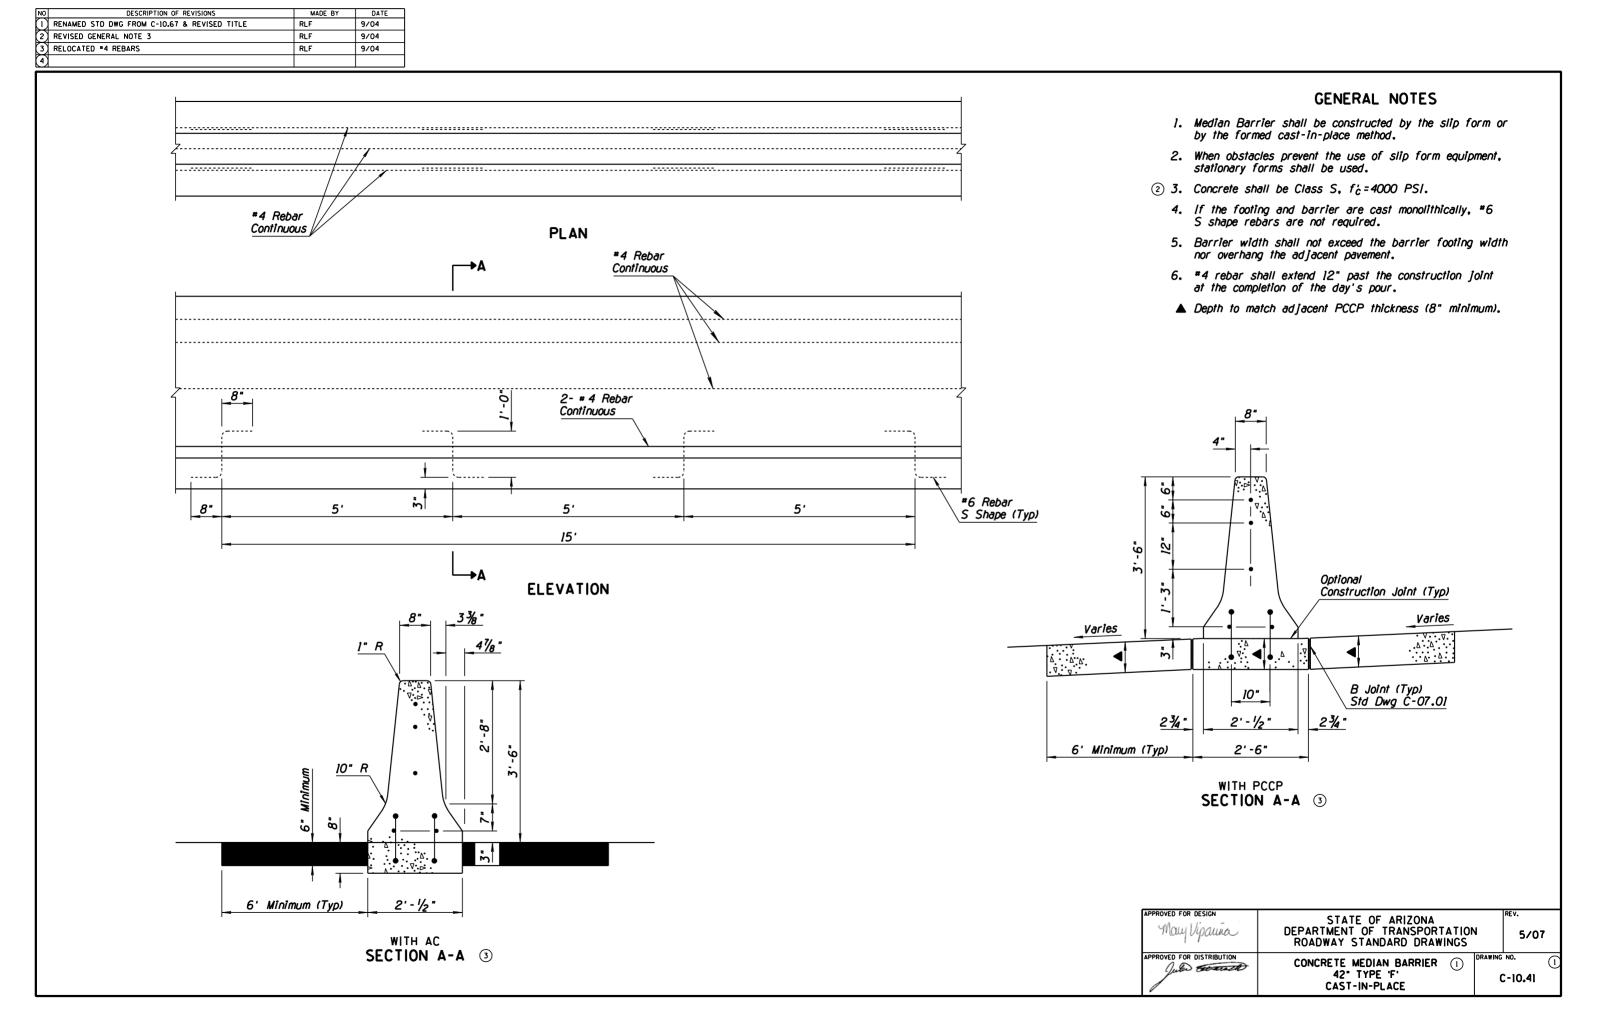


NO DESCRIPTION OF REVISIONS MADE  1 RENAMED STANDARD DRAWING FROM C-10.97, SHEET 1 OF 3 RLF  2 CORRECTED DRAWING REVISION DATE RLF  3  4	9/04 7/06		
			GENERAL NOTES
n———	n ————	n — — — — — — — — — — — — — — — — — — —	<ol> <li>Posts shall be 12'-6" center to center. Structural steel shall conform to ASTM A36, galvanized in accordance with ASTM A123.</li> </ol>
56	4"	<u>.</u>	<ol> <li>Hex head bolt shall conform to ASTM A307, galvanized in accordance with ASTM A153 Class C.</li> </ol>
4- N	4"-    N	4"-   N	<ol> <li>Helical spring lock washer shall conform to ASTM A313, galvanized in accordance with ASTM A153 Class C.</li> </ol>
			4. Tension wire: AWG number 9 (0.148") galvanized in accordance with ASTM Ali6 Class 2.
32.	32	32,	5. Hog ring: AWG number 12 (0.105") galvanized in accordance with ASTM A116 Class 2. Fasten glare screen to top and bottom tension wire spaced approximately 2' apart.
GLARE SCREEN INSTALLATION ON STANDARD MEDIAN BARRIER	GLARE SCREEN INSTALLATION ON MEDIAN BARRIER TRANSITION	GLARE SCREEN INSTALLATION ON HALF BARRIER AT BRIDGE PIER	6. Glare Screen: 18 gauge steel. ASTM A526, galvanized in accordance with ASTM A525/(G235), expanded to the following dimensions: 1.33" shortway of diamond and 4.0" longway of diamond (center to center of bridges) with a strand width of 0.250" angled at approximately 20° to the plane of the original sheet. Top edge to be shop curled and crimped on 12" center to center. Glare screen shall be installed such that flat portion of screen blocks light from headlights. See Direction Detail, Sheet 2 of 2.
	Bolt Glare Screen and	Tie Tension Wires and Glare Screen Through Top and Bottom	7. Splices allowed in glare screen at posts only, with one full diamond overlap.
12'-6" (Typ)	Top and Bottom Tension Wires at Every Fifth Post See Cross-Brace Post Detail Sheet 2 of 3  Top Tension Wire See Wire Routing Detail See Note 4	Holes at Each Intermediate Post With Type C Wire Tie Glare Screen See Intermediate Post Detail See Note 6 Sheet 2 of 3	8. Glare screen shall be constructed without interruption to the greatest degree possible.
Trypi			
	Bottom Tension Wire (Continuous) See Note 4	Median Barrier  ELEVATION	
	Cross-Brace Post Top Tension Wire		Cross-Brace Post
	<u> </u>	Bottom Tension Wire	
	TENSION	WIRE ROUTING DETAIL	APPROVED FOR DESIGN  May Vipaura  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  STATE OF ARIZONA  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS
			APPROVED FOR DISTRIBUTION  GLARE SCREEN  CONCRETE MEDIAN BARRIER  DRAWING NO.  1  C-10.42  Sheet 1 of 3


1 RENAMED FROM STANDARD DRAWING C-10.97, SHEET 2 OF 3 RLF 9/04 2 3 4		
See Typical Post Detail		<ul> <li>Indicates AASHTO, AGC &amp; ARTBA Task</li> <li>Force 13 Report designation</li> </ul>
See Intermediate Post Detail  See Top Top Tension Wire See Note 4 Sheet 3 of 3  Sheet 1 of 3	See Intermediate Post Detail  See Typical Post Detail  Wire Tie	
Type A Wire Tie  See Bottom  Type B Wire Tie	Type C Wire Tie Hog R	TYPE A WIRE TIE
Wire Tie  Hog Ring Fasteners 2' Center to Center (Typ) See Note 5 Sheet 1 of 3  CROSS-BRACE POST DETAIL	INTERMEDIATE POST DETAIL	ring Fasteners niter to Center (Typ) tote 5 1 of 3
	Traffic <	TYPE B WIRE TIE
%6 " Diameter Hole 2 Places  L 2"x2"x"/4"x28 % "	Traffic	
4"x6"x 3%"   1"   4" Steel Plate	TOP VIEW SECTION  34" Diameter Hole	
Steel Plate   6"		TYPE C WIRE TIE
TYPICAL POST DETAIL SECTION	N A-A DIRECTION DETAIL	APPROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION GLARE SCREEN CONCRETE MEDIAN BARRIER  REV. 5/07  C-10.42 Sheet 2 of 3


DESCRIPTION OF REVISIONS


MADE BY DATE


NO DESCRIPTION OF REVISIONS MADE BY DATE  1) RENAMED STANDARD DRAWING FROM C-10.97, SHEET 3 OF 3 RLF 9/04  2) 3 4	
Tension Wire  Tension Wire  Tension Wire  TOP BOLT DETAIL	Patron Wire    Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation   I/2* Plain Round Washer (●)
	TOP BOLT SECTION
Top Tension Wire See Note 4 Sheet 1 of 3  Tension Wire See Note 4 Sheet 1 of 3  Type A Wire Tile (Typ)	See Cross-Brace Post Detail Sheet 2 of 3  Top Tension Wire See Note 4 Sheet 1 of 3  See Cross-Brace Post Detail Sheet 2 of 3  Type B Wire Tie  Type B Wire Tie  Top Tension Wire See Note 4 Sheet 1 of 3  Type A Wire Tie  Tension Wire See Note 4 Sheet 1 of 3  Top Tension Wire See Note 4 Sheet 1 of 3
TERMINATION DETAIL	OBSTRUCTION DETAIL
	APPROVED FOR DESIGN  STATE OF ARIZONA  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION  GLARE SCREEN CONCRETE MEDIAN BARRIER  REV.  5/07  C-10.42 Sheet 3 of 3

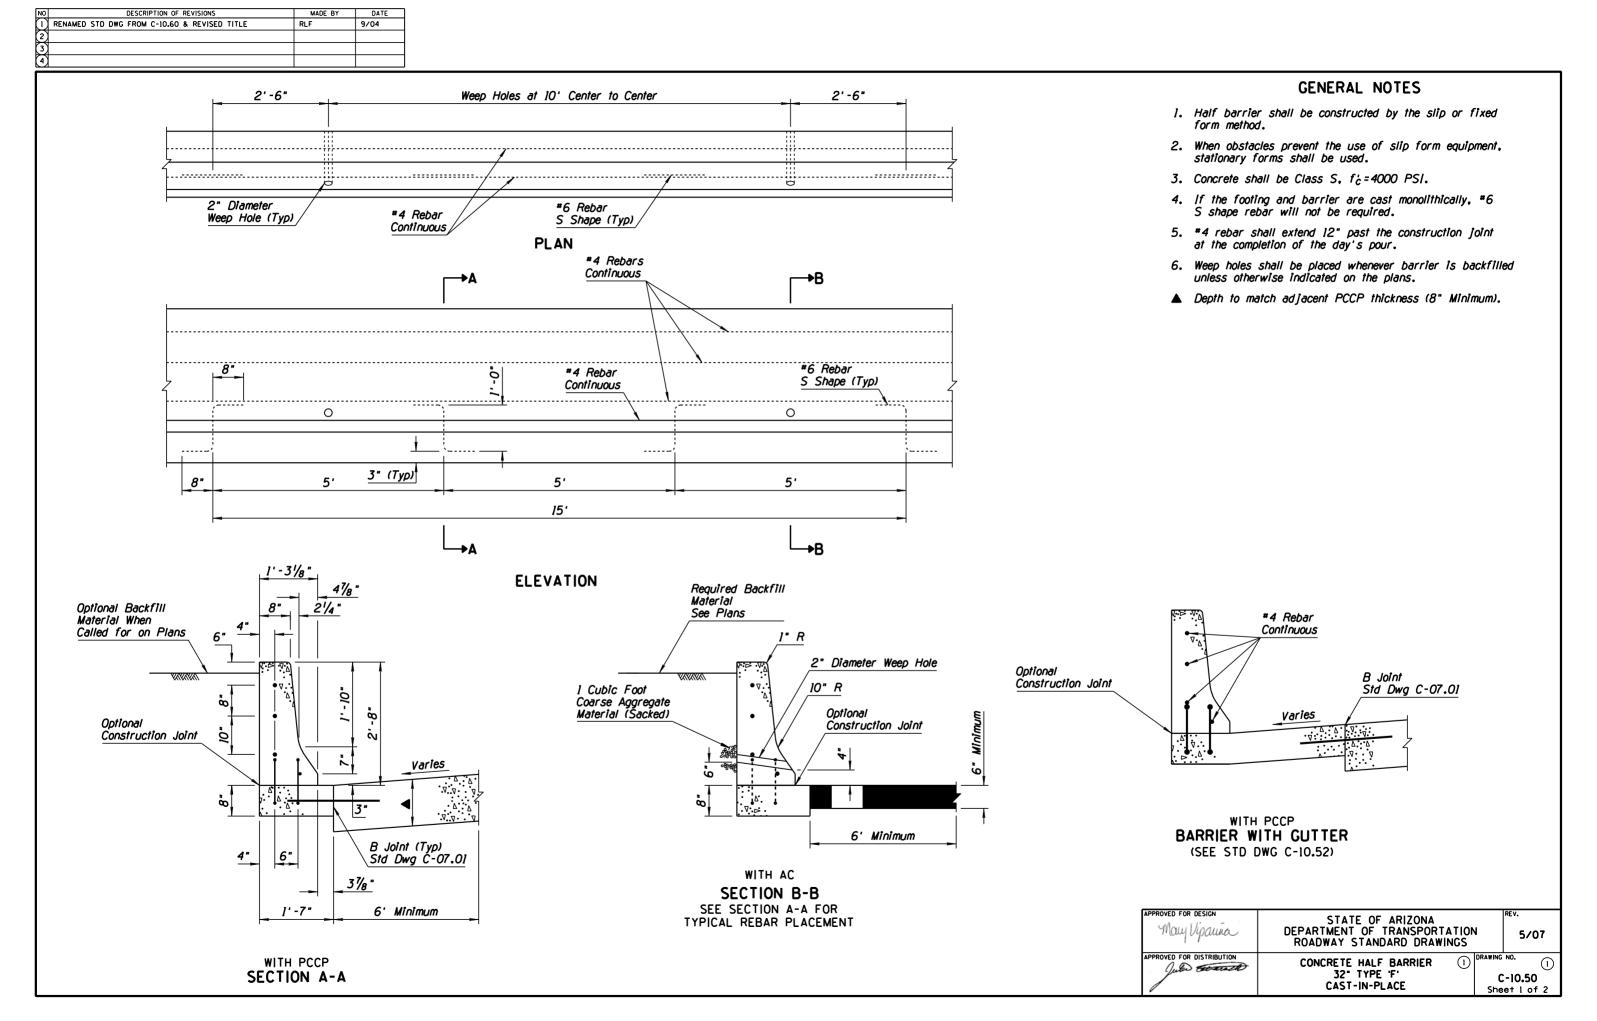

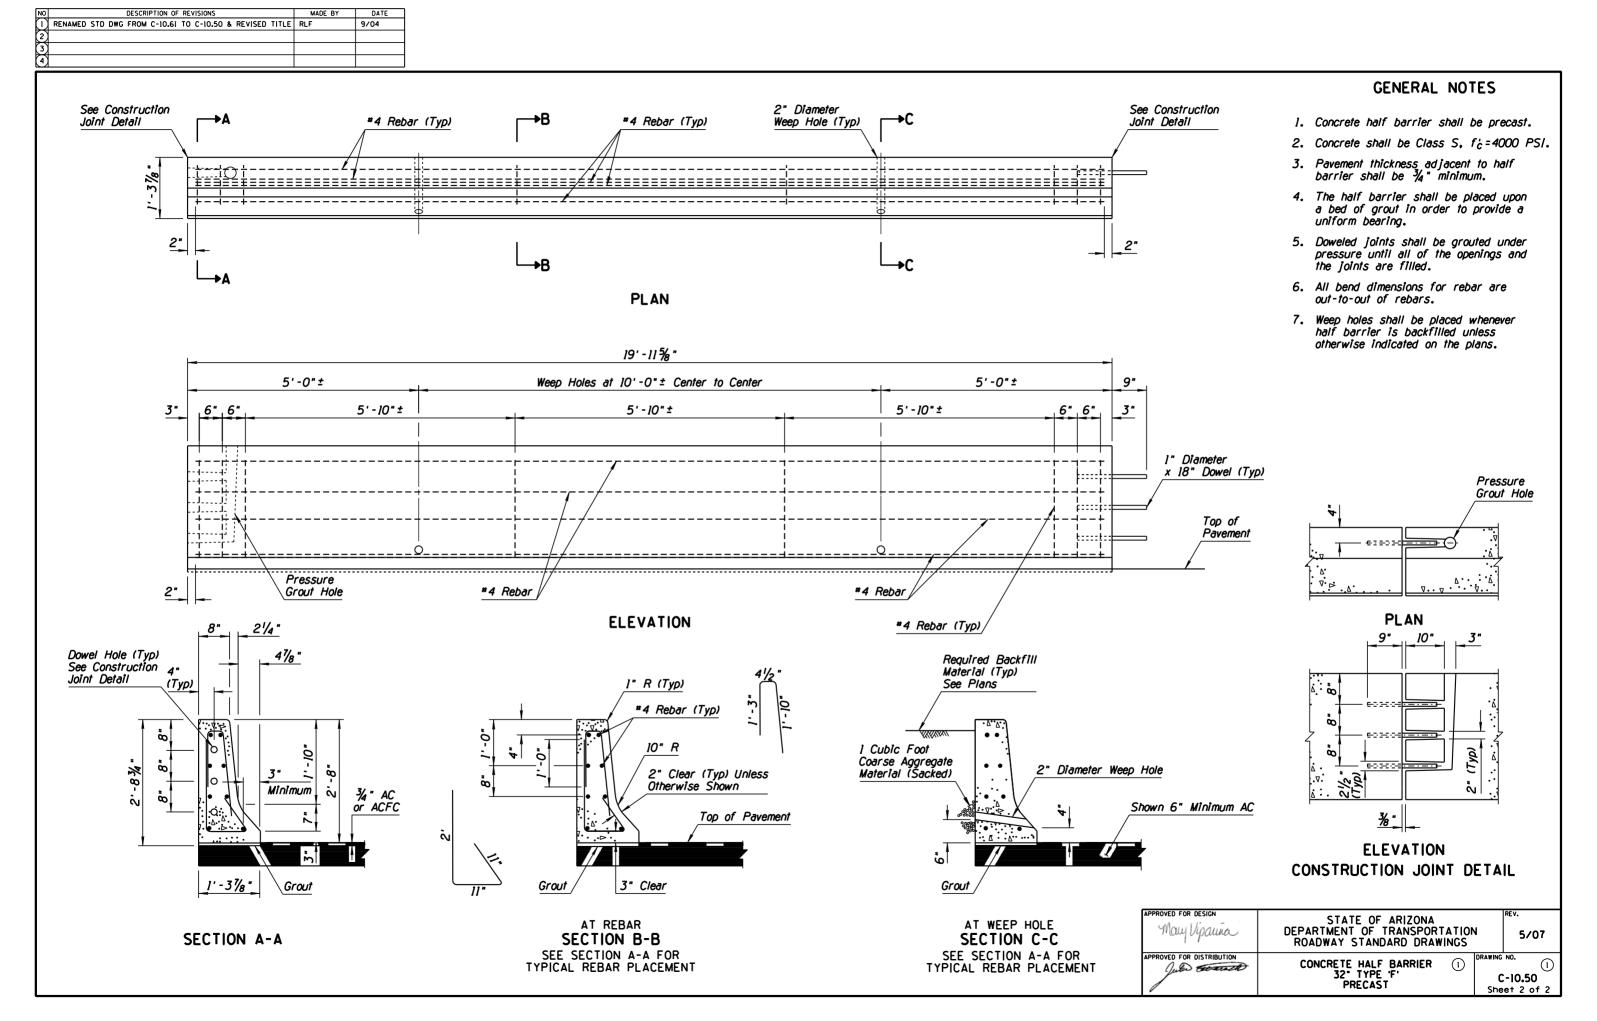


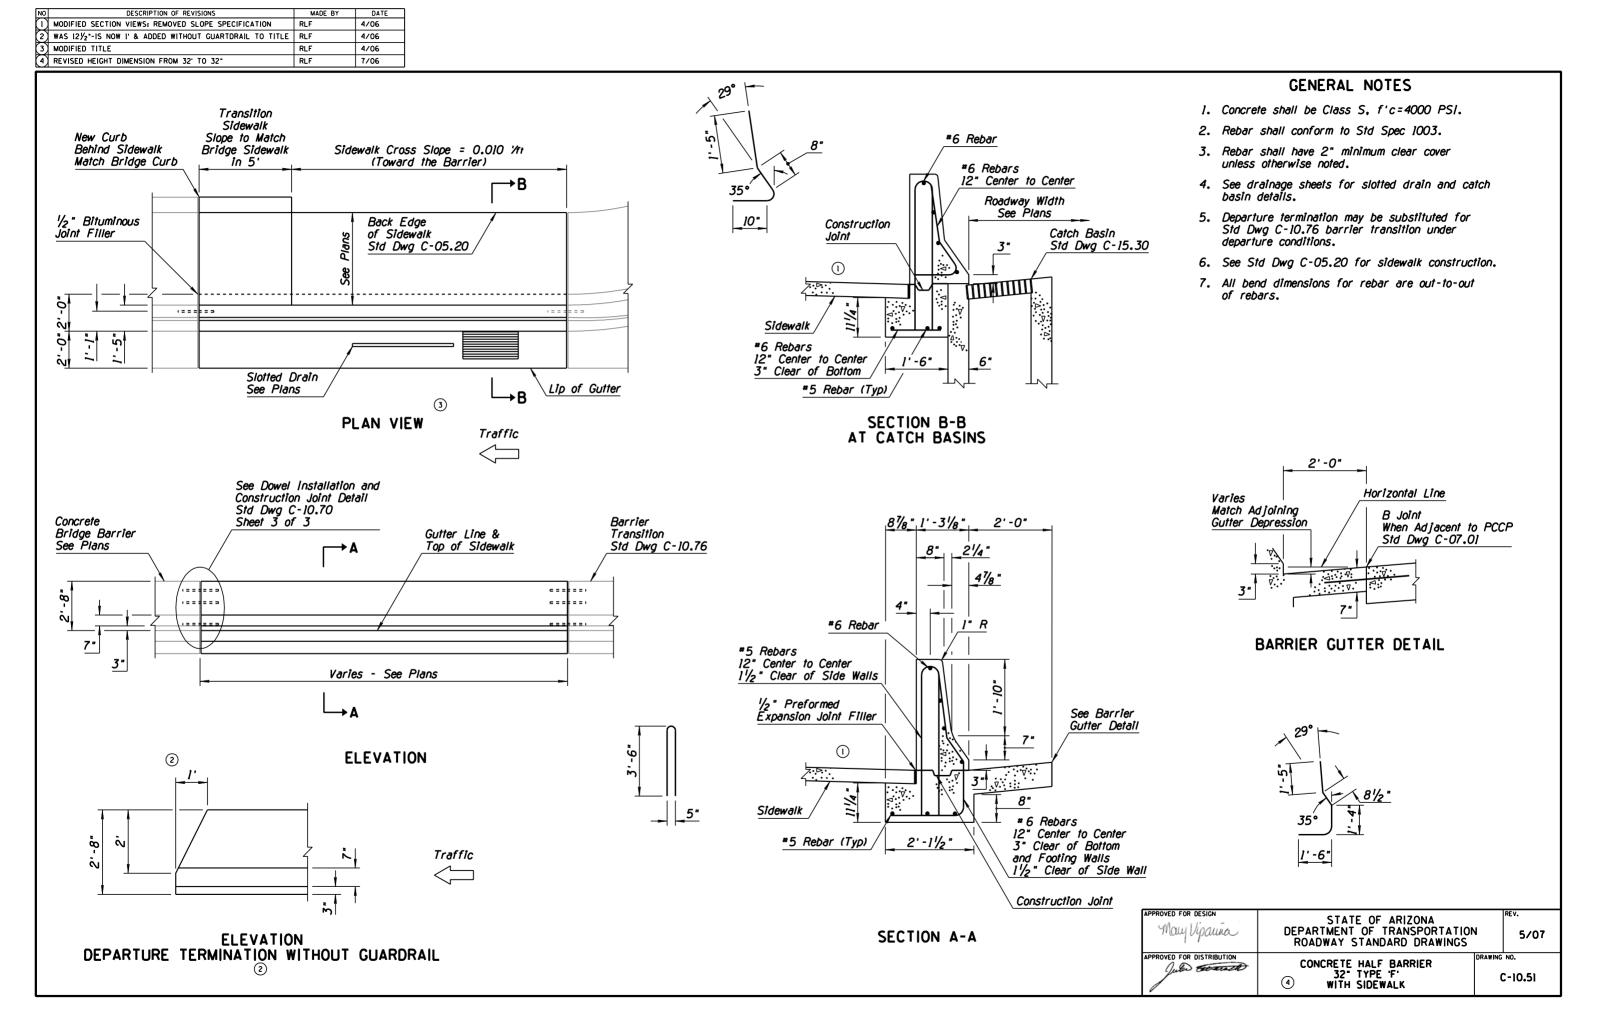

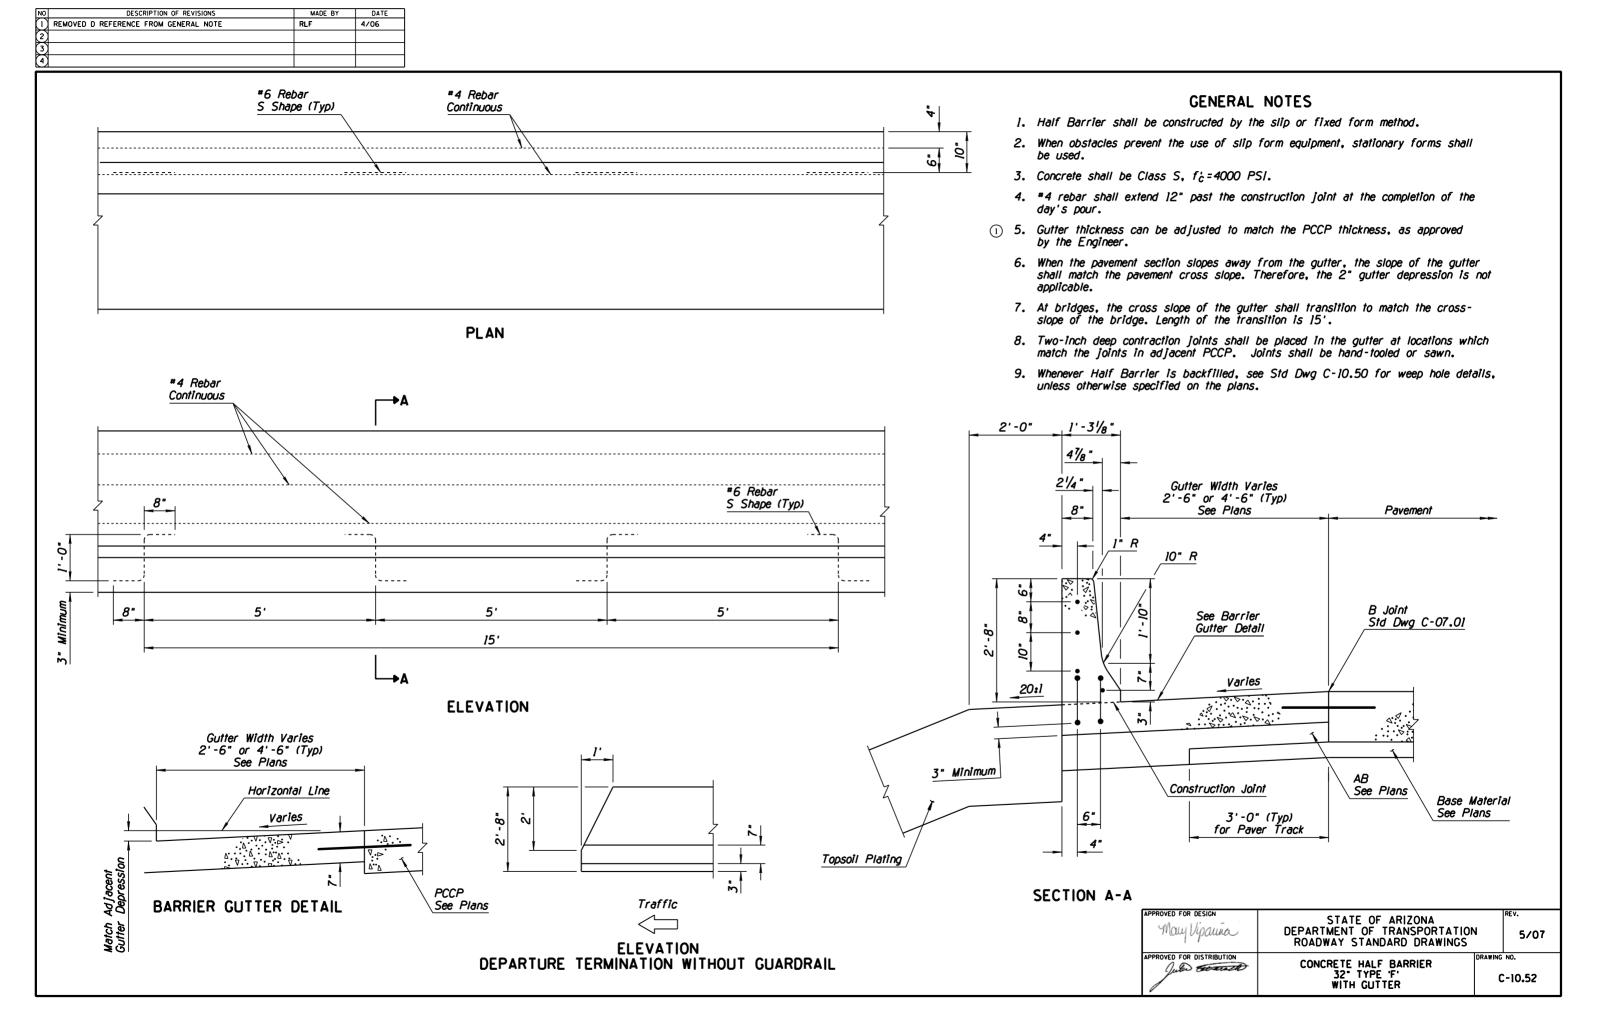


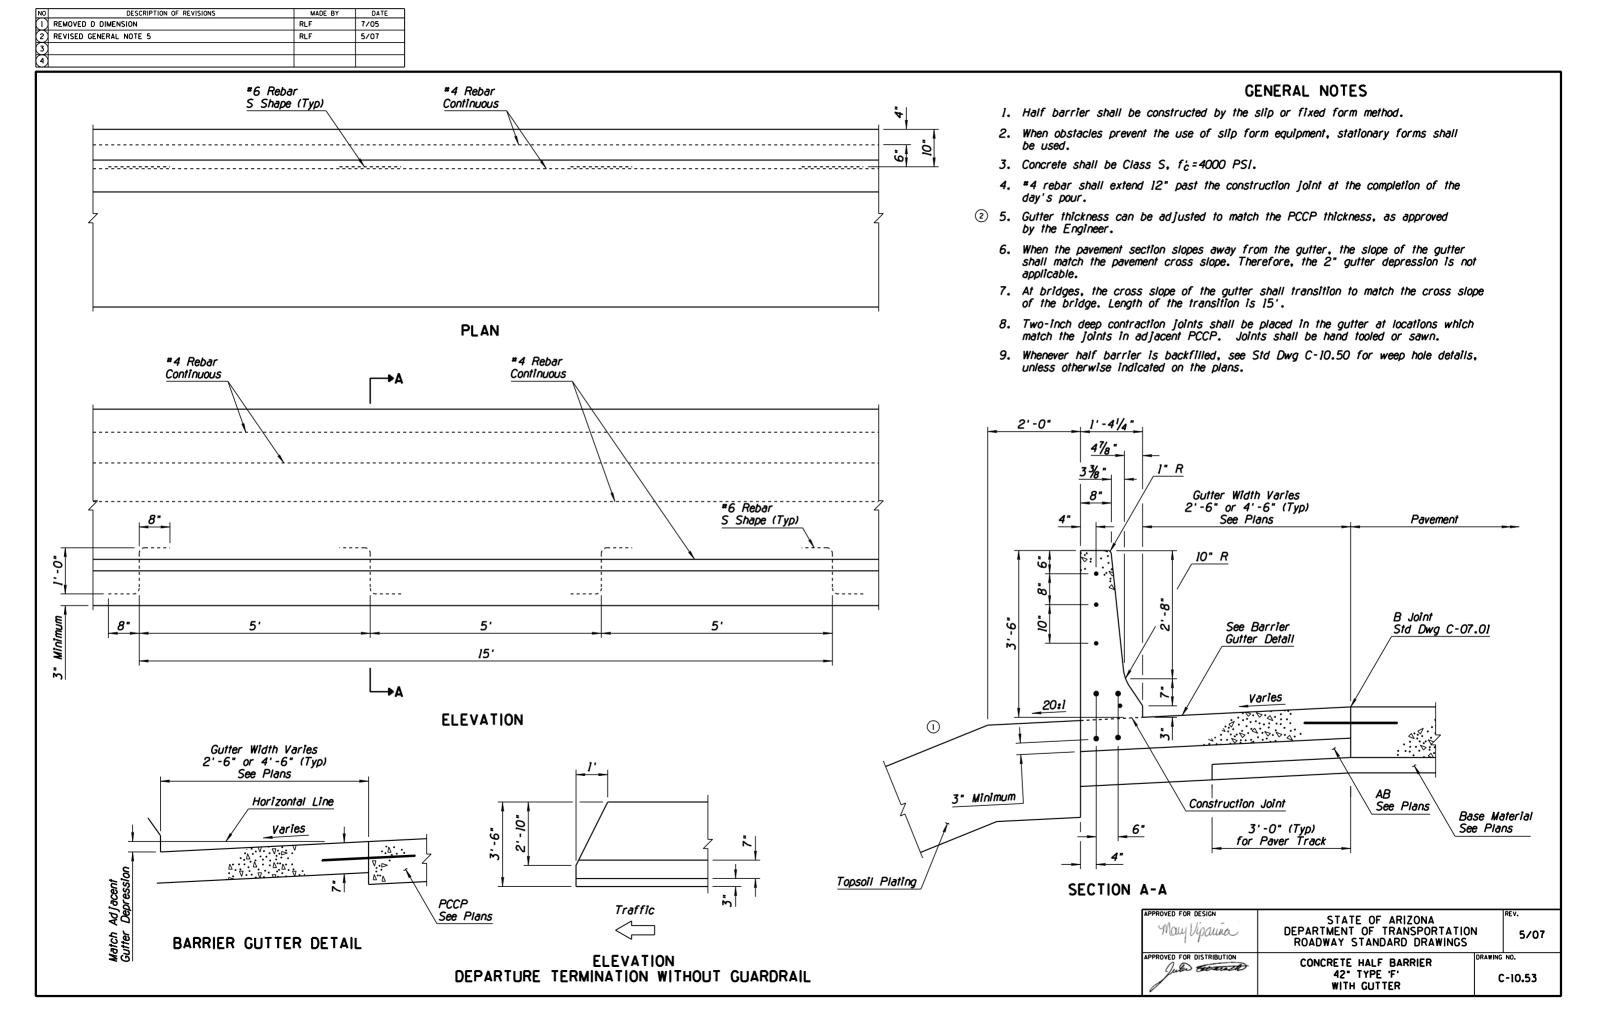


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	REVISED SECTION A-A: ADDED CONCRETE CAP & NOTES	RLF	11/06
2	REVISED GENERAL NOTE 3	RLF	11/06
(3)	ADDED (Typ)	RLF	11/06
(4)	REMOVED DOWEL FROM JOINT	RLF	5/07

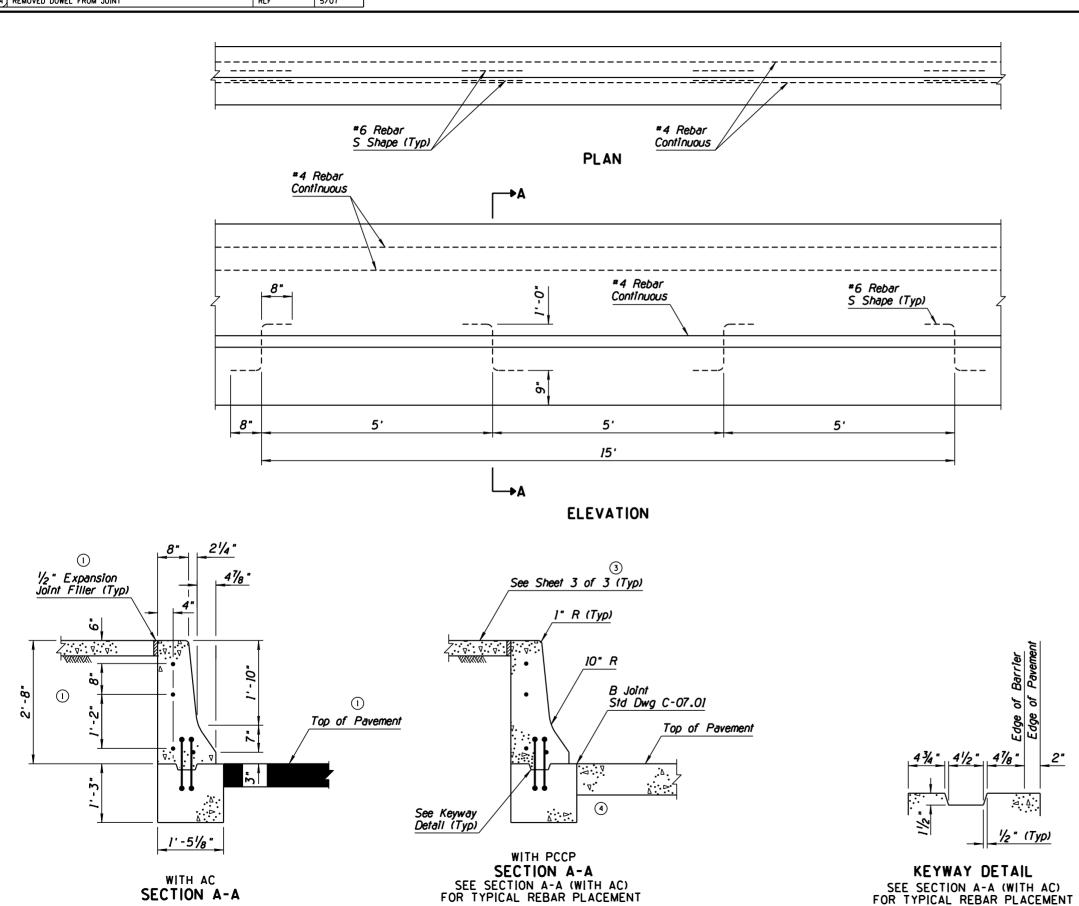


- 1. Concrete shall be Class S, fc=4000 PSI.
- If the footing and Half Barrier are cast monolithically,
   \*6 S shape rebars are not required.
- ② 3. Longitudinal rebar shall extend 12" past the construction joint at the completion of each incremental pour.



NO DESCRIPTION OF RI  REVISED SECTION A-A: ADDED CONC  REVISED CALLOUT: ADDED 'TYP'		RLF 11/	DATE ('06						
3 ADDED B JOINT NOTE 4		RLF 5/	07						
									GENERAL NOTES
See Construction Joint Detail	<b>┌</b> →A		4 Rebar (Typ)	⊢→B		*4 Rebar (7	'yp)	See Construction Joint Detail	1. Concrete shall be Class S, fc=4000 PSI.
	╌╆╍╍┡╱╕┢╺╸╸╸	A_		 		A			<ol> <li>The Half Barrier shall be placed upon a bed of grout in order to provide a uniform bearing.</li> </ol>
13%	- <u>#==</u> #=================================	=======		=======================================		=======================================			<ol> <li>Doweled joints shall be grouted under pressure until all of the openings and the joints are filled.</li> </ol>
2"_	-			1			_	2"	4. All bend dimensions for rebar are out-to-out of rebars.
	L→A			<b>∟</b> •В	PLAN				
					19' - 11 <b>%</b> "		-1	9"	
3"_	6: 6:	5.	-10" ±	-	5' -10" ±	5'-1	0"± 6" 6"	]" Diameter x 18" Dowel (Typ)	
				 ! !			·		
	<del>  -</del>  -						//	Top of Pavement	Pressure
	+						-/		Grout Hole
							/	<u> </u>	
		\ Pressure		# 2	1 Rebar	#4 Rebar			$\begin{array}{ c c c c c c c c c c c c c c c c c c c$
		Grout Hole		_	ELEVATION				
	41/8"	Dowel Hole (	Τγρ)		ELEVATION				PLAN  9" 10" 3"
① //a " Expansion	8" 21/4"	Dowel Hole ( See Construc Joint Detail	etion ——		(2)				
1/2" Expansion Joint Filler (Typ)	4"				See Sheet 3 of 3 (T)	4½"			۵ ۵ ۱
①				4"	1" R (Typ)	P	#4 Rebar		, id
\$\frac{1}{80} \frac{1}{10}		1 1		, T	— <b>*4</b> Rebar (7	<u> </u>			
20					10" R				
		58	①	å	2" Clear Unless Otl	(Typ) herwise Shown	3- 41/2 65%		
8- 8		<del>-1</del> 1	op of Pavement	6-		Top of Pavement	3" 41/2" 65%" Q		<u>3/6 °                                    </u>
1 . ±		.		1 91/2:		<u>.α.</u>	43/4" 41/2" 47/8"		ELEVATION
0/	· · · ·	<b>~</b>		8½" See: Ke	yway		<u>                                     </u>		CONSTRUCTION JOINT DETAIL
		" Minimum		See Ke <u>Detail</u>	(1 <i>yp)</i> / \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \	int <sup>③</sup> Dwg C-07.01		[appropries can agree:	
	1'-31/8" WITH AC			© Grout Lev Bed (Typ)	AT REBAR - WITH PCCP	<u> </u>	" (Typ)	May Upaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  STOTE OF TRANSPORTATION TO STANDARD DRAWINGS
	SECTION A-A				SECTION B-B		KEYWAY DETAIL	APPROVED FOR DISTRIBUTION	CONCRETE HALF BARRIER 32" TYPE 'F' AT PIERS PRECAST  C-10.54 Sheet 2 of 3

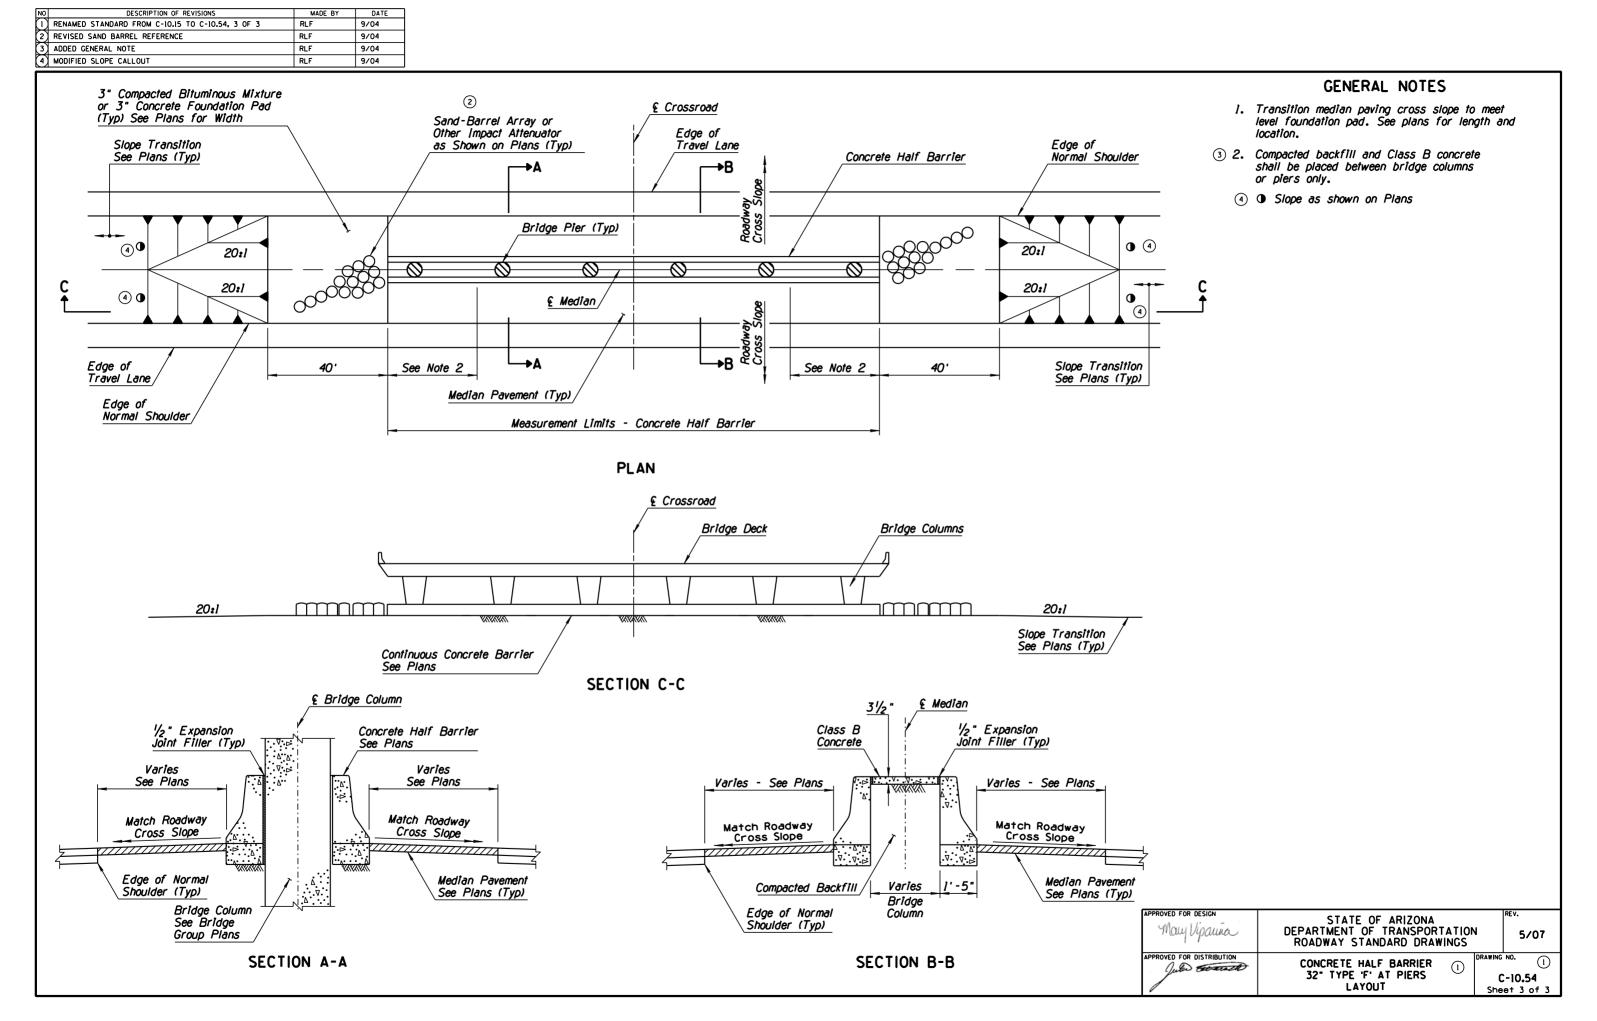


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
I)	REVISED SECTION A-A: ADDED CONCRETE CAP & NOTES	RLF	11/06
2	REVISED GENERAL NOTE 4	RLF	11/06
3)	ADDED (Typ)	RLF	11/06
<u>a</u>			

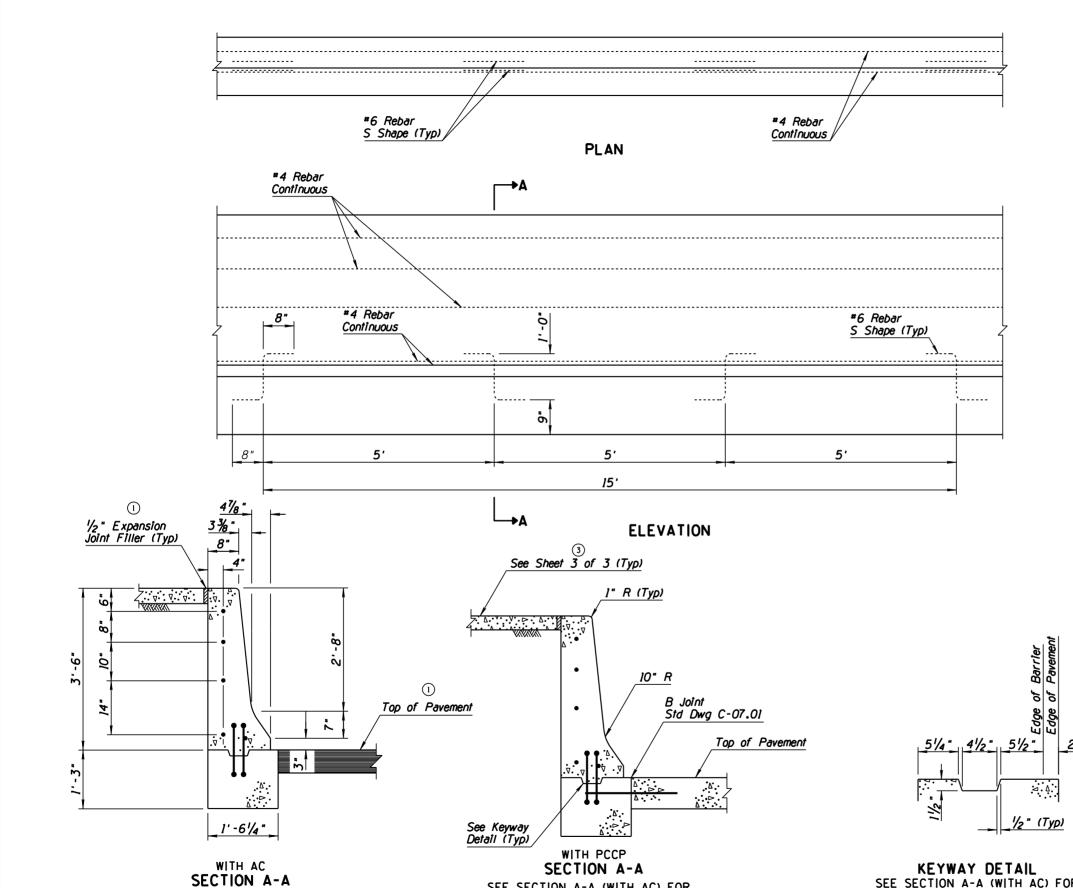


SEE SECTION A-A (WITH AC) FOR TYPICAL REBAR PLACEMENT


### GENERAL NOTES


- 1. Concrete shall be Class S, f'c = 4000 PSI.
- 2. If the footing and barrier are cast monolithically, \*6 S shape rebars are not required.
- Barrier width shall not exceed the barrier footing width nor overhang the adjacent pavement.
- ② 4. Longitudinal rebar shall extend 12" past the construction joint at the completion of each incremental pour.



SEE SECTION A-A (WITH AC) FOR TYPICAL REBAR PLACEMENT

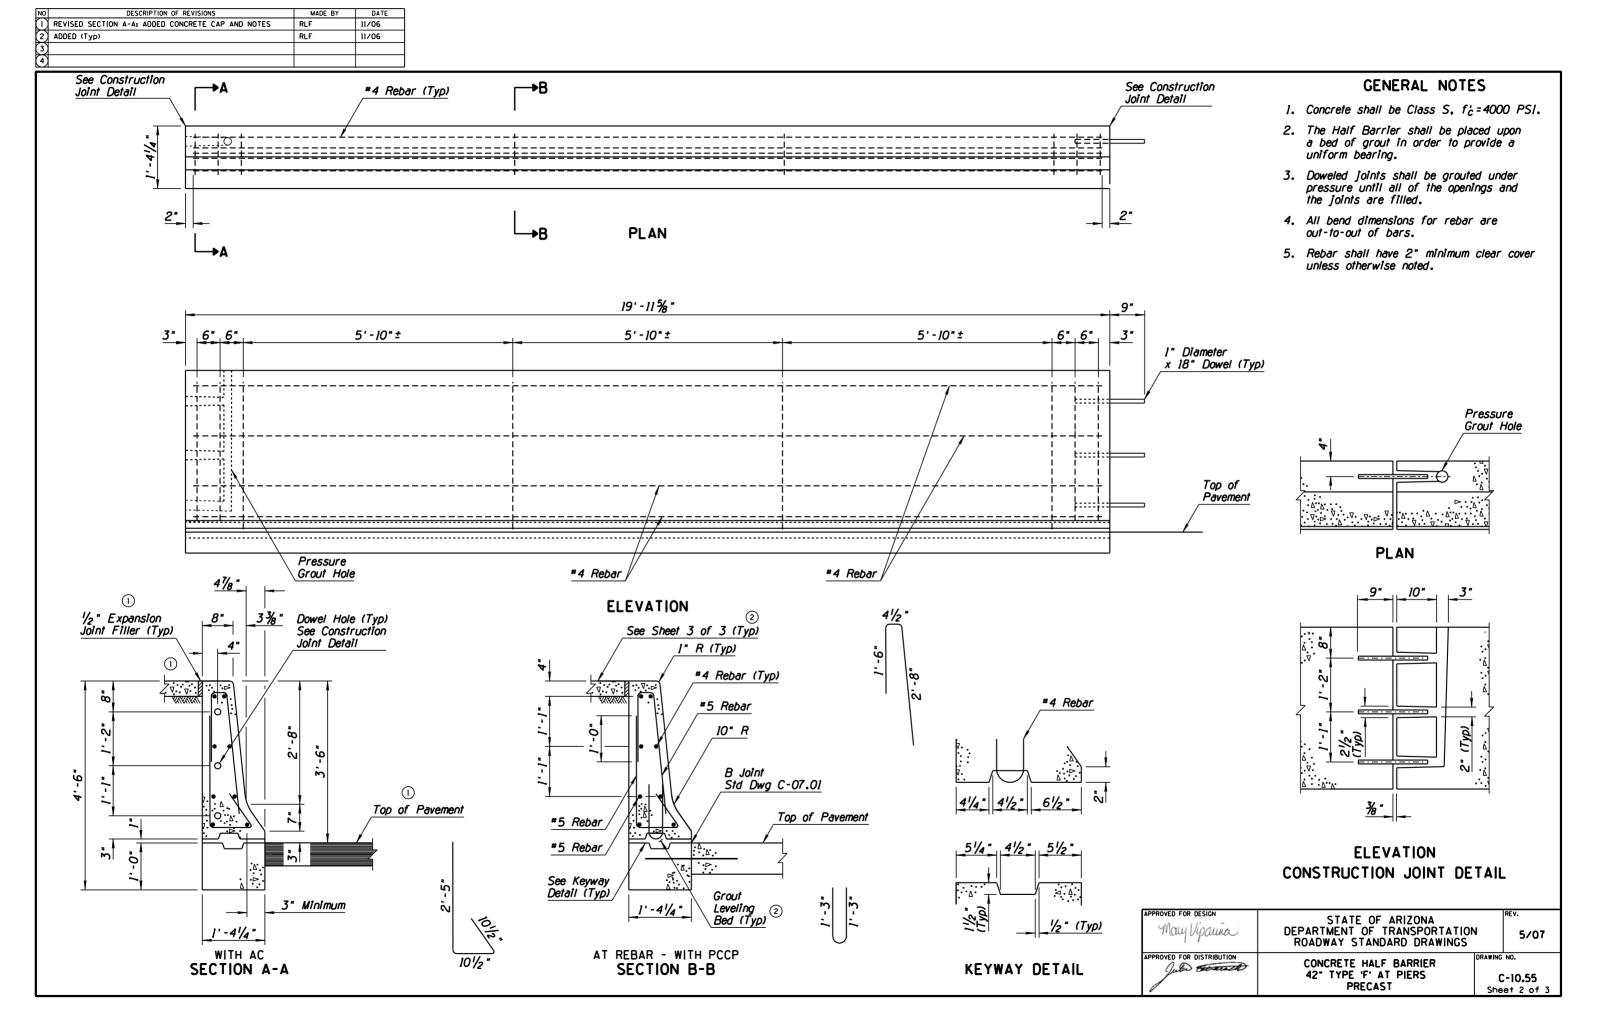


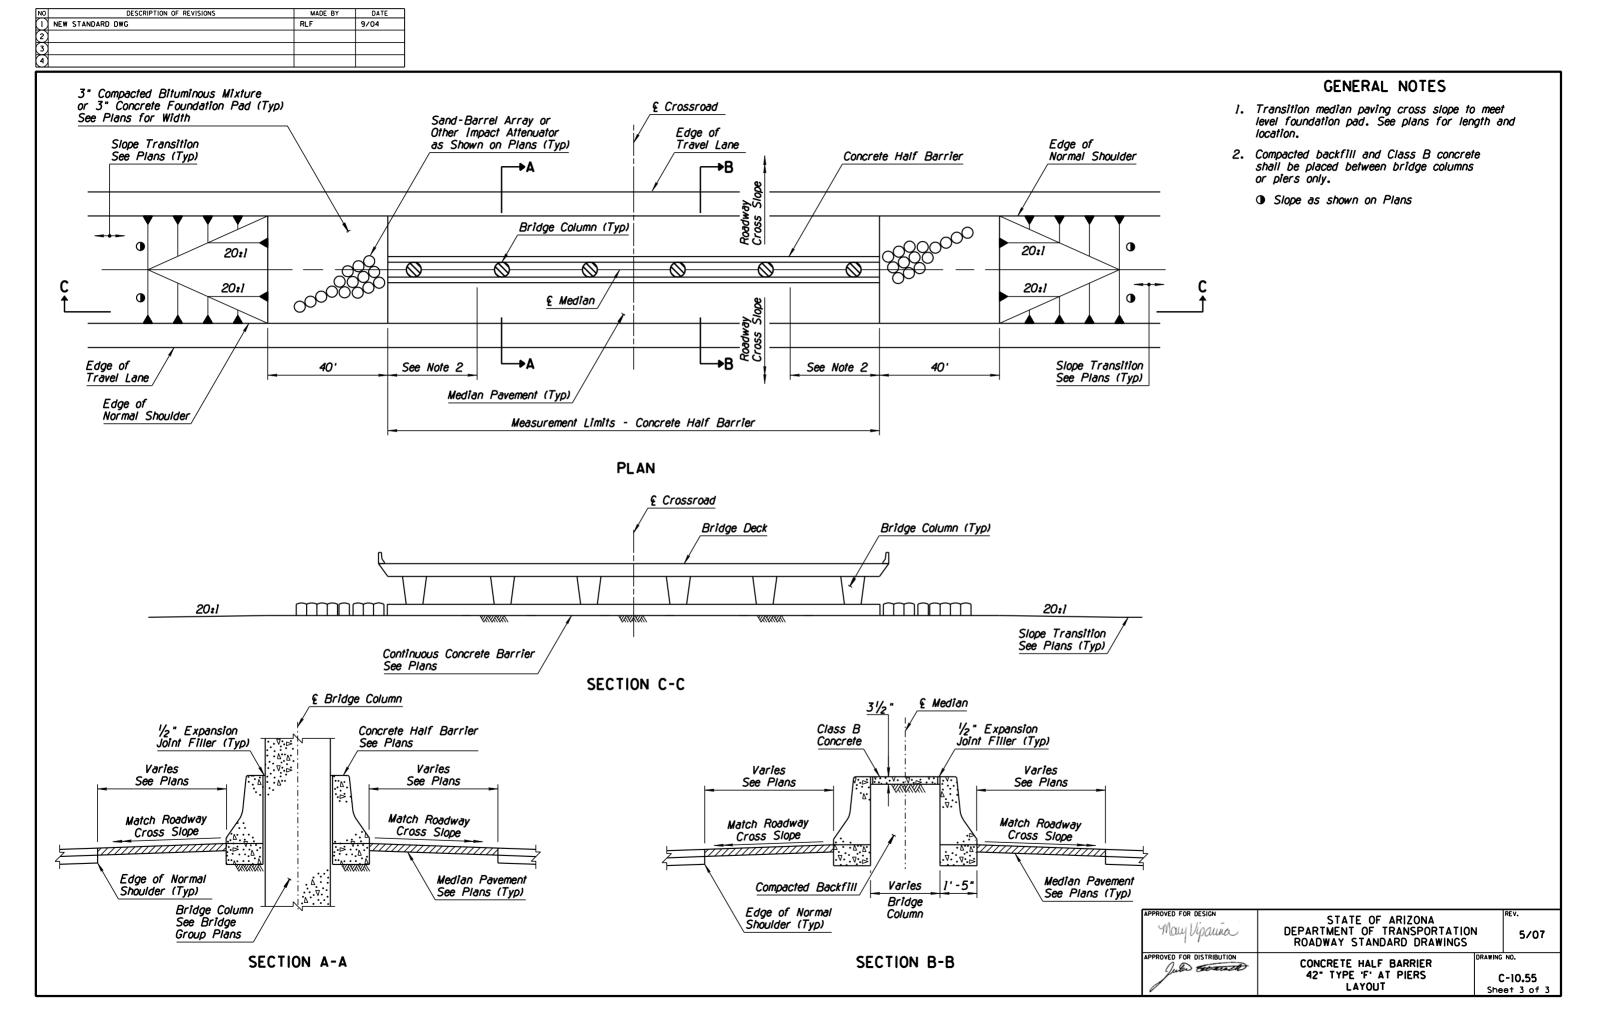

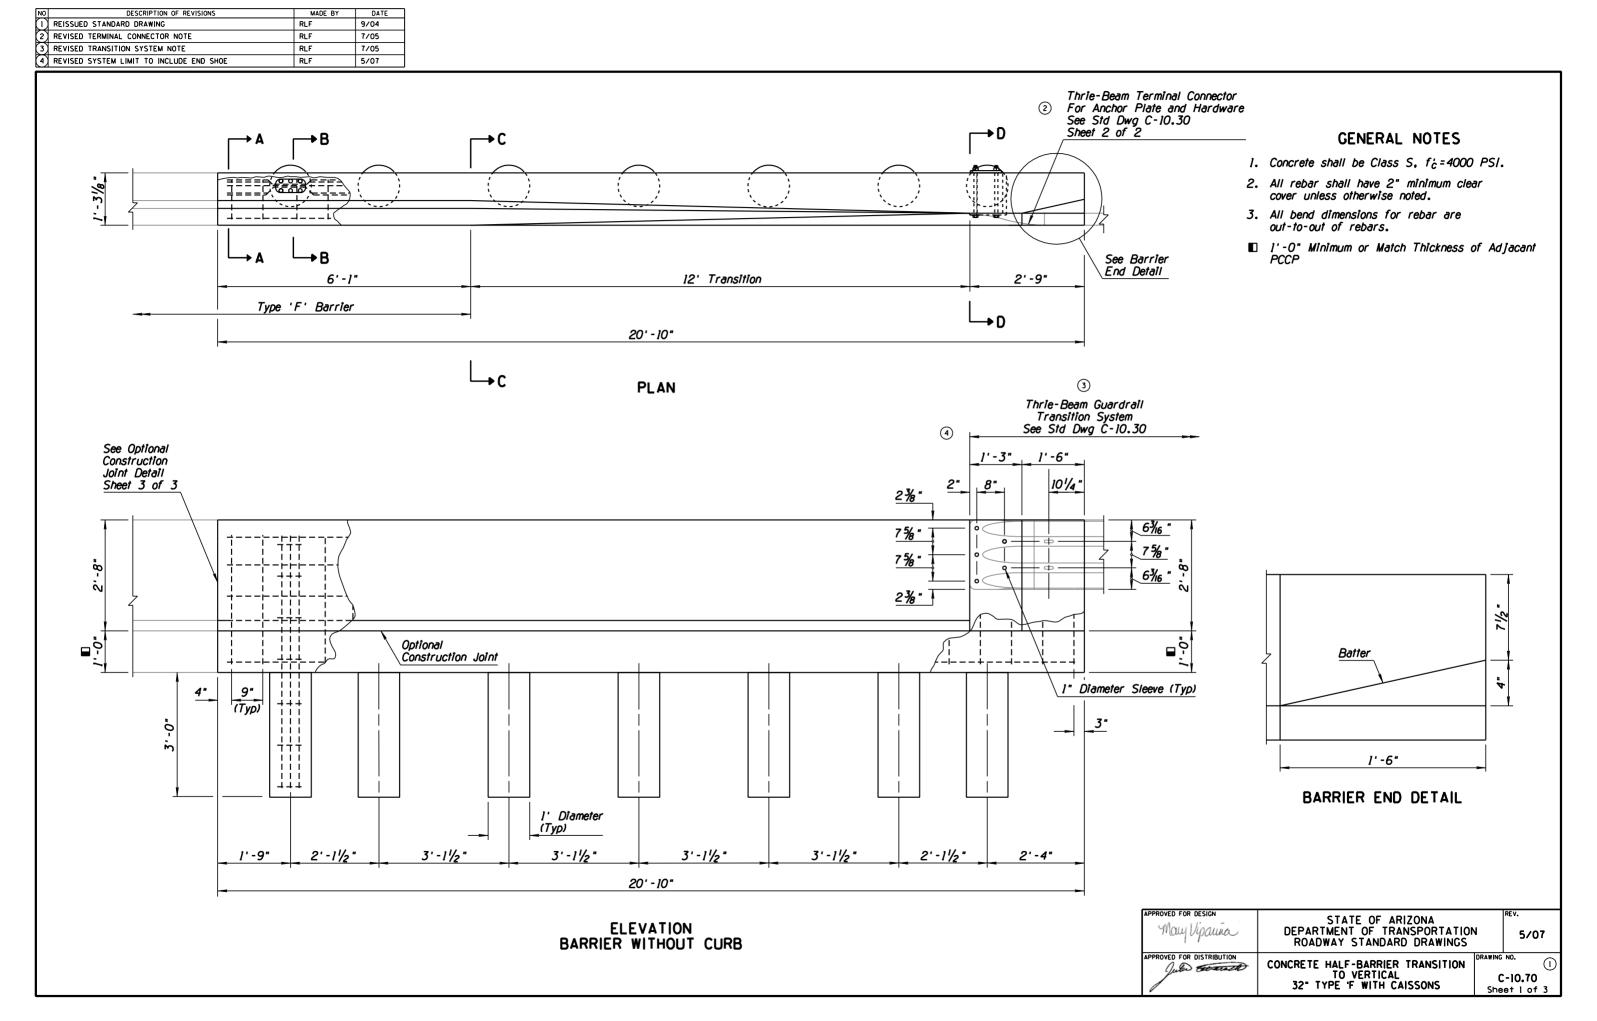


NO   DESCRIPTION OF REVISIONS   MADE BY   DATE			
<i>I* R</i> ①	6"	21	GENERAL NOTES  1. See Section B-B for caisson reinforcement.  See Optional Construction Joint Detail, Sheet 3 of 3  1'-0" Minimum or Match Thickness of Adjacant PCCP
1 **6 Rebar (Continuous)  8 **4 Rebars   1 **3 /6 ** 2 /4 ** 2	7 "4 Rebar Ties 12" Center to Center (All Calssons) See Calsson Reinforcement Detail Sheet 3 of 3  6 "B Rebars (All Calssons) See Calsson Reinforcement Detail Sheet 3 of 3  Optional Construction Joint (Typ) Roadway Width + Offset (2' Typ)  19 "4 Rebars 9" Center to Co	Roadway Width + Offset (2' Typ)	I' Diameter Sleeve (Typ)  To Anchor Plate and Hardware See Std Dwg C-10.30 Sheet 2 of 2  Thrie Beam Terminal Connector See Std Dwg C-10.30  Sheet 2 of 2  WITHOUT CURB SECTION D-D  WITHOUT CURB SECTION D-D  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION CONCRETE HALF-BARRIER TRANSITION TO VERTICAL 32* TYPE 'F' WITH CAISSONS 2  Sheet 2 of 3  CONCRETE HALF-BARRIER TRANSITION TO VERTICAL 32* TYPE 'F' WITH CAISSONS 2  Sheet 2 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1 REVISED T	ITLE	RLF	9/04
2 REMOVED	ANCHOR PLATE DETAIL	RLF	9/04
(3)			

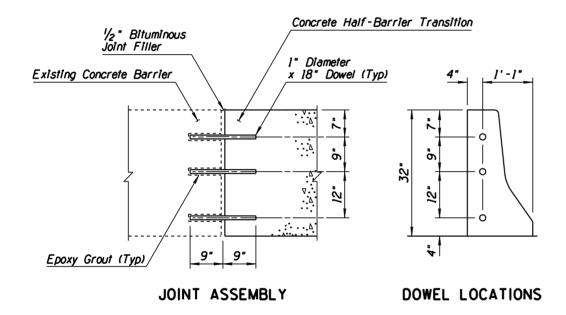

CONSTRUCTION JOINT DETAIL (OPTIONAL)



\*4 Rebar Tie
12" Center to Center


CAISSON REINFORCEMENT

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	CONCRETE HALF-BARRIER TRANSITION TO VERTICAL 32- TYPE 'F' WITH CAISSONS	_	no. -10.70 et 3 of 3

2


1) REISSUED STANDARD DRAWING RLF 9 2) REVISED NOTE RLF 1	DATE 9/04 7/05 5/07		
<b>┌→A</b>	Г <b>→</b> В	Thrie-Beam Terminal Connector For Anchor Plate and Hardware See Std Dwg C-10.30 Sheet 2 of 2	GENERAL NOTES  1. Concrete shall be Class S, f'c = 4000 PSI.  2. All rebar shall have 2" minimum clear cover unless otherwise noted.
		See Barrier End Detail	<ul> <li>3. All bend dimensions for rebar are out-to-out of bars.</li> <li>4. Two-inch deep contraction joints shall be placed in the gutter at locations which match the joints in adjacent PCCP and at approximate 15' centers when adjacent to AC pavement. Joints shall be either hand tooled or sawn.</li> <li>I'-O" Minimum or Match Thickness of Adjacant PCCP</li> </ul>
Type 'F' Barrier	20'-10" PLAN	2'-9" →C	Lip Curb & Gutter
See Optional Construction Joint Detail Sheet 2 of 2	Traffic	Thrie-Beam Guardrail Transition System See Std Dwg C-10.30  1'-3" 1'-6"  2" 8" 10'/4"	BARRIER END DETAIL
		7 % " 6 % 6 " 2 ½ " 2 ½ "	
3" 9" (Typ)	Optional Construction Joint  20' - 10"	1" Diameter Sleeve (Typ)	
	ELEVATION BARRIER WITH CURB AND GUTTER	APPROVED FOR DESIGN May Vipau  APPROVED FOR DISTRIE	ROADWAY STANDARD DRAWINGS


NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REISSUED STD DWG RLF 9/04  2 ADDED REFERENCE RLF 9/04  3 REMOVED ANCHOR PLATE DETAIL RLF 9/04	
	Varies  Varies  Varies  Varies  Varies  Varies  Roadway Width  Gutter Width Varies 2'-6- to 4'-6' (Typ) See Plans  Pavement  B Joint Sid Dwg C-07.01  B Joint Sid Dwg C-07.01
8 *4 Rebars 9" Center to Center 3" Clear of Bottom  SECTION A-A  7 *4 Rebars (Continuous)	Optional Construction Joint 1'-31/8" 16 *5 Rebars 9" Center to Center  SECTION B-B
I" Diameter Sleeve (Typ)  For Anchor Plate and Hardware See Std Dwg C-10.30 Sheet 2 of 2  Roadway Width  Gutter Width Varies 2'-6" to 4'-6" (Typ) See Plans Pavement	Concrete Half- Barrier Transition  I" Diameter x 18" Dowel (Typ)  4" 1'-1" 6"
2 (a) Thrie-Beam Terminal Connector See Std Dwg C-10.30  B Joint Std Dwg C-07.01	Epoxy Grout (Typ)  9" 9"  3
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$	JOINT ASSEMBLY DOWEL LOCATIONS  CONSTRUCTION JOINT DETAIL (OPTIONAL)
6"	APPROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION TO VERTICAL 32" TYPE 'F' WITH CURB & GUTTER  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION TO VERTICAL STATE OF ARIZONA TO VERTICAL C-10.71 Sheet 2 of 2

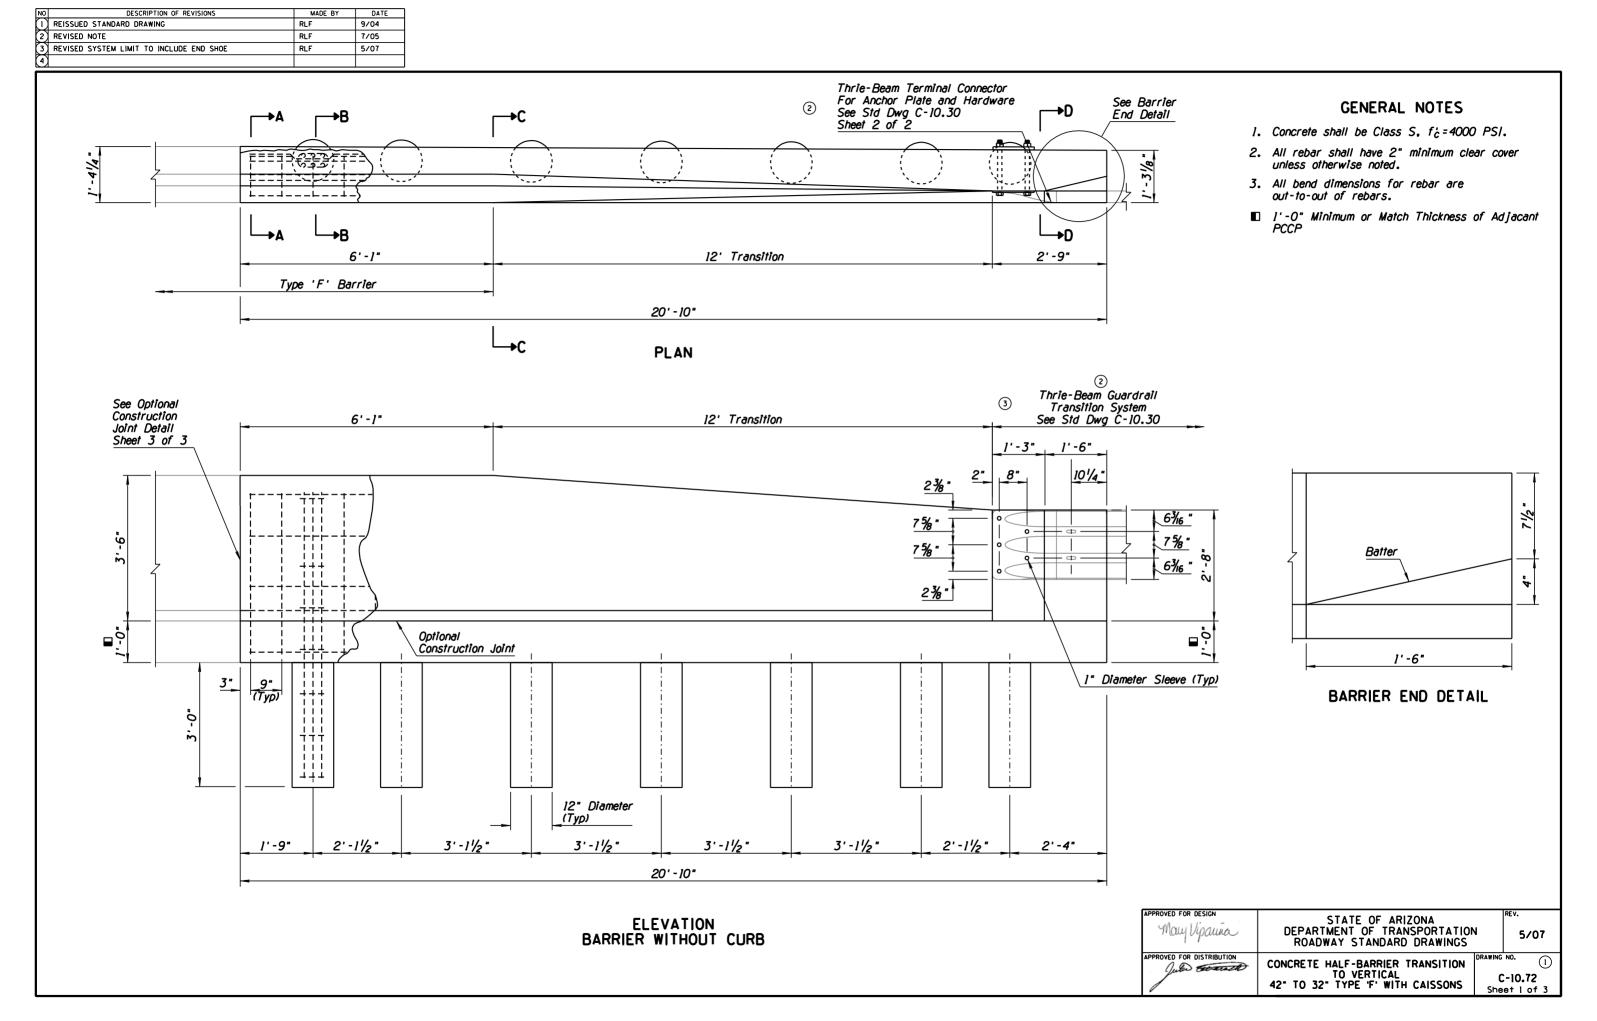


NO DESCRIPTION OF REVISIONS MADE BY DATE  1) REISSUED STD DWG RLF 9/04  2) REVISED NOTE RLF 7/05  3)			
	51/2"	6.	GENERAL NOTES  1. See Section B-B for caisson reinforcement.  ① See Optional Construction Joint Detail, Sheet 3 of 3  ① 1'-0" Minimum or Match Thickness of Adjacant PCCP
Roadway Width * Offset (2' Typ)  14 "4x18" Rebars 18" Center to Center  19" Center to Center 27 "4 Rebars 9" Center to Center 3" Clear of Bottom  WITHOUT CURB SECTION A-A	7 #4 Rebar Till2" Center to (All Calssons) See Reinforcement Is Sheet 3 of 3  6 #8 Rebars Calssons) See Reinforcement Sheet 3 of 3  Optional Construction Roadway Width Offset (2' Ty	Varies  Varies	I" Diameter Sleeve (Typ)  3/2 Roadway Width + Offset (2' Typ)  Thrie-Beam Terminal Connector See Std Dwg C-10.30  3 "5 Rebars 9" Center to Center  WITHOUT CURB SECTION D-D  6"  WITHOUT CURB SECTION D-D  6"
	Diameter  WITHOUT CURB SECTION B-B		APPROVED FOR DESIGN  STATE OF ARIZONA  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION TO VERTICAL 42- TO 32- TYPE 'F' WITH CAISSONS  REV.  5/07  CONCRETE HALF-BARRIER TRANSITION TO VERTICAL 42- TO 32- TYPE 'F' WITH CAISSONS  Sheet 2 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1	REVISED TITLE	RLF	9/04
2	REMOVED ANCHOR PLATE DETAIL	RLF	9/04
3			
(4)			

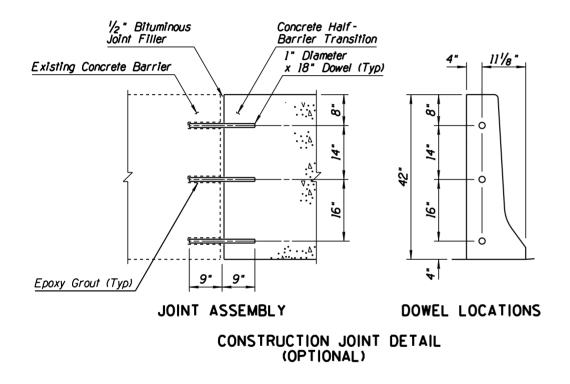



#4 Rebar Tie 12" Center to Center



CAISSON REINFORCEMENT

APPROVED FOR DESIGN

May Vipaura

DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS


APPROVED FOR DISTRIBUTION
TO VERTICAL
42\* TO 32\* TYPE 'F' WITH CAISSONS

REV.

5/07

CONCRETE HALF-BARRIER TRANSITION
TO VERTICAL
42\* TO 32\* TYPE 'F' WITH CAISSONS


2

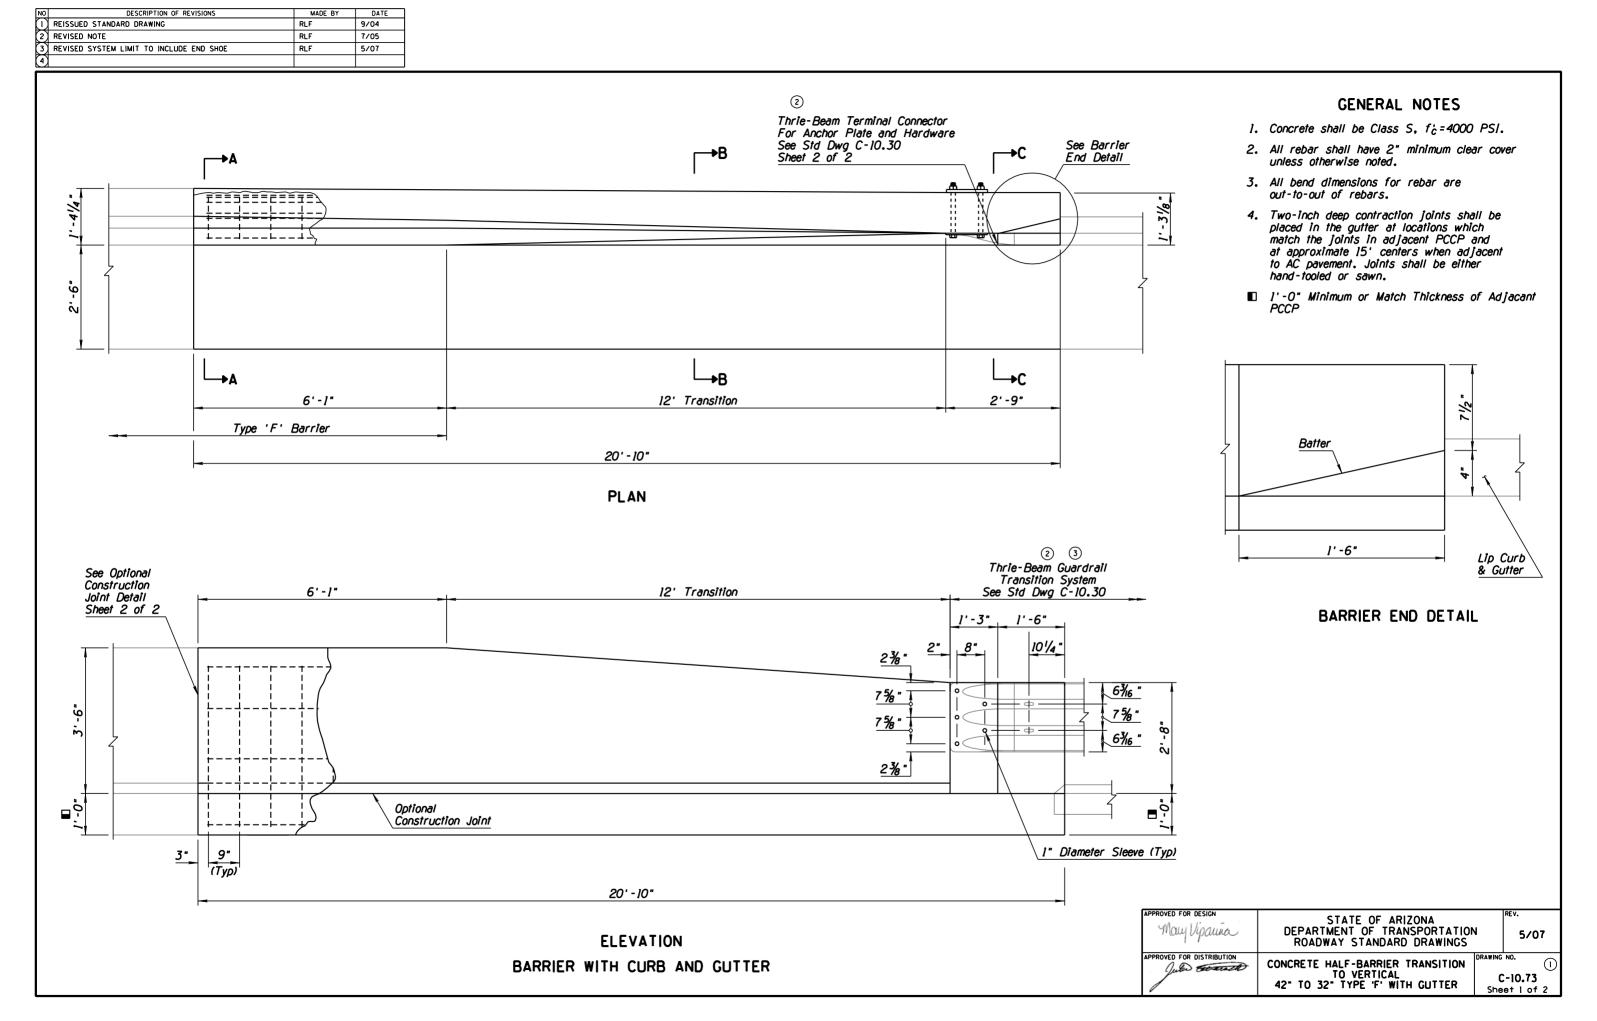


NO DESCRIPTION OF REVISIONS MADE BY DATE  (1) REVISED TITLE RLF 9/04  (2) ADDED REFERENCE RLF 9/04	
3 REMOVED ANCHOR PLATE DETAIL RLF 9/04 4 REVISED NOTE RLF 7/05	
1 **6 Rebar (Continuous)  8"  4"  4"  3%  See Plans  Pavement	Varies  Varies  Varies  Gutter Width Varies  2'-6" to 4'-6" (Typ)  Varies  Varies  Varies  Pavement  See Optional Construction Joint Detail  1'-0" Minimum or Match Thickness of Adjacant PCCP
27 "4 Rebars 9 " Center to	B Joint Std Dwg C-07.01  19 *4 Rebars 9* Center to Center Optional
8 *4 Rebars 9" Center to Center 3" Clear of Bottom  SECTION A-A  8 *4 Rebars (Continuous)	Construction Joint (Typ)  Varies  16 *5 Rebars 9" Center to Center  SECTION B-B  Concrete Half- Barrier Transition
Pavement    " Diameter Sleeve (Typ)   Roadway Width	Existing Concrete Barrier  1" Diameter x 18" Dowel (Typ)  1" Diameter x 18" Dowel (Typ)  3  3
2 4  Thrie-Beam Terminal Connector See Std Dwg C-10.30  B Joint Std Dwg C-07.01	JOINT ASSEMBLY  DOWEL LOCATIONS
3 *5 Rebars 9" Center to Center $ \begin{array}{ccccccccccccccccccccccccccccccccccc$	CONSTRUCTION JOINT DETAIL (OPTIONAL)
SECTION C-C	APPROVED FOR DESIGN  May Vigaura  APPROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION CONCRETE HALF-BARRIER TRANSITION TO VERTICAL 42" TO 32" TYPE 'F' WITH GUTTER Sheet 2 of


NO DESCRIPTION OF REVISIONS  1 REISSUED STANDARD DRAWING	MADE BY DATE RLF 5/07		
(2) (3) (4)			
Concrete Half Barrier 42" Type 'F' With Gutter Sid Dwg C-10.53 or as Shown on Plans	#4 Rebar Continuous  #6 Rebar S Shape S Shape	as Snown on Plans	GENERAL NOTES  1. Half-barrier Transition shall be constructed by the formed cast-in-place method.  2. Concrete shall be Class S, f'c=4000 PSI.  3. If the footing and barrier are cast monolithically, *6 S shape rebars are not required.  4. Barrier width shall not exceed the barrier footing width nor overhang the adjacent pavement.  5. *4 rebar shall extend 12* past the construction joint at the completion of the day's pour.  6. Gutter thickness can be adjusted to match the PCCP thickness, as approved by the Engineer.  7. Two-inch deep construction joints shall be placed in the gutter at locations which match the joints in adjacent PCCP and at
		20	approximate 15' centers when adjacent to AC pavement. Joints shall be either hand tooled or sawn.  2'-0"    1'-4!/4" to 1'-3!/8"   4'/8"    3
PLAN CONSTRUCTIO	Varies Match Adjoining Gutter Depression  ELEVATION  ON JOINT DETAIL TIONAL)	Gutter Width Varies 2'-6" or 4'-6" (Typ) See Plans  Horizontal Line Varies  Varies  PCCP See Plans  PCCP See Plans	3" Minimum  Optional Construction Joint See Plans  SECTION A-A  SECTION A-A  APPROVED FOR DESIGN  May Vigaura  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION  APPROVED FOR DISTRIBUTION  CONCRETE HALF-BARRIER TRANSITION  42" TO 32" TYPE 'F'  C-10.74

NO		
Sidewalk Cross Slope = 0.010 '/ri (Toward the Curb)  Outside Edge of Sidewalk Std Dwg C-05.20  Lip of Gutter	Transition Sidewalk Slope and Width In 5'  Concrete Curb and Gutter See Plans  Gutter Line  Transition Sidewalk Slope to Match In 5', Std Dwg C-05.20  V <sub>2</sub> " Bituminous Joint Filler  O- Z	CENERAL NOTES  1. All concrete shall be Class S, f'c=4000 PSI.  2. All rebar shall conform to Std Spec 1003.  3. All rebar shall have 2" minimum clear cover unless otherwise noted.  4. See drainage sheets for slotted drain and catch basin details.  5. Barrier transition shall match both adjoining curb and gutter and concrete Half Barrier.  6. See Std Dwg C-05.20 for sidewalk construction.  7. All bend dimensions for rebar are out-to-out of rebars.  8. Two-inch deep contraction joints shall be placed in the gutter at locations which match the joints in adjacent PCCP and at approximate 15' centers when adjacent to AC pavement. Joints shall be either hand tooled or sawn.
Varies  Match Adjoining Gutter Depression  Horizontal Line  7"  PCCP See Plans  B Joint Std Dwg C-07.01	Top of Curb  A B  Top of Sidewalk  Gutter Line  Transition Top of Sidewalk in 10'-0"  See Construction Joint Detail Std Dwg C-10.71 Sheet 2 of 2  ELEVATION  Transition Top of Sidewalk in 10'-0"  See Construction Joint Detail Std Dwg C-10.71 Sheet 2 of 2	#6 Rebar  #5 Rebar  12" Center to Center 11/2 " Clear of Side Walls
BARRIER GUTTER DETAIL   \frac{10\cdot 8}{8} \cdot 1' - 3\frac{1}{8} \cdot 2' - 0'' \\  \frac{2}{1} \cdot 2' \cdot 2'' \\  \frac{3}{1} \cdot 2'' \cdot 2'' \cdot 2'' \\  \frac{3}{1} \cdot 2'' \cdot 2'' \cdot 2'' \\  \frac{3}{1} \cdot 2'' \cdot	Varies From    1'-3 /6"   Varies From   1'-4" to 3'-6"     2'-0"     35'   Varies to 7"     1'-7 /2"     See Barrier Gutter Detail     2'-3"   "6 Rebars   12" Center to Center   3" Clear of Bottom and Side Walls When Cast   Against Earth     1'-7 /2"	See Barrier Gutter Detail  See Barrier Gutter Detail  #5 Rebar (Typ)  2'-3"  "6 Rebars 12" Center to Center 3" Clear of Bottom and Side Walls When Cast Against Earth  SECTION C-C TRANSITION TO VERTICAL TYPE CURB  APPROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  CONCRETE HALF-BARRIER TRANSITION TYPE F' TANGENT DEPARTURE TYPE 1  ORAHING NO.  C-10.75 Sheet 1 of 2

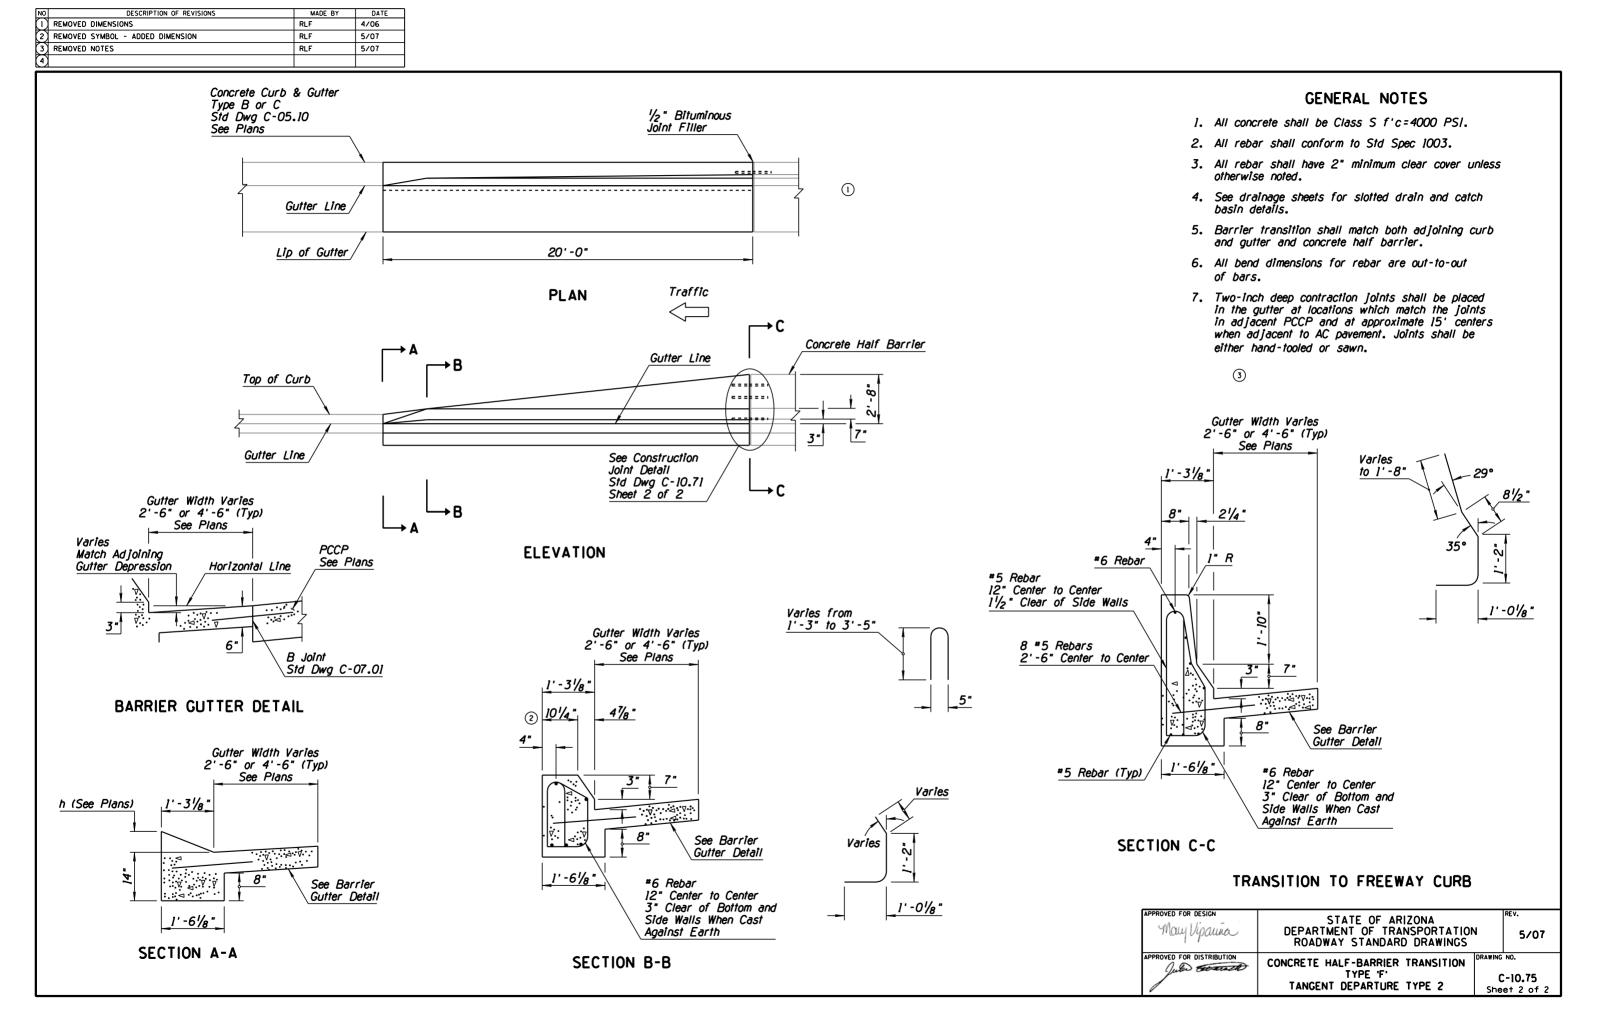

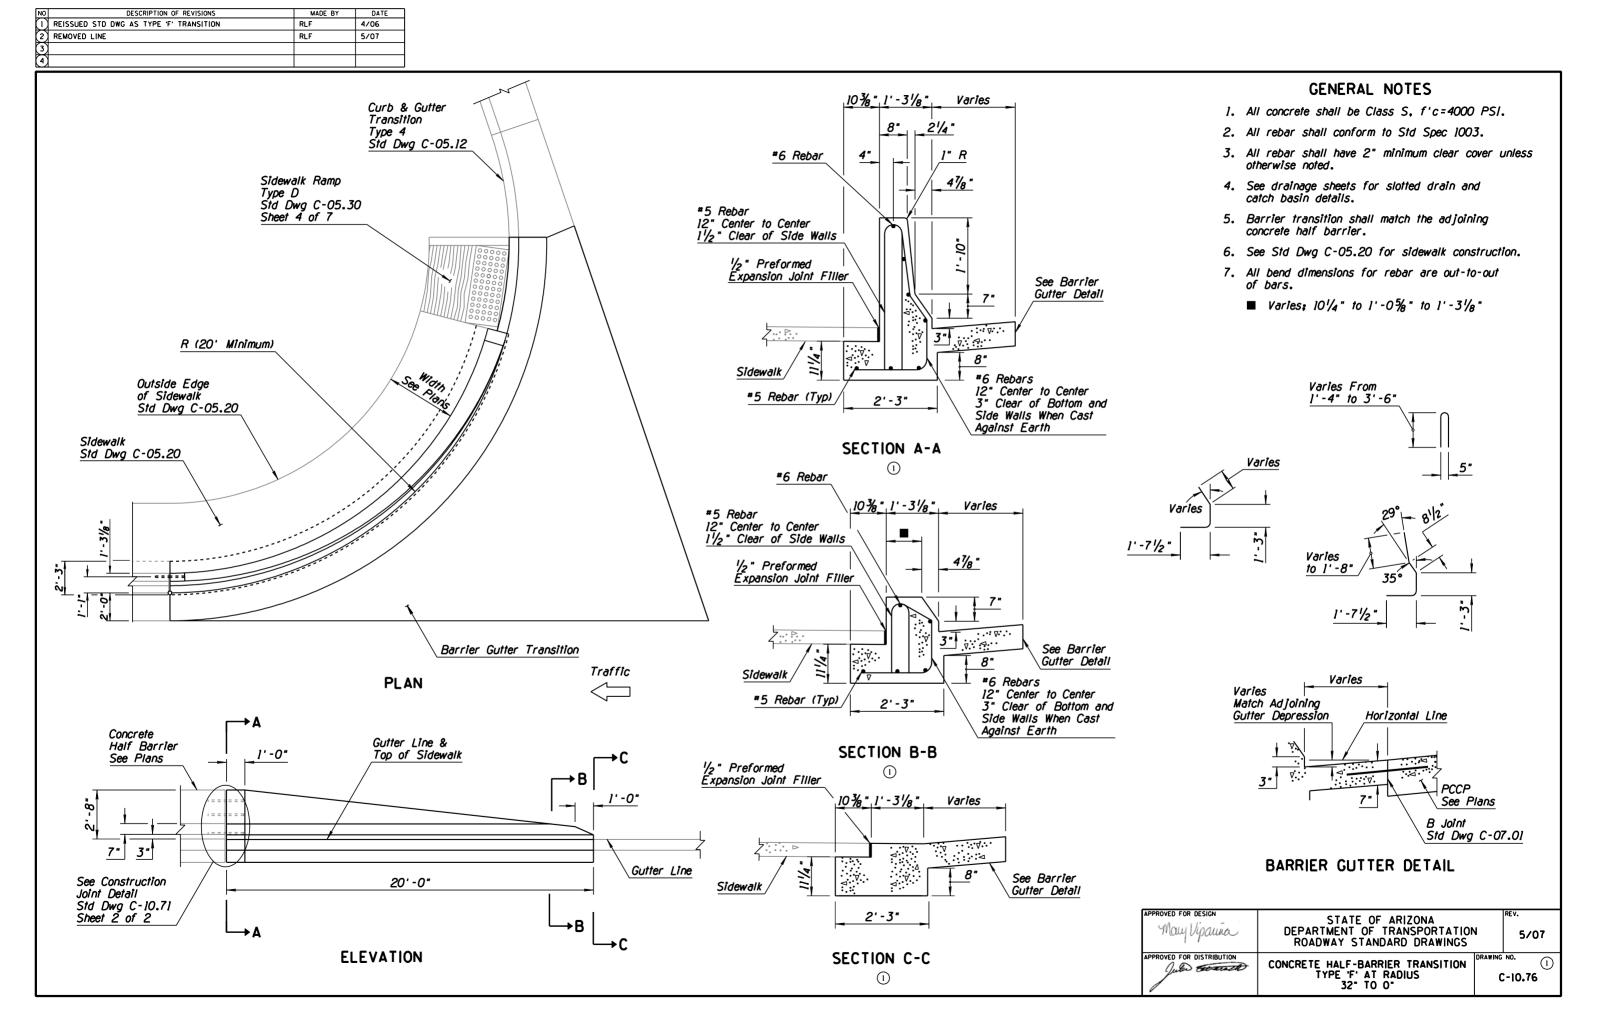


NO DESCRIPTION OF REVISIONS MADE BY DATE TO THE PROPERTY OF TH	E		
Slope Quitons Options	6" (Typ) ns PCC Pavement Width  & Gutter x 5" Lip Curb Sid Dwg C-10.30 ② 1 of ②  Slope  Optional Construction	Gutter Width Varies 2'-6" or 4'-6" (Typ) See Plans  PCC Pavement Width  Gutter Flowline  Joint  Subgrade  Type B, C or Cl Curb With Variable Width Gutter Gutter Depression Varies See Std Dwg C-05.10	I. See plans and barrier summary sheets for location and type of guardrail and end treatments. Timber post Installation shown.  2. See Std Dwgs C-05.10, 05.12, 10.01 and 10.02 for dimensions and details not shown.  3. Type B guardrail installation shown. For Type A guardrail installation, use Type D-1 Curb and Gutter instead of the Type D-2 Curb and Gutter shown.  4. See plans for type and location of drainage facilities.  5. Bituminous joint filler (1/2") shall be placed when the curb & gutter or concrete widening abuts slotted drains, catch basins, dados, barrier, etc. Scored joints, 2" in depth, shall be placed to match adjacent joints in PCCP or at 15' intervals when adjacent to AC or continuously reinforced concrete pavement.  ① To Top of W-Beam Guardrail
SECTION	A-A	SECTION B-B	
Concrete Barrier Transition, Type 2 Std Dwg C-10.75 Sheet 2 of 2  Curb & Gutter Transition, Type 5 Std Dwg C-05.12  Curb & Gutter Type B, C or Cl Std Dwg C-05.10  Lip of Gutter  Edge of Traffic Lane	Concrete Half-Barrier Transition To Vertical Std Dwg C-10.71  Concrete Gutter  Curb & Gutter Std Dwg C-10.30 Sheet 1 of 2	Guardrail Transition Thrie-beam to Concrete Half Barrier Std Dwg C-10.30  Curb & Gutter Type B, C or C1 With Variable-Width Gutter Std Dwg C-05.10  Payment Limits for Variable-Width Gutter See Appropriate End Treatment De	APPROVED FOR DESIGN STATE OF ARIZONA REV.
			DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION END TERMINAL CURB AND GUTTER  DEPARTMENT OF TRANSPORTATION FOR TRANSPORTATION CONCRETE HALF-BARRIER TRANSITION C-10.77

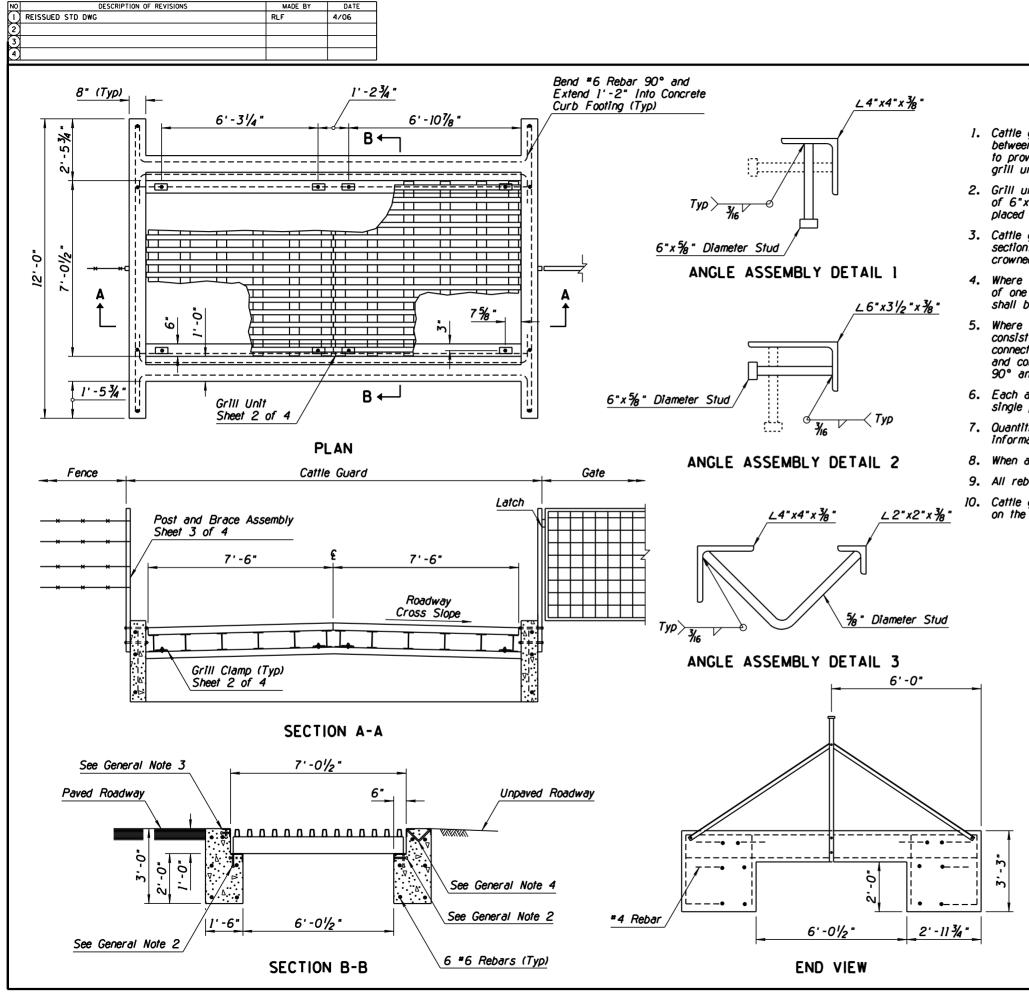



- Cattle guard shall include two (2) clamps per Sheet 4 at each gap between two (2) grill units, one at each end. Clamps shall be adjusted to provide a ¼-inch, plus or minus ¼-inch gap between adjacent grill units.
- 2. Grill units shall be set on an angle iron assembly consisting of one piece of 6"x3"/2"x3%" angle iron and studs with a head. The studs shall be placed on 1'-0" alternate centers. See Angle Assembly Detail 2.
- 3. Cattle guard shall be sloped to conform to the roadway grade and crosssection, except that where an odd number of grill units is specified in a crowned roadway, the center grill unit shall have a level cross slope.
- 4. Where the adjacent roadway is paved, an angle iron assembly shall consist of one piece of 4"x4"x¾" angle iron and studs with a head. The studs shall be placed on 1'-0" alternate centers. See Angle Assembly Detail 1.
- 5. Where the adjacent roadway is unpaved, an angle iron assembly shall consist of one 4"x4"x½" angle iron, one 2"x2"x½" angle iron, and connected with studs. The assembly shall be crowned at the centerline and constructed with a bevel cut and welded. The studs shall be bent 90° and placed on 1'-0" centers. See Angle Assembly Detail 3.
- Each angle iron and angle iron assembly shall be fabricated to form a single piece for the full length of the cattle guard.
- 7. Quantities shown for concrete and rebar are approximations for informational purposes only.
- 8. When a gate is to be installed, it shall be called out on the plans.
- 9. All rebar shall have a minimum cover of 3", or as shown on the plans.
- Cattle guard beams shall be HS-20 loading unless otherwise shown on the plans.

UNIT TABLE				
Roadway Width (ft)	Grill Units Required	Concrete (Cu Yd)	Rebar (Lbs)	
12	2	5.8	175	
16	3	8.0	240	
20	4	10.3	310	
28	5	12.5	375	
34	6	14.7	445	
36	6	14.7	445	
38	7	16.9	510	
40	7	16.9	510	


May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	5/07
APPROVED FOR DISTRIBUTION	ROADWAY CATTLE GUARD	NO. 1 C-11.10 et 1 of 4

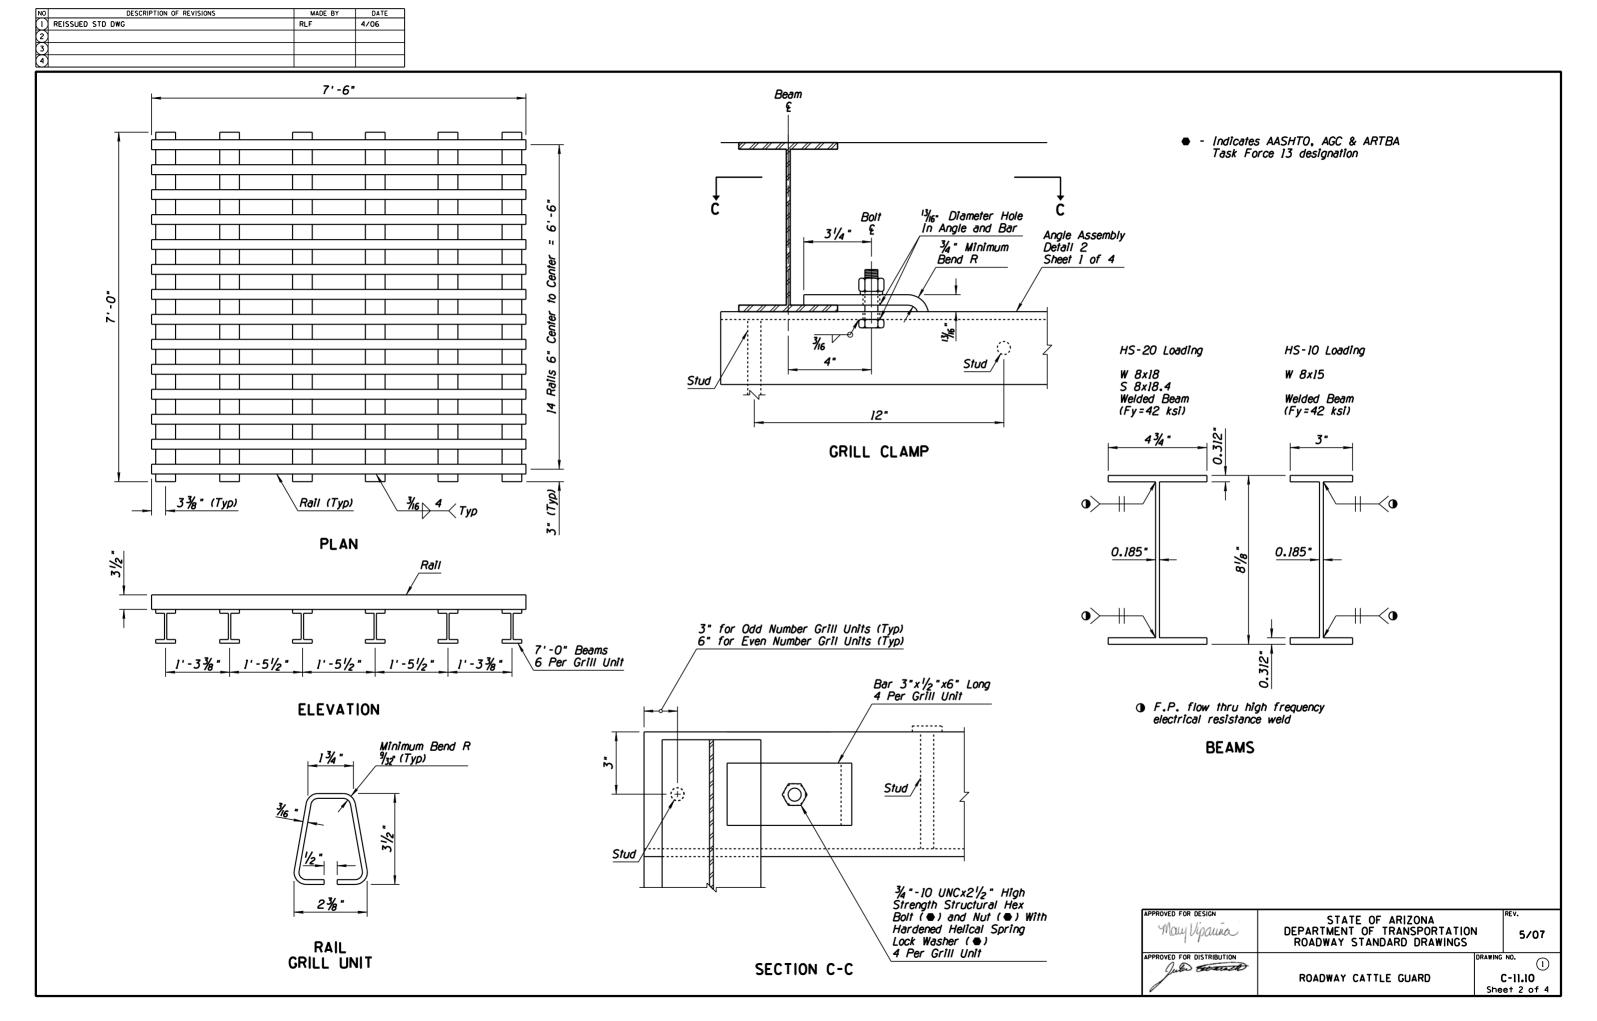




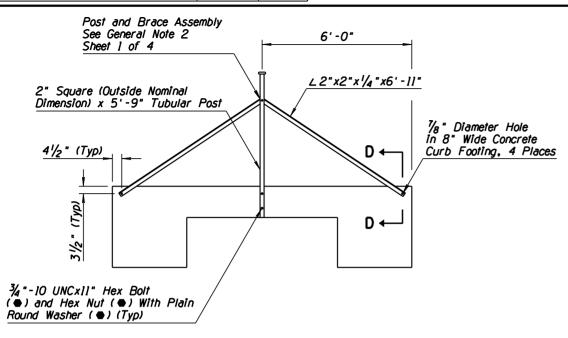

# END VIEW

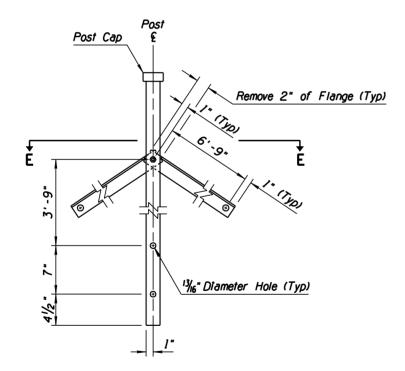


POST AND BRACE ASSEMBLY




SECTION E-E

- 1. Material for shoulder transition shall be placed to the finished roadway elevation for the entire length of the transition. When the roadway is paved, aggregate subbase or AB shall be used. When the roadway is unpaved, a material equivalent to the existing roadway shall be used.
- On steeper grades, the post shall be installed plumb to align with adjacent fencing. The brace assembly may be modified as necessary to support the post.
  - Indicates AASHTO, AGC & ARTBA Task Force 13 designation

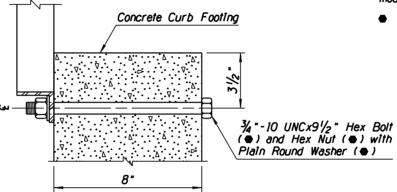


SECTION D-D

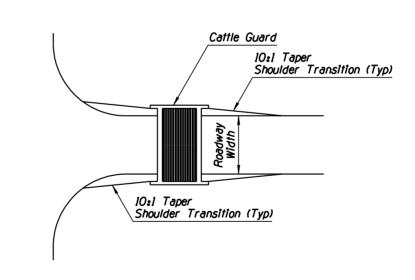


SHOULDER TRANSITION AT CATTLE GUARDS

May Vipauro	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	5/07
APPROVED FOR DISTRIBUTION	ROADWAY CATTLE GUARD	NO. 1 C-11.10 et 3 of 4


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STD DWG	RLF	4/06
2	ADDED GENERAL NOTE	RLF	5/07
3			
4			

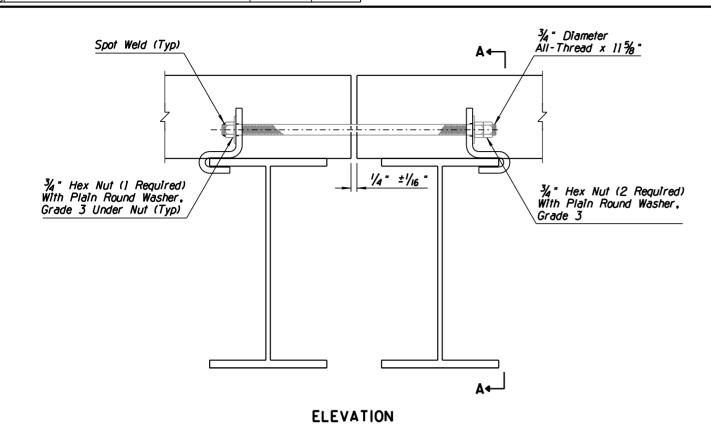

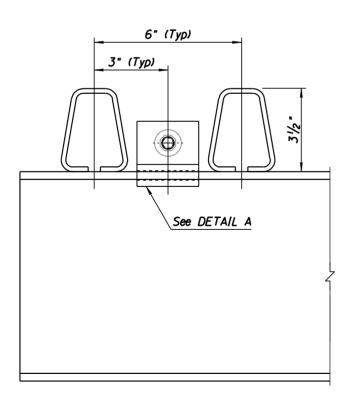


SECTION A-A


 Apply a heavy duty, high-strength anaerobic thread-locking compound to the threads before installing the double nuts.



PLAN

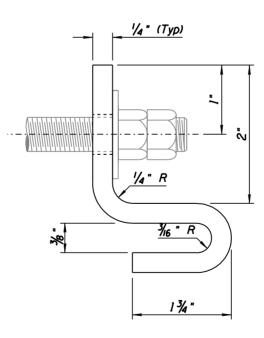


ELEVATION

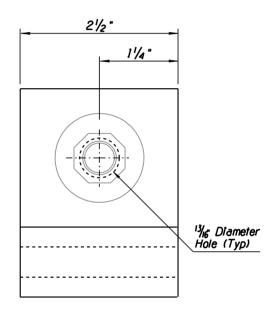



DETAIL A

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	5/07
APPROVED FOR DISTRIBUTION	ROADWAY CATTLE GUARD	NO. (1) C-11.10 et 4 of 4

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED NOTE	PNB	7/94
2	REMOVED CONCRETE NOTES	RLF	7/06
3	ADDED CONCRETE DEPTH DIMENSIONS	RLF	7/06
$\mathbf{A}$			

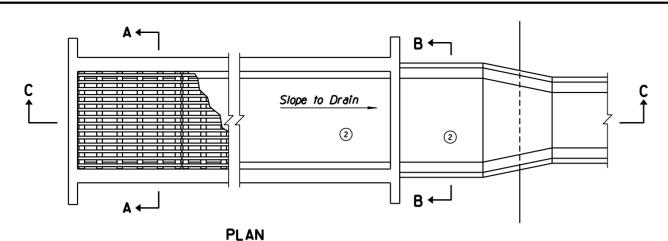

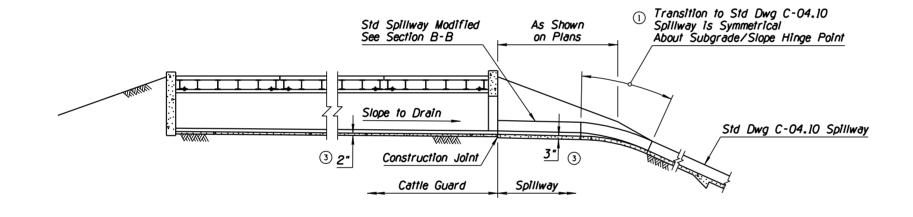





SECTION C-C IN EMBANKMENT

SECTION C-C
WHERE USED FOR THROUGH DRAINAGE
CATTLE GUARD OPEN BOTH ENDS

- 1. See Std Dwgs C-11.10 for all other Cattle Guard details.
- 2. This standard shall be used in embankment or where highly erodable soil is found.
- 3. All concrete shall be Class B.




SECTION A-A

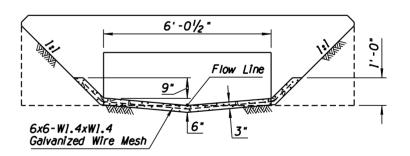


**SECTION B-B** 

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	CATTLE GUARD, DRAINAGE	DRAWING	NO. C-11.20

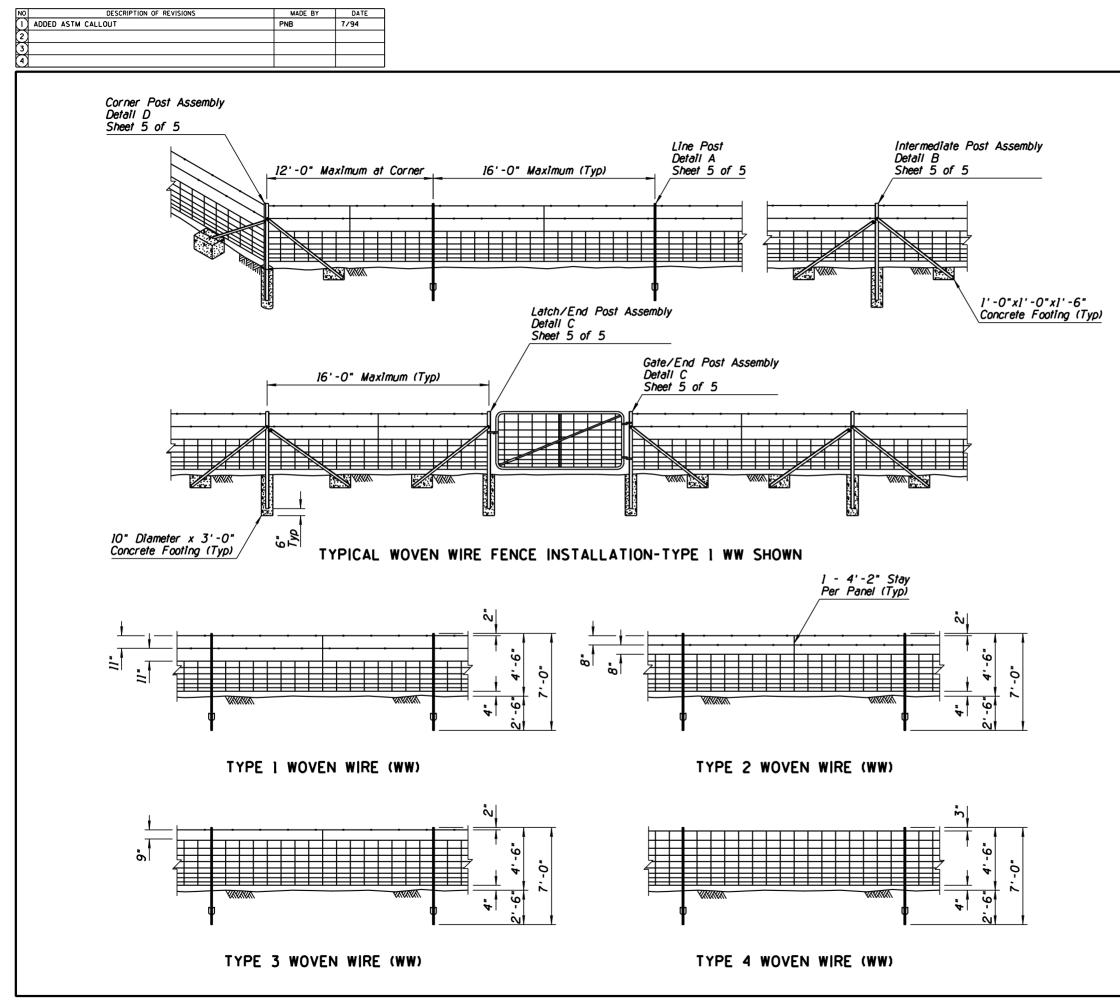


- Length of post and braces shall not be less than 7'-0".
- Woven wire fence fabric shall be attached to the post at the top, bottom, and intermediate wires.
- Intermediate Post Assemblies shall be located as shown and at intervals to utilize standard rolls to minimize cutting and waste.
- 4. A twisted wire stay shall be centered between posts.
- ◆ ASTM design number




FENCE FABRIC DIMENSIONS AND DESIGN NUMBERS

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07
APPROVED FOR DISTRIBUTION	FENCE WOVEN WIRE	C-12.10 Sheet 1 of 5




..-0.

9

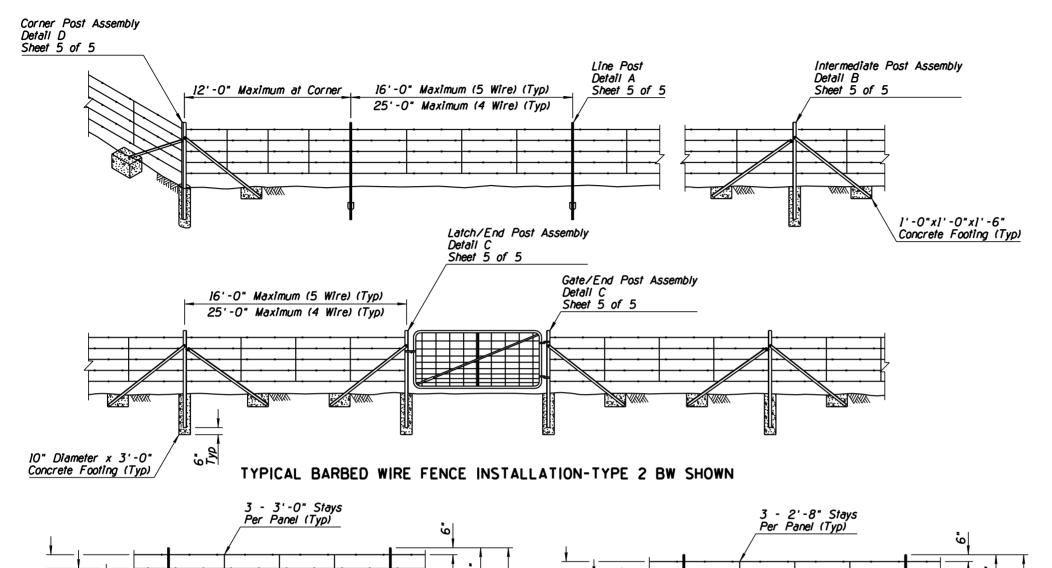


BARBED WIRE GAME FENCE (GF)

# TYPE 1 BARBED WIRE (BW) (4 WIRE)

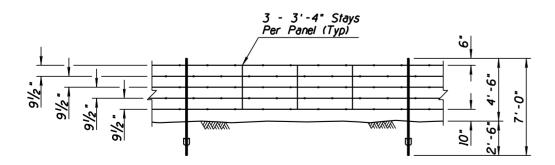


TYPE 2 BARBED WIRE (BW) (5 WIRE)

- I. Intermediate Post Assemblies shall be located as shown and at intervals not to exceed 650', or midway between all braced posts.
  - 2. For game fence the bottom wire shall be barbless.
  - 3. The stays on game fence shall have their ends turned up to prevent injuries to game.




NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REISSUED STD DWG PNB 7/94  2 ADDED DIMENSION RLF 9/04  3 4	
Intermediate Post Assembly Gate/End Post Assembly	1'-0" Maximum (Typ)
	age Channel  Single Loop of Wire  Option Top of Bank  Single Loop of Wire  Sheet 5 of 5  Detail B  Sheet 5 of 5
② E	g Weight
\((Тур)	as Required
41 Historia	OD GATE
Latch/End Post Assembly Detail C Sheet 5 of 5  Gate/End Post Assembly Detail C Sheet 5 of 5  Gate/End Post Assembly Detail C Sheet 5 of 5	
	Latch/End Post Assembly Detail C Sheet 5 of 5  20' Maximum Gate/End Post Assembly Detail C Sheet 5 of 5  Pry Stick Double Loop of Wire  Sheet 5 of 5
Truss Rod / Vertical Brace  TYPE 1 SINGLE GATE	
3" Clear Maximum  (Typ)  Gate/End Post Assembly Detail C Sheet 5 of 5  1.315" OD Drop Rod  Gate/End Post Assembly Detail C Sheet 5 of 5	Latch Board  Double Loop of Wire  1'-0" x 1'-0" x 1'-6" Concrete Footing (Typ)  10" Diameter x 3'-0" Concrete Footing (Typ)
Vertical Brace  Truss Rod	TYPE 2 GATE  APPROVED FOR DESIGN STATE OF ARIZONA REV.
1.90" OD x 10" Pipe  1.90" Double Gate  10" Diameter x 1'-0" Concrete Footing (Typ)	APPROVED FOR DESIGN  May Vipaura  DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION  FENCE  TYPE 1 AND 2 GATES  FLOOD GATE  TYPE 1 AND 2 GATES  Sheet 3 of 5


NO         DESCRIPTION OF REVISIONS         MADE BY         DATE           1         ADDED TYPE 2 GATE         RLF         9/04           2
Detail E (Typ) Sheet 5 of 5  Wingwall (Typ)  Wing Fence  Type 2 Gate Sheet 3 of 5  When Stown of Channel Bank  Right-of-Way Fence
PLAN
Type 2 Gate Sheet 3 of 5 When Shown on Plans  Drainage Channel Top of Bank to Top of Bank  Flood Gate Length as Required  Typical Installation With Type 2 Gate
ELEVATION TYPICAL FLOOD GATE INSTALLATION  APPROVED FOR DESIGN  MOLY Vigaura  APPROVED FOR DESIGN  TRANSPORTATION  ROADWAY STANDARD DRAWINGS  ORABING NO.  C-12.10 Sheet 4 of 5




**ABUTTING FENCE** 

2½"x2½"x½"x2" Angle Bracket

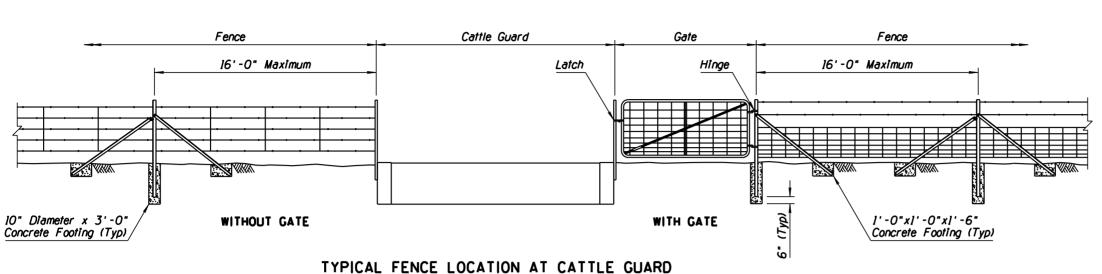

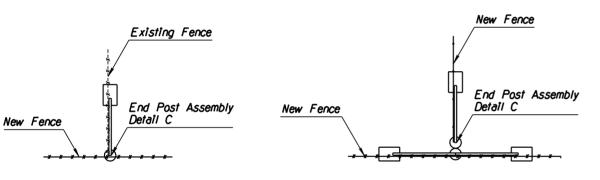


ABUTTING FENCE AT POST



DETAIL B
INTERMEDIATE POST ASSEMBLY


DETAIL C
END POST ASSEMBLY

1/2" Hex Bolt and Nut (Typ)



TYPICAL CROSS SECTIONS
OF LINE POST SHAPES


DETAIL A




DETAIL D CORNER POST ASSEMBLY

# GENERAL NOTES

 Post assemblies shall consist of an upright angle 2½"x2½"x¼" at 4.10 lbs/ft, and brace angles 2"x2"x¼" at 3.19 lbs/ft.




TYPICAL FENCE LOCATION



DETAIL E FENCE CONNECTION TO WINGWALL

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07
APPROVED FOR DISTRIBUTION	0	RAWING NO.
July the the	① FENCE MISCELLANEOUS DETAILS	C-12.10 Sheet 5 of 5

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\equiv$	MODIFIED TABLE MEASUREMENT FORMAT	RLF	9/04
2			
3			
4			

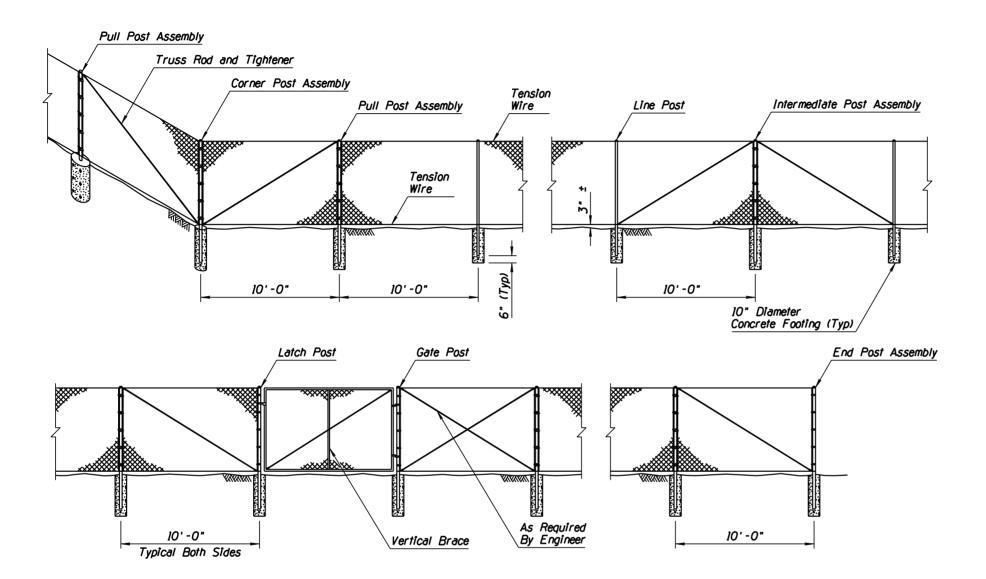

TYPICAL CHAIN LINK FENCE INSTALLATION - TYPE 1 SHOWN


1


			TYPI(	IMENSIO	NS						
Fabric	Cato Latoh		Corner, End, Intermediate, Gate, Latch and Pull Posts						Line Posts		
Height (In)	Length	Round	Roll For	med ( n)	Length	Round		Roll Formed			
1717	(Ft-In)	(OD) (In)	L	ם	(Ft-In)	(OD) (In)	H-Section (In)	□ (/n)			
36	6-0	2.375	3.50 x 3.50	2.25 x 1.70	5-6	1.900	1.875 x 1.625	1.875 x 1.625			
48	7-0	2.375	3.50 x 3.50	2.25 x 1.70	6-6	1.900	1.875 x 1.625	1.875 x 1.625			
60	8-0	2.375	3.50 x 3.50	2.25 x 1.70	7-6	1.900	1.875 x 1.625	1.875 x 1.625			
72	9-0	2.375	3.50 x 3.50	2.25 x 1.70	8-6	1.900	1.875 x 1.625	1.875 x 1.625			
Over 72	Height +3-0	2.875	3.50 x 3.50	2.50 x 2.50	Height +2-6	2.375	2.250 x 2.000	1.875 x 1.625			

- 1. Posts shall be round, H-section, or roll-formed and shall conform to the nominal dimensional requirements shown on the plans. Dimensional tolerances for all shapes shall be according to ASTM A500. In addition, the material of which posts are fabricated shall have a nominal thickness, before galvanizing, of not less than 0.111" for line posts and 0.130" for terminal posts.
- 2. Chain link fabric shall be either zinc-coated or aluminum-coated steel wire fence fabric. Zinc-coated steel fabric shall conform to the requirements of ASTM A392, Class I coating. Aluminum-coated steel fabric shall conform to the requirements of ASTM A491, with a minimum weight of coating of 0.40 ounce per square foot of wire surface area. Fabric shall be 11 gauge for all fence fabric 60" or less in height and shall be 9 gauge for fabrics greater than 60" in height.
- Tension wires shall be 7 gauge (0.177" diameter)
  coll spring steel wire with a minimum tensile strength
  of 75,000 PSI and shall be zinc-coated or aluminumcoated.
- 4. Truss rods shall be ¾ " diameter adjustable rods.
  Truss tighteners shall have a strap thickness of not less than ¼".
- 5. Stretcher bars shall be  $\frac{3}{6}$  "x  $\frac{3}{4}$ " steel flat bars. Stretcher bar bands shall be  $\frac{1}{6}$ "x 1" preformed steel bands.
- 6. Bottom tension wire shall be 3" from top of crown on concrete footings.
- 7. Intermediate post assemblies shall be spaced at 500' intervals or midway between pull posts when the distance between such posts is less than 1,000' and more than 500'.
- 8. See Sheet 3 of 3 for typical fence location.

APPROVED FOR DESIGN May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION  July Tournal	FENCE CHAIN LINK TYPE 1	_	NO. C-12.20 et 1 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED TABLE MEASUREMENT FORMAT	RLF	9/04
2	MODIFIED DIMENSION TE T	RLF	10/05
3	DELETED DIMENSION	RLF	10/05
4			

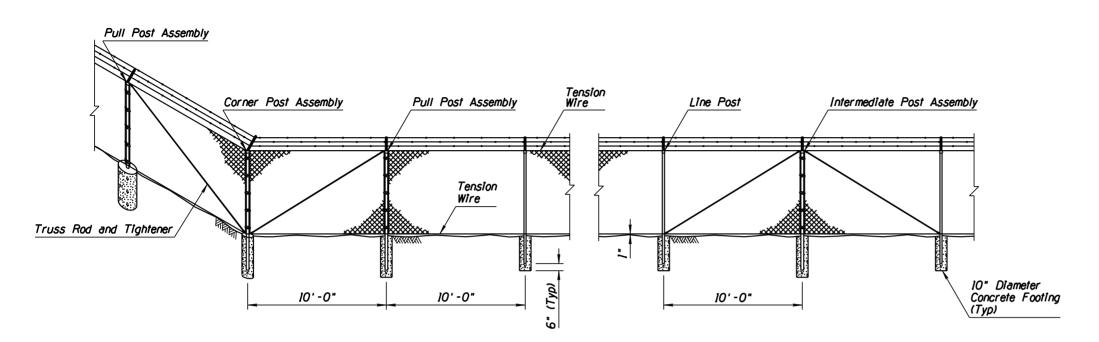

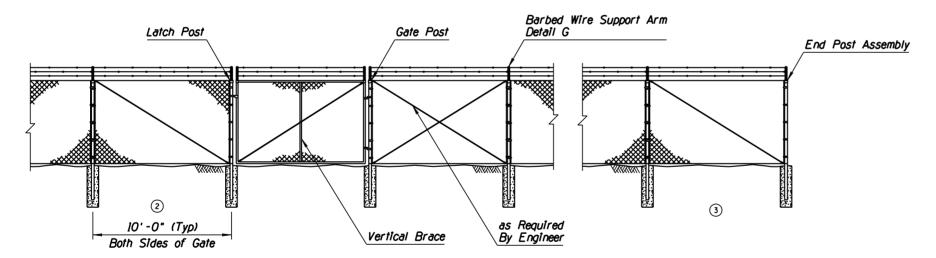


TYPICAL CHAIN LINK FENCE INSTALLATION - TYPE 2 SHOWN

1


	TYPICAL POST DIMENSIONS							
Fabric	Corner, End, Intermediate, Gate, Latch and Pull Posts			Line Posts				
Height (In)	Lengin	Round	Roll F	ormed	Length	Round	H-Section	Roll Formed
""	(Ft-In)	(OD) (In)	<b>∟</b> (/ሰ)	□ (/n)	(Ft-In)	(OD) (In)	(/n)	□ (/n)
72	8-6	2.375	3.50 x 3.50	2.50 x 2.50	8-0	1.900	1.875 x 1.625	1.875 x 1.625

- 1. Barbed wire for use with Type 2 chain link fence shall be 12 gauge steel wire with 4 point 14 gauge barbs spaced 5" apart and shall be either zinc-coated or aluminum-coated. inc-coated steel wire shall conform to the requirements of ASTM A121, Class 1 coating. Aluminum-coated steel wire shall conform to the requirements of ASTM 1585, Type 1, Class 1 coating.
- Barbed wire support arm shall be of the type shown on the plans, shall be fabricated from commercial quality steel, and shall be zinc-coated in accordance with the requirements of AASHTO MIII.
- Bottom tension wire shall just clear top of crown on concrete footings.
- 4. For details and notes not shown, see chain link fence, Type 1, Sheet 1 of 3.
- 5. See Sheet 3 of 3 for typical fence location.





DETAIL G BARBED WIRE SUPPORT ARM

APPROVED FOR DESIGN May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION  July Governor	FENCE CHAIN LINK TYPE 2	_	NO. 3-12.20 et 2 of 3

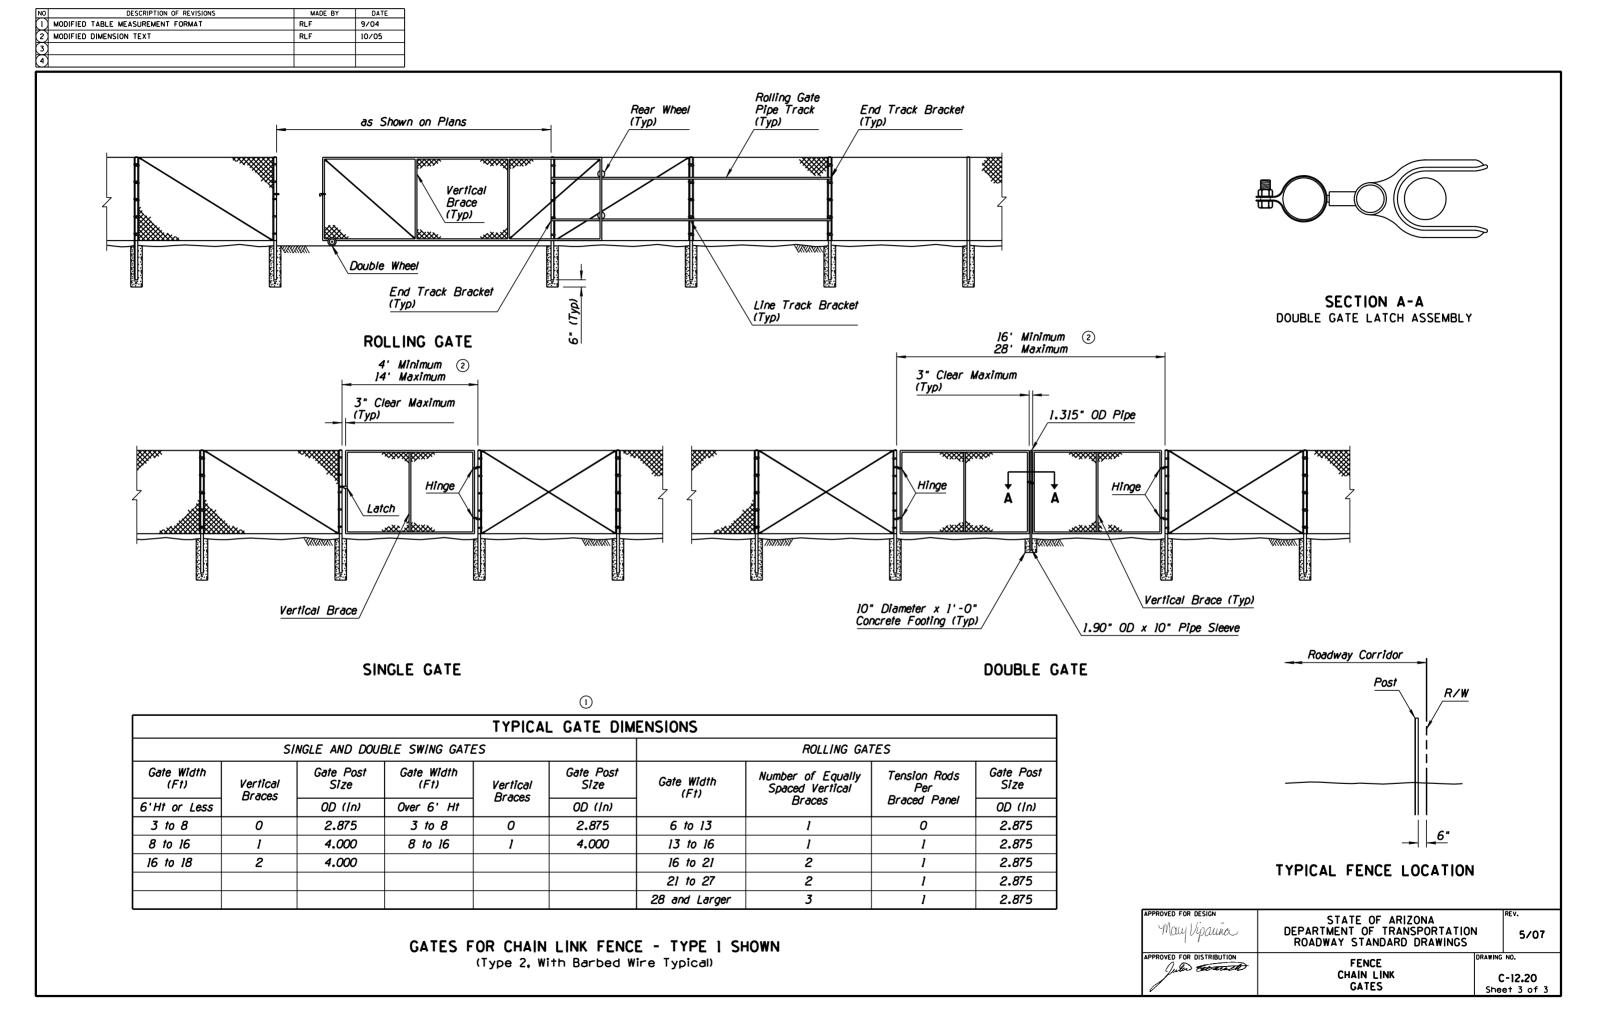

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED TITLE	RLF	9/04
2	REVISED SLOPE CRITERIA	RLF	9/04
3	MODIFIED DIMENSION TEXT	RLF	10/05
$\Gamma$	N		

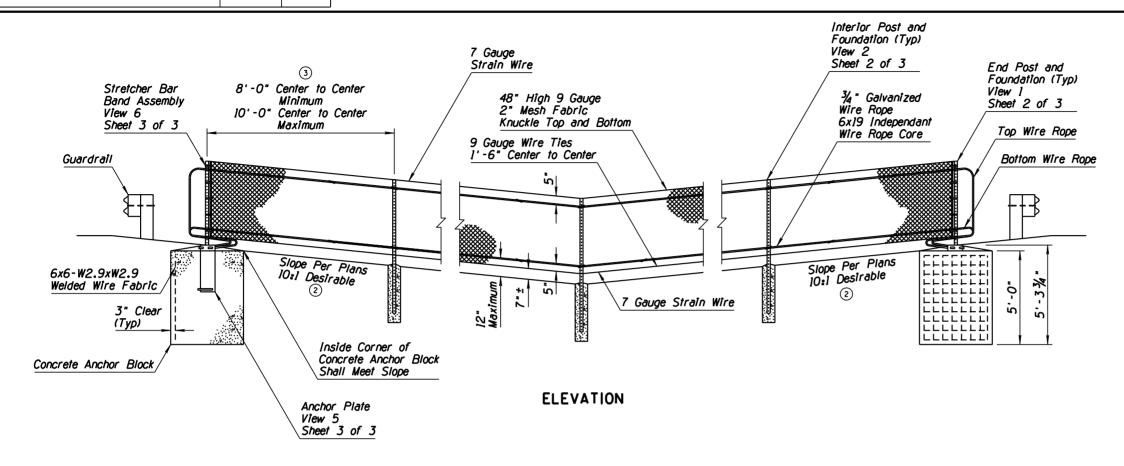

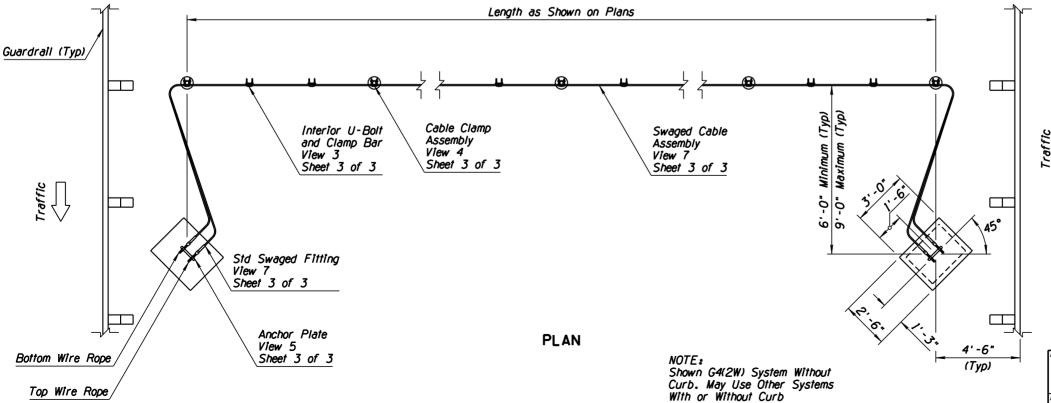

- 1. All concrete shall be Class S, f'c = 4000 PSI.
- 2. All bolts, nuts, washers and fittings shall meet the dimensional requirements of the American National Standards Institute, unless otherwise designated and shall be galvanized in accordance with ASTM A153.
- 3. Galvanized swaged fitting and U-Bolt shall conform to ASTM A449.
- 4. The 3/4" galvanized wire rope shall conform to AASHTO M30 Class B. Type 2.
- 5. The wire fabric, ties, bands, stretcher bars, and other fittings and hardware shall conform to AASHTO M181.
- 6. The wire fabric fence shall follow contour of the graded median.
- 7. The excavation for the concrete anchor blocks shall be to neat lines. Maximum excess shall be 3".
- 8. Perforated posts shall be square tube formed from 0.105" USS gauge ASTM A366/A366M cold rolled carbon steel. The square tubes shall be welded directly in the corner by high frequency resistance welding or equal. The posts to be externally scarfed to agree with standard corner radii of \(^1/32\) " \(^1/6\)".
- 9. Perforated posts shall be galvanized to the requirements of ASTM\_A653/A653M. Coating designator shall be Z275.
- 10. The cables shall have enough tension to prevent sagging. The location of the concrete anchor blocks may also be varied to provide enough tension to help prevent sagging.
- 11. Two interior U-bolt and clamp bars shall be spaced at  $\frac{1}{3}$  of the distance between posts.
- 12. See Standard Drawing C-12.20 for 48" fabric details.
- An alternate to rectangular concrete anchor block shall be a 36" diameter round footing with an additional depth of 4".
- 14. The median approach grade within 100' ± of the Chain Link Cable Barrier should not exceed a grade break of 10 percent.

ROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS Mary Vipauna 5/07 ROVED FOR DISTRIBUTION Outer Ferrack FENCE CHAIN LINK CABLE BARRIER

C-12.30 Sheet 1 of 3

NO DESCRIPTION OF REVISIONS MADE BY DATE  1) ADDED DESIGNATION RLF 9/04  2) REVISED TITLE RLF 9/04  3) 9/04			
₹ of Roadway  Traffic  Approach Slab  Interior U-Bolt	Wire Fabric	Stretcher Bar Band  Cable Clamp Assembly	- Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation  - When Shown on Plans
Shoulder  Chain Link Cable Barrier		Cable  Perforated Post  2" Square  13/4" Square  Ground Line	% "-16 UNCx3 ½" Hex Bolt (♠) and Hex Nut (♠) With Plain Round Washer (♠) and Regular Helical Spring Lock Washer (♠) Under Nut
Shoulder  Traffic	2/-2//2" 8//2"	2½" Square  2½" Square  2½" Square  2½" Square	2" Square  2" Square  134" Square
PLAN  55'-0" ± (50' Minimum) From Non-Traversable Slope  See Plans for Slope  Non-Traversable Slope		13/4" Square 0	30.
SECTION A-A TYPICAL INSTALLATION WITHOUT DIKE	و	<b>/</b>	
55'-0" ± (50' Minimum) From Non-Traversable Slope  Dike	Concrete Foundation	8" Diameter	B* Concrete Foundation
See Plans for Slope Slope Slope Slope Non-Traversable Slope	END POST	VIEW 1 AND FOUNDATION	VIEW 2 INTERIOR POST AND FOUNDATION  APPROVED FOR DESIGN  REV.
SECTION A-A TYPICAL INSTALLATION WITH DIKE			STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  APPROVED FOR DISTRIBUTION FENCE CHAIN LINK CABLE BARRIER  REV. 5/07  STOTE C-12.30 Sheet 2 of 3

	9/04
3	9/04
3)	
4)	


① ● - Indicates AASHTO, AGC & ARTBA Task Force 13 Report designation

STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS

FENCE CHAIN LINK CABLE BARRIER

5/07

C-12.30 Sheet 3 of 3

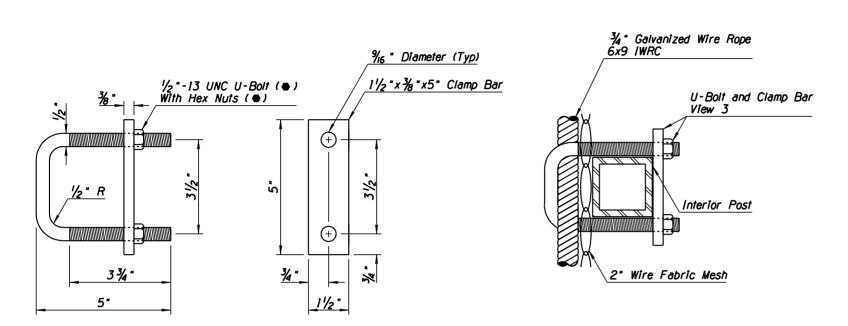

1 1/4 " Diameter (Typ) 11/4" Top of Concrete Anchor Block Slope to Drain إُنَّ 13% 11/4"x12"x2'-6" Plate 5**¾**" <sup>13</sup>/<sub>16</sub>" Diameter (Typ) 34"x12" Round Bar (ASTM A36) 12" 3 Each Plate

VIEW 3 U-BOLT AND CLAMP BAR


VIEW 4
CABLE CLAMP ASSEMBLY

VIEW 5 ANCHOR PLATE


PROVED FOR DESIGN

May Vipauna


PROVED FOR DISTRIBUTION July Estate

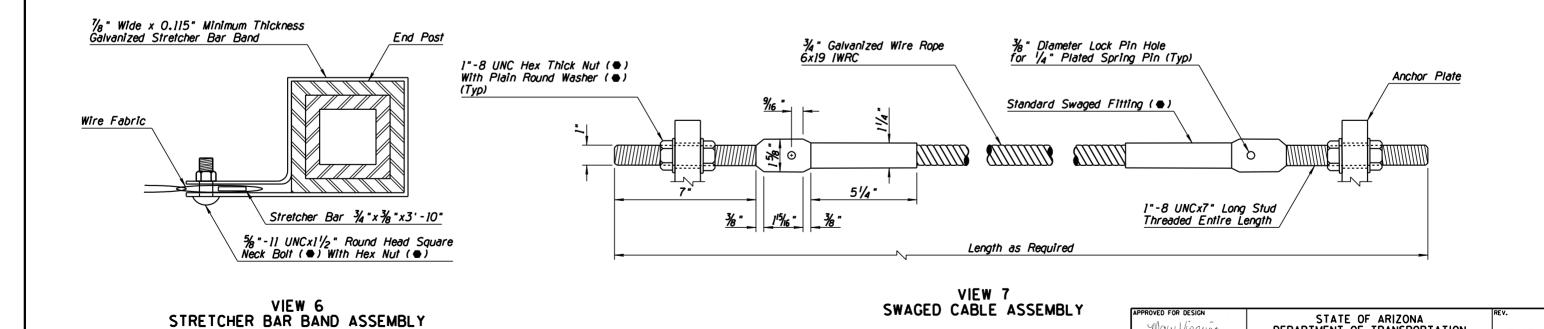


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REISSUED STANDARD DRAWING	RLF	7/05
2			
3			
4			

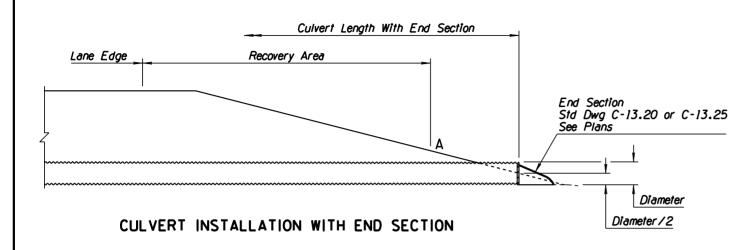


MINIMUM SPACING FOR MULTIPLE PIPES WITH HEADWALL				
Diameter or Span (In)	E (Ft-In)			
18	2-6			
24	3-0			
30	3-9			
36	4-6			
42	5-3			
48 to 66	OD + 3-0			
72 and Over	OD + 3-0			

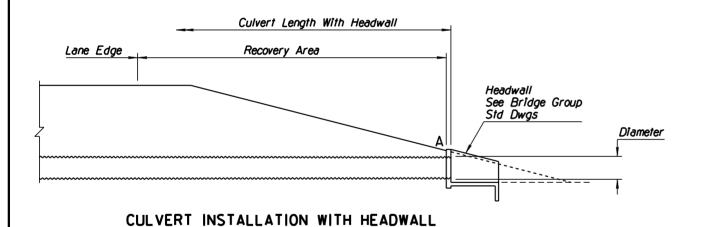



MINIMUM SPACING FOR MULTIPLE PIPES WITH HEADWALL

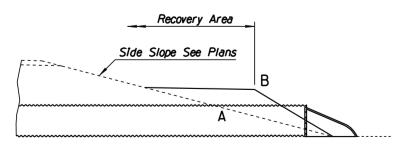







MINIMUM SPACING FOR MULTIPLE PIPES WITH END SECTIONS

- See plans for any required inlet and/or outlet protection.
- 2. E dimension applies to both non-trench and trench conditions.
- Minimum cover over pipe culverts shall be 1', measured from the top of pipe.
- 4. See Pipe Berm Requirement Detail for pipe berm requirements and Std Dwg C-03.10 for Installation. If Point A is within the recovery area, then a pipe berm is required and Point B is set at the edge of the recovery area.
- 5. Slope plating shall conform to Std Spec 501.



PLAN

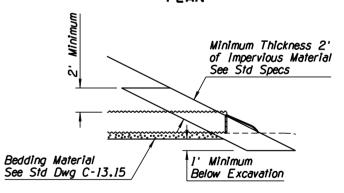


# **ELEVATION**


# SLOPE PLATING FOR PIPE WITH END SECTIONS

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATIO ROADWAY STANDARD DRAWINGS	N	FEV. (1)
APPROVED FOR DISTRIBUTION	PIPE CULVERT INSTALLATION		C-13.10


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	NEW GENERAL NOTE 2	RLF	9/04
2			
3			
4			

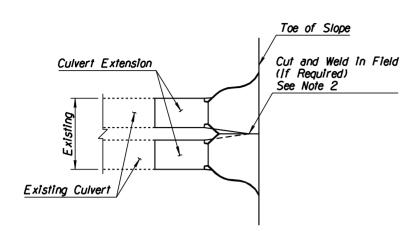


SPECIAL MULTIPLE PIPE END SECTION DETAIL FOR PIPE CULVERT EXTENSIONS ONLY

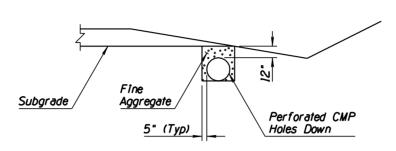


PERFORATED CMP INSTALLATION

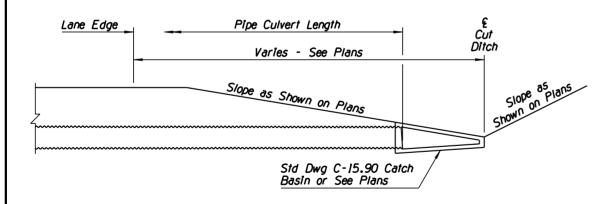

PIPE AND CATCH BASIN INSTALLATION AT SAG CONDITION OF CUT DITCH

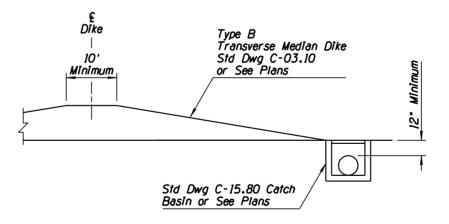

PIPE AND CATCH BASIN INSTALLATION AT BASE OF TRANSVERSE DIKE

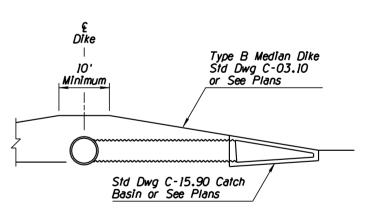


PIPE AND CATCH BASIN INSTALLATION AT FACE OF TRANSVERSE DIKE

May Vipauña	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	5/07
APPROVED FOR DISTRIBUTION  July Grand	PIPE CULVERT INSTALLATION	C-13.10

- Minimum cover over pipe culverts shall be 12", measured from the top of pipe.
- After welding, the damaged coating shall be cleaned by a wire brush and painted with at least one full coat of Paint Number 4, or given two coats of an approved hot asphalt paint, as directed by the Engineer.


		Pro Exi	posed Sub sting Grou	grade or nd Line
2) 3) 4)				
①	REVISED SPECIFICATIONS		RLF	9/04
NO	DESCRIPTION OF REVISIONS		MADE BY	DATE

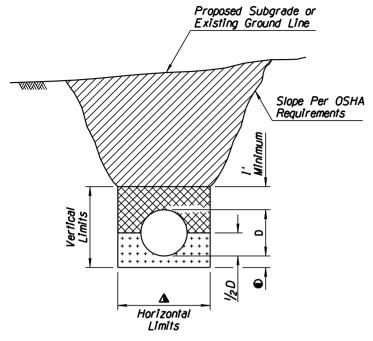

TRENCH CONDITION
IN NATURAL GROUND OR IN EMBANKMENT
WITHOUT BRACING

# Proposed Subgrade or Existing Ground Line Slope or Brace Per OSHA Requirements Horizontal Limits

TRENCH CONDITION
IN NATURAL GROUND OR IN EMBANKMENT
WITH BRACING SHOWN

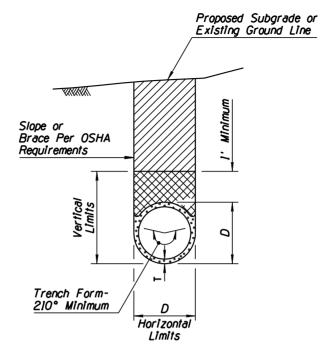

TRENCH CONDITION

NRCIPCP IN NATURAL GROUND

OR IN EMBANKMENT


## GENERAL NOTES

- Pipes shall be installed either in a trench condition or in a non-trench condition in natural ground or in embankment.
- In a trench condition, the vertical and horizontal limits shall be maintained. If horizontal limits are exceeded or the vertical limits are not maintained, a non-trench condition exists.
- Bracing and sloping shall conform to OSHA requirements.
- 4. Pipe backfill may be bedding material.
- 5. In a non-trench condition, the embankment for pipe stability shall be constructed in lifts to the limits shown in the detail simultaneously with the bedding material and pipe backfill. If the contractor chooses to construct it as a trench condition, the embankment shall be constructed before excavating the trench.
- D Outside diameter of full circle pipe or outside dimension (span or rise) of arch, arch pipe, elliptical pipe.
- T Minimum wall thickness for NRC/PCP: See Plans.
- ①  $\triangle$  For D < than 4': D + 6" each side, minimum D + 2' each side, maximum
- ) For D≥ than 4': D + 1' each side, minimum D + 3' each side, maximum
- - 6 inches except when on unyielding or unstable material. See Std Specs.

TRENCH BACKFILL

PIPE BACKFILL

BEDDING

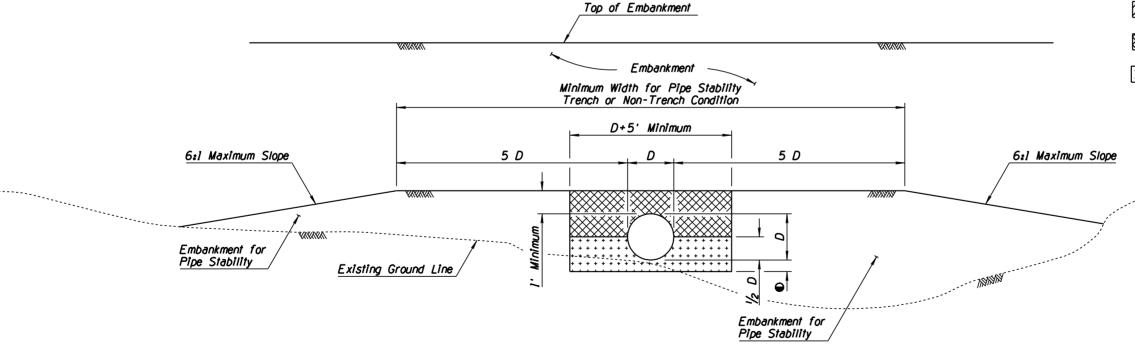

NON-TRENCH CONDITION

May Vipauia

PROVED FOR DISTRIBUTION

Julia Harrist

PROVED FOR DISTRIBUTION

Julia Harrist

TURNOLL PLOT

STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

N .

TYPICAL PIPE INSTALLATION

C-13.15


5/07


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	NEW GENERAL NOTE 1	RLF	9/04
(2)			
(3)			
4			

Pipe Diameter	Approximate		D	e	o (I	)		Approximato
( n)	Weight (Lbs)	T	Α	В	С	Ε	F	Approximate Slope
24	1520	3	91/2	431/2	30	731/2	48	3
27	1930	31/4	101/2	491/2	24	731/2	54	3
30	2190	31/2	12	54	19	73	60	3
36	4100	4	15	63	34	97	72	3
42	5380	41/2	21	63	35	98	78	3


Embankment Slope

- 1. End section joint type shall match the pipe joint type.
  - 2. Embankment slope shall be warped to match slope of end section.

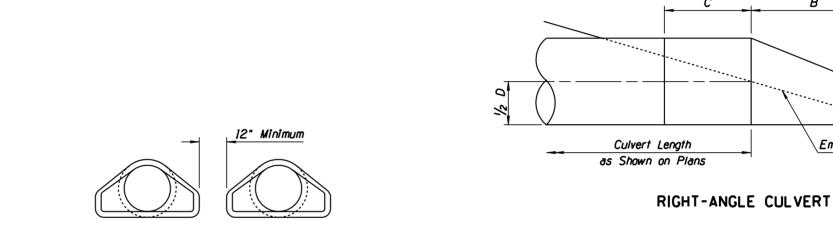


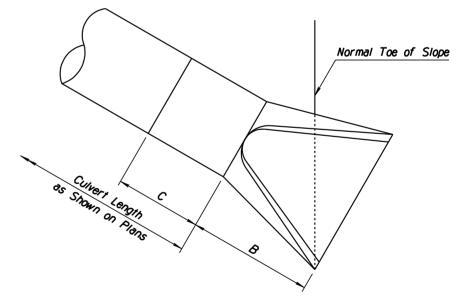


	as Shown on Plans B
FRONT ELEVATION	SKEWED CULVERT  APPROVED FOR DESIGN STATE OF ARIZONA REV.

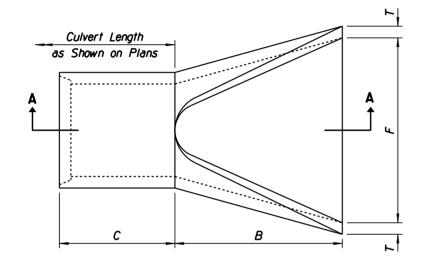

PLAN

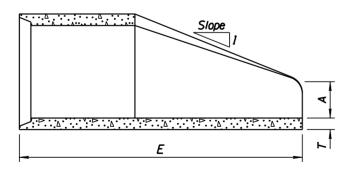


SECTION A-A

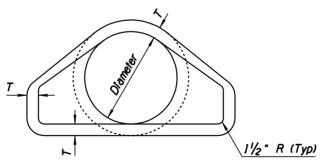


SPACING FOR MULTIPLE INSTALLATION

STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS May Vipaura 5/07 PPROVED FOR DISTRIBUTION PIPE REINFORCED CONCRETE END SECTION C-13.20

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED DATA TABLE	BAF	6/98
2	REMOVED 'TYPE 5' REFERENCE	RLF	7/06
(3)			
4			

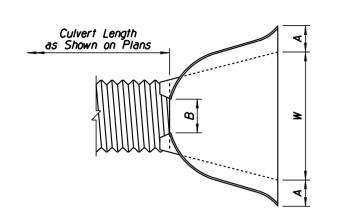

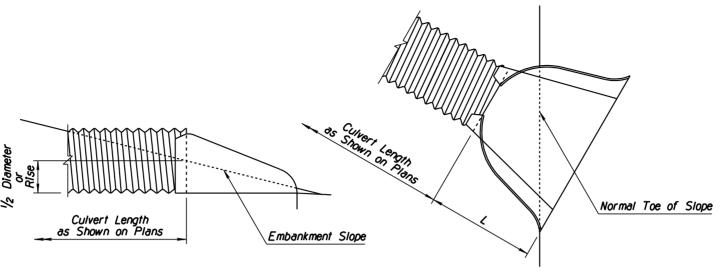

RIGHT ANGLE CULVERT

SKEWED CULVERT

- The end section may be joined to the pipe or connector section by bolts, rivets, dimpled bands, slip-seam bands or threaded rod type fasteners. For allowable connector types, see table.
- 2. The Type I connector is bolted or riveted.

  Maximum circumferential fastener spacing shall be
  12" and with a minimum of 8 fasteners per joint. The
  Type I joint may be used with either annular or helical corrugations.
- 3. Type 2 and 3 connectors shall only be used with annular or helical pipe with a requisite number of annular corrugations.
- 2 4. Type 4 connector shall only be used with helical pipe.
  - 5. All steel end section components shall be galvanized.
  - 6. Toe of embankment shall be warped to match toe of skewed end section.
  - 7. A berm shall be added to abnormal projections per Std Dwg C-13.10.

±11/2

31

41 51

60

69

8. The foregoing applies to all cross-section configurations.

±2

36

48

57

72

84

Connection

Туре

2, 3, 4

2, 3, 4

2, 4

2, 4

3

Approximate

Slope


21/2


21/2

21/2


21/2

21/2






TYPE 2 THREADED ROD CONNECTIONS



SPACING FOR MULTIPLE INSTALLATION



141/2

17

12

14

12

36

42


1

9


101/2

1

	Pine Arc	·h	C	)imen	sions	(ln)			
l '	Pipe Arch			В	н	L	w	Approximate	Connection
Span ( n)	Rise (In)	Gauge	±1	Max	±1	±11/2	±2	Slope	Туре
21	15	16	71/2	11	6	24	36	21/2	2. 3. 4
28	20	16	8	16	6	32	48	21/2	2. 3. 4
35	24	14	10	16	6	39	60	21/2	2, 4
42	29	14	12	12	71/2	46	75	21/2	2. 4
49	33	12	131/2	20	9	53	84	21/2	3

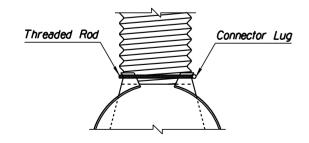


TYPE 3 THREADED ROD CONNECTIONS




TYPE 4 DIMPLED BAND CONNECTIONS

ROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS May Vipauna 5/07 PROVED FOR DISTRIBUTION Jules Estracto C-13.25 CORRUGATED METAL END SECTION


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	DELETED GENERAL NOTE 7	RLF	9/04
2			
(3)			
(4)			

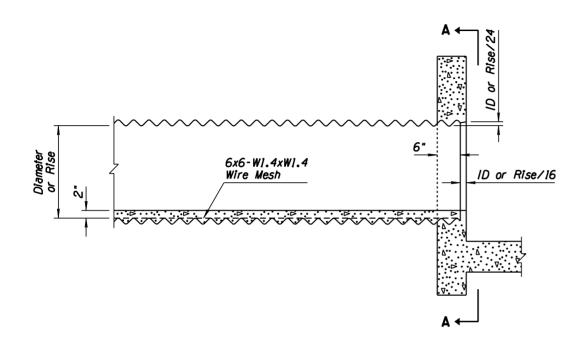


HEADWALL INSTALLATION (SEE STANDARD DRAWING B-11.12)

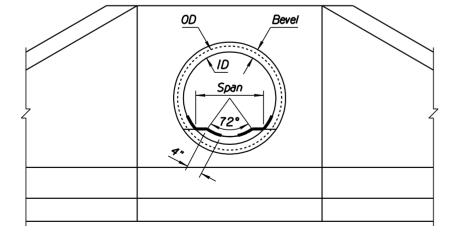

SECTION A-A



PROJECTING INSTALLATION




SECTION B-B


- For lateral dimensions of invert paving, use 72° control for CMP and span for CMPA.
- 2. Paving shall be scored laterally at 1'-6" minimum intervals along the length of the pipe.
- 3. Use bevel on inlet headwall only.
- 4. Wire mesh shall be fastened or welded to corrugation crests at intervals and in a manner approved by the Engineer. Laps shall be 6" minimum.
- 5. Paving shall not be placed until backfilling is completed.
- 6. Concrete shall be Class B.

1


May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	N	FEV. 5/07
APPROVED FOR DISTRIBUTION	PIPE AND PIPE ARCH CORRUGATED METAL CONCRETE INVERT PAVING	DRAWING	NO. C-13.30


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	MODIFIED TABLE & MEASUREMENT FORMAT	RLF	9/04
2	REVISED WIRE MESH DESIGNATION	RLF	9/04
3			
(4)			

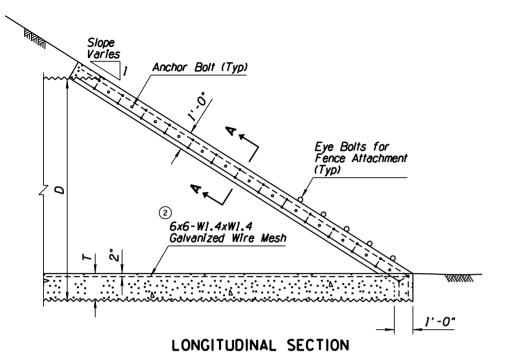

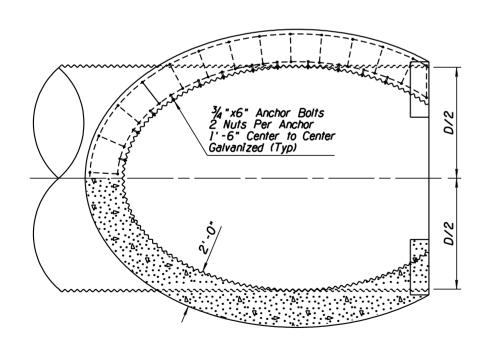


PLAN NORMAL TO SLOPE



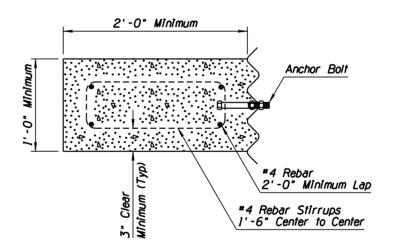



SECTION A-A

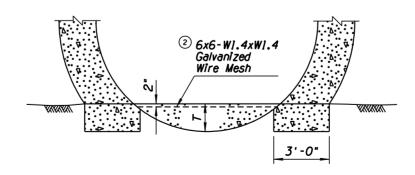

**END ELEVATION** 


- 1. This end treatment is to be used only for those cattle and/or vehicle passes not used for drainage.
- 2. All concrete shall be Class B. An optional 12" AB invert paving base course and 6" of concrete may be used in the 144" diameter pipe.
- Anchor bolts shall be retained in a horizontal position during pour with final tightening a minimum of 7 days after pour.
- 4. Pipe shall be backfilled before concrete bond beam is constructed. Minimum forming may be used.
- Edges of wire mesh shall be fastened or welded to corrugation crests at intervals and in a manner approved by the Engineer. Laps shall be a minimum of 6".
- 6. For installation normal to roadway centerline only.



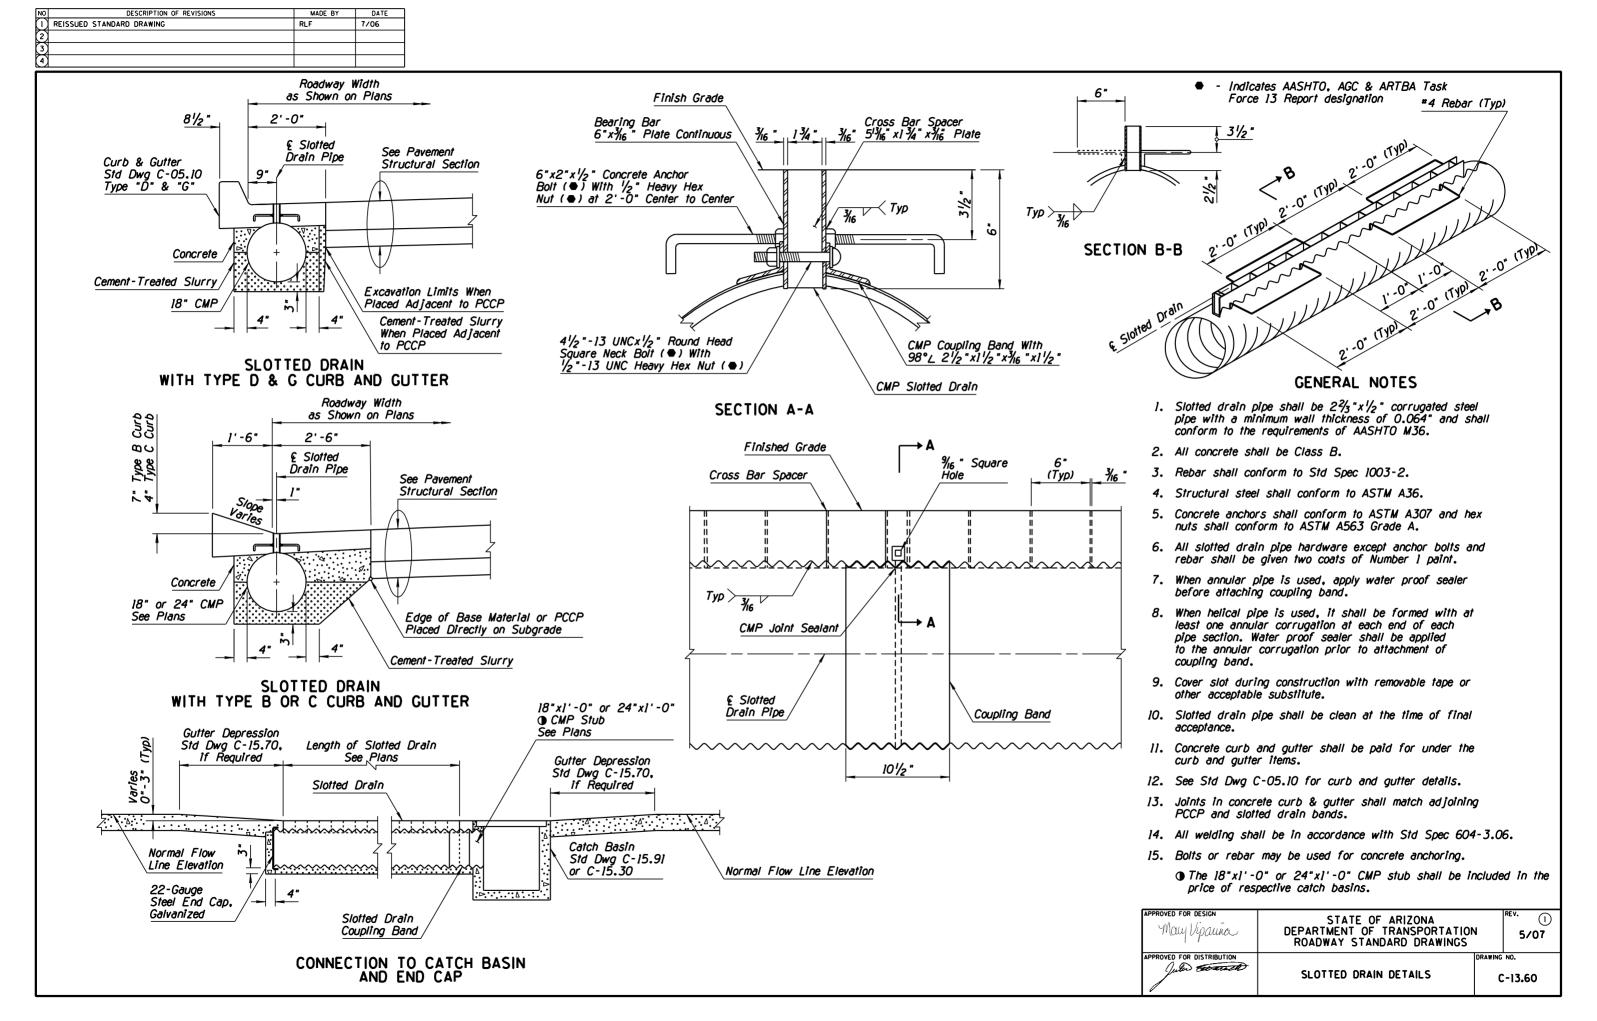


NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REVISED CATCH BASIN REFERENCE RLF 9/04  2 3 4	
Main Drainage	Main Drainage
Trunk Line Gutter  £ Line  8'-0" Minimum   Roadway Width	Trunk Line Gutter I. Pipe collars are not required where direct catch  Line basin connections can be made within 7° of a normal  8'-0" Minimum Roadway Width 90° installation, either horizontally or vertically.
Catch Basin With Frame and Grate Std Dwg C-15.91	2. "T" connections direct to the main drainage trunk line should be avoided and used only where manhole connections are impractical.  Catch Basin With Frame and Grate
SECTION A-A TYPICAL CONNECTION BETWEEN CATCH BASIN AND MANHOLE	SECTION C-C  Std Dwg C-15.91  TYPICAL CONNECTION BETWEEN CATCH BASIN AND MAIN STORM DRAIN
Pipe Cross Connection	ZEOII II
SECTION B-B	SECTION D-D
	Main Storm Drain Pipe Diameter See Plans
B A Roadway Median Roadway Super Drain Pipe Diameter  Main Storm Drain Pipe Diameter  Median Catch Basin With Apron	Roadway  E  Concrete Pipe Collar Std Dwg C-13.80  PIAN  PROVED FOR DESIGN  STATE OF ARIZONA  PEROVED FOR DESIGN  DEPARTMENT OF TRANSPORTATION  REV.  PORTUGINA  PEROVED FOR DESIGN  DEPARTMENT OF TRANSPORTATION  REV.  PORTUGINA  PORT
Pipe Diameter See Plans PLAN TYPICAL SLOTTED DRAIN AND CATCH BASIN INSTALLATION WITH MANHOLE	PLAN TYPICAL SLOTTED DRAIN AND CATCH BASIN INSTALLATION WITHOUT MANHOLE  PLAN TYPICAL SLOTTED DRAIN AND CATCH BASIN INSTALLATION WITHOUT MANHOLE  APPROVED FOR DESIGN May Vipauia  APPROVED FOR DESIGN May Vipauia  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  PROVED FOR DESIGN MAY VIPAUIA  SLOTTED DRAIN INSTALLATION DETAILS  C-13.65


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REARRANGED STD DWG	PNB	7/94
2			
(3)			
(4)			

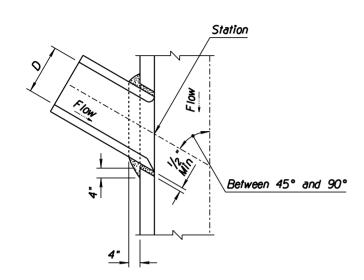


SECTION A-A

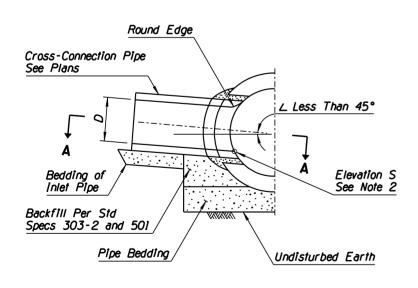

SIDE INLET

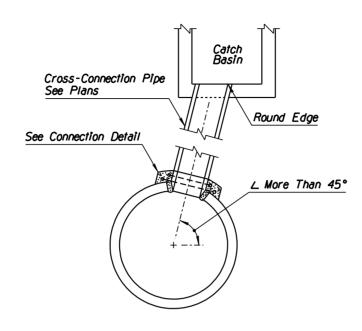


CATCH BASIN ABOVE STORM DRAIN TYPE 2

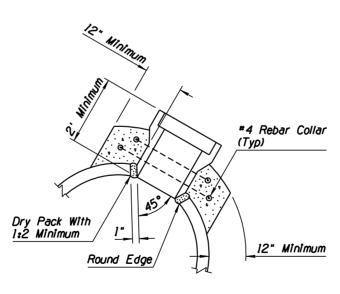


CONNECTION DETAIL TYPE 2

- 1. Prefabricated tees shall be used when the outside diameter of the inlet pipe exceeds one half of the inside diameter of the main storm drain, except when the manholes are shown on plans.
- Centerline of the inlet pipe shall intersect the centerline of the main storm drain except when elevation "S" is shown on plans.
- 3. If  $\angle$  is 45° or less, Type 1 connection shall be used.
- 4. All concrete shall be Class B.
- 5. All rebar shall conform to Std Specs 1003-1 & 2.
- 6. Rebar shall have 2" minimum cover.




NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	RENAMED STANDARD	RLF	9/04
2	MODIFIED TABLE MEASUREMENT FORMAT	RLF	9/04
3	MODIFIED STEEL QUANTITIES	RLF	9/04
4			

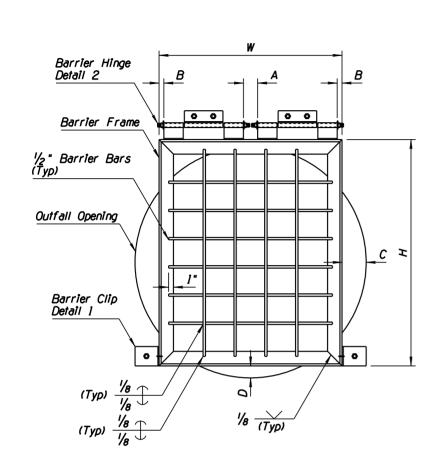




3 x3 x1/16 5 x3 x1/4

96



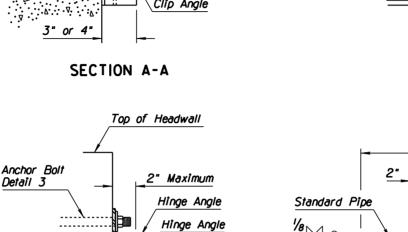

**1/8**↓

Barrier Bar

Barrier Frame Angle

97

13-39 \*

43


3

4.5


5

580

SECTION B-B

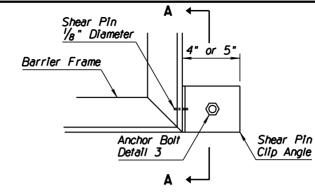


DETAIL 1

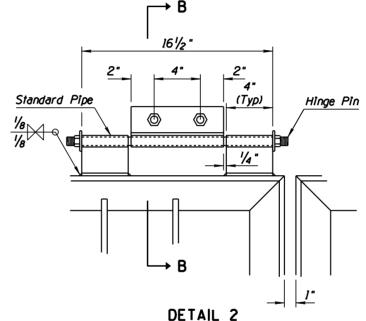


### GENERAL NOTES

- All shear pin angles shall fit snug and true to face. Cover with waterproof grease prior to installation of pin.
- 2. Shear pin holes in the angle shall be drilled for a tight fit of the pins.
- 3. Both ends of the shear pins shall be peened after installation.
- Shear pin material shall be commercially pure aluminum wire alloy 1100, Temper O, Federal Spec OO-A411.
- 5. Galvanize all ferrous parts after fabrication.
- 6. Frame and hinge angles shall have the outstanding leas out.
- 7. All steel shall be in accordance with ASTM A36.
- 8. Barrier bars shall be equally spaced.
- Hinge pin material shall be bolt stock and threaded on both ends so nut and lock washer are flush with the lower angle. Cover pin with waterproof grease prior to installation. Upset or damage exposed threads after installation.
- 10. All welding shall be in accordance with Std Spec 604-3.06.

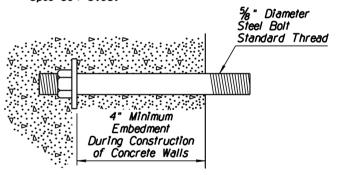

DETAIL 3




\* Per Grate

# INSTAL FOR D

INSTALLATION DETAIL FOR DOUBLE GATES

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATIO ROADWAY STANDARD DRAWINGS	ON	FEV. 5/07
APPROVED FOR DISTRIBUTION	STORM DRAIN ① OUTLET BARRIER GATE	DRAWING C-	NO. (1)

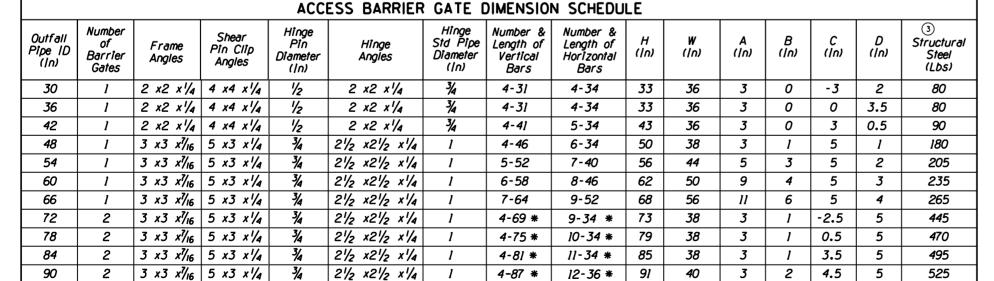


5-93 \*

21/2 x21/2 x1/4


2

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
	RENAMED STANDARD FROM C-13.75, SHEET 2	RLF	9/04
(2)			
(3)			

- Compact soil at end of pipe plug to 95% of maximum density.
- 2. If depth of cover is less than 5' or greater than 10', increase plug thickness a minimum of 4".

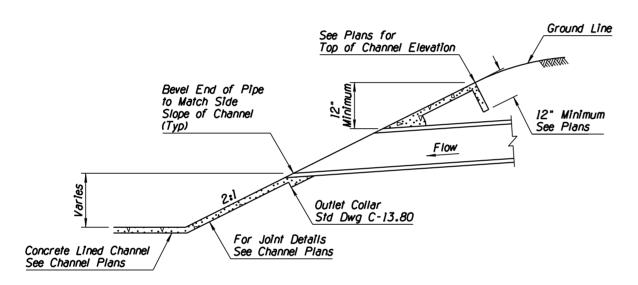

DRAINAGE OUTLET INTO CHANNEL

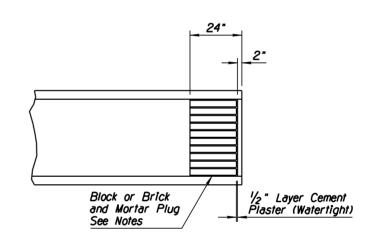


STORM DRAIN PLUG

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	N 5/07
APPROVED FOR DISTRIBUTION	STORM DRAIN OUTLET ① AND STORM DRAIN PLUG	C-13.76

N0	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	MODIFIED TABLE VALUES	RLF	9/04
2	MODIFIED GENERAL NOTE 2	RLF	9/04
3	ADDED CALLOUT	RLF	9/04
$\mathbf{A}$			

CONCRETE PIPE COLLAR

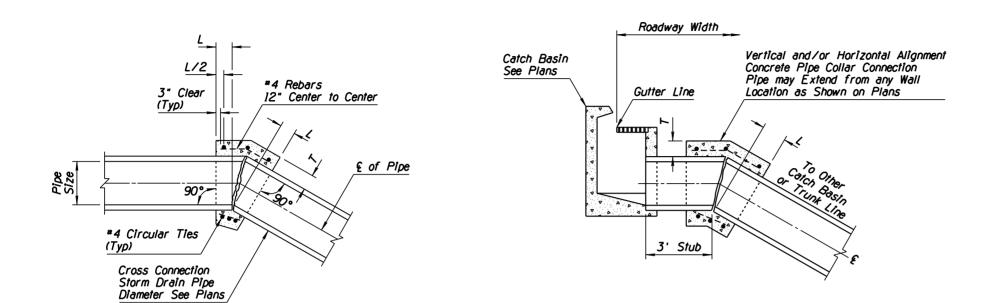


TYPICAL LATERAL CONNECTIONS TO CATCH BASINS WITH CONCRETE COLLARS

# **GENERAL NOTES**

- 1. All concrete shall be Class B.
- 2. All rebar shall conform to Std Spec 1003-1.2.
  - 3. All rebar shall have 3" minimum clear cover.
  - 4. A concrete collar shall be required where pipes of different diameters or materials are joined or where the design change in alignment or grade exceeds that allowed for a standard joint.
  - 5. When pipes of different diameters are joined with a concrete collar, "L" & "T" shall be those of the larger diameter.
  - 6. The diameter of the circular ties shall be the outside diameter of pipe + T.
  - 7. Pipe ends to be trimmed such that the maximum distance between pipes at any point is 2".

1

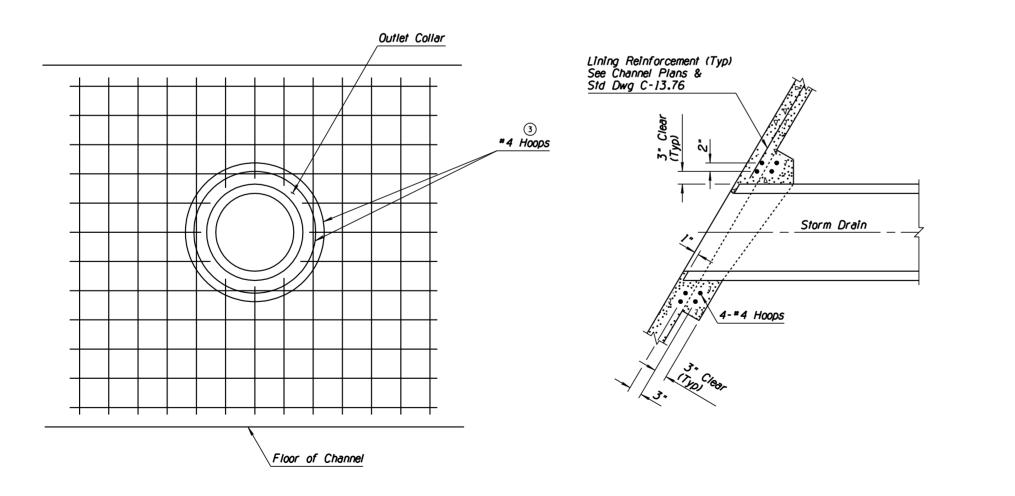


**OUTLET COLLAR DETAIL** 

PIPE COLLAR TABLE				
Pipe Size ( n)	L (Ft-In)	T (In)	#4 Ties	
12	1-0	4	3	
18	1-0	5	3	
24	1-0	6	3	
30	1-6	8	3	
36	1-6	8	3	
42	1-9	10	4	
48	1-9	10	4	
52	1-9	10	4	
60	1-9	11	4	
66	2-0	11	5	
72	2-0	14	5	
78	2-0	14	5	
84	2-3	16	5	
96	2-3	16	5	

May Vipaura	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
ROVED FOR DISTRIBUTION		DRAWING	NO.
July toward	PIPE COLLAR DETAILS		-13.80

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 REVISED NOTE * 5 RLF 7/O1  2 REMOVED UNIT OF MEASURE FROM WELD SPECIFICATION RLF 4/O6  3 4				
Gutter Control Grade  PLAN - CATCH BASIN TYPE 1 - SINGLE	See Catch Basin Type 1-Sin Section A-A for Rebar Details	3'-2¾"  Basin Type  6'-5½"	Curb and Gutter  Gutter Control Grade	GENERAL NOTES  1. Catch basin used at roadway sag.  2. Pipes can be placed in any wall.  3. Sump floor shall be a wood troweled finish with a minimum 4:1 slope in all directions to outlet.  4. All rebar shall be ASTM A36.  1. S. All welding shall be in accordance with Std Spec 604-3.06.  6. Grate, frame, beam and nose plate shall be given one shop coat of Number 1 paint.  7. All concrete shall be Class B.  8. Construction joints and drains shall be placed to meet field conditions. See Std Dwg C-15.70.  9. Any specified inlet depression shall be warped to opening according to Std Dwg C-15.70.  10. Silicone sealant shall be placed between the grate frame and PCCP, recessed 1/4" from the pavement surface.  11. Curb opening areas, sq ft, for Type 1-single and Type 1-double equal 0.25 and 0.54, respectively, for each inch of "h" + inlet depression - 2.35". See Std Dwg C-15.70.  12. See Std Dwg C-15.50 for grate and frame details and grate opening areas.
"3 Rebars 6" Center to Center 2" Clear to Top of Nose and Inside of Wall See Detail 3  Nose Plate and Anchor See Detail 1  Normal 2½" Gutter Slope 2'-0"  Inlet Depression See Plans  Construction Joint (Typ)  Grate Support for Catch Basin Type 1-Double Only See Detail 2  "4 Rebars 18" Center to Center Horizontal and Vertical 2" Clear of Bottom	6" 2"  7/6"  Nos 8" Len  8"	se Plate	Tame Grate  //2" Stove Bolt 2 Per Frame, Avoid Conflict With Grate  W 5x18.5 or W 5x19 Length = 33 3/4"  DETAIL 2	13. ① t = 6" when H is 8' or less 8" when H is greater than 8' See Section B-B  = 9" when pavement is AC Match pavement thickness when pavement is PCCP
Construction Joint (Typ)  SECTION A-A	SECTION B-B USE THIS SECTION WHEN +=8-	DETAIL 1	APF	PROVED FOR DESIGN  STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  PROVED FOR DISTRIBUTION CATCH BASIN TYPE 1  C-15.10

CATCH BASIN TYPE 1

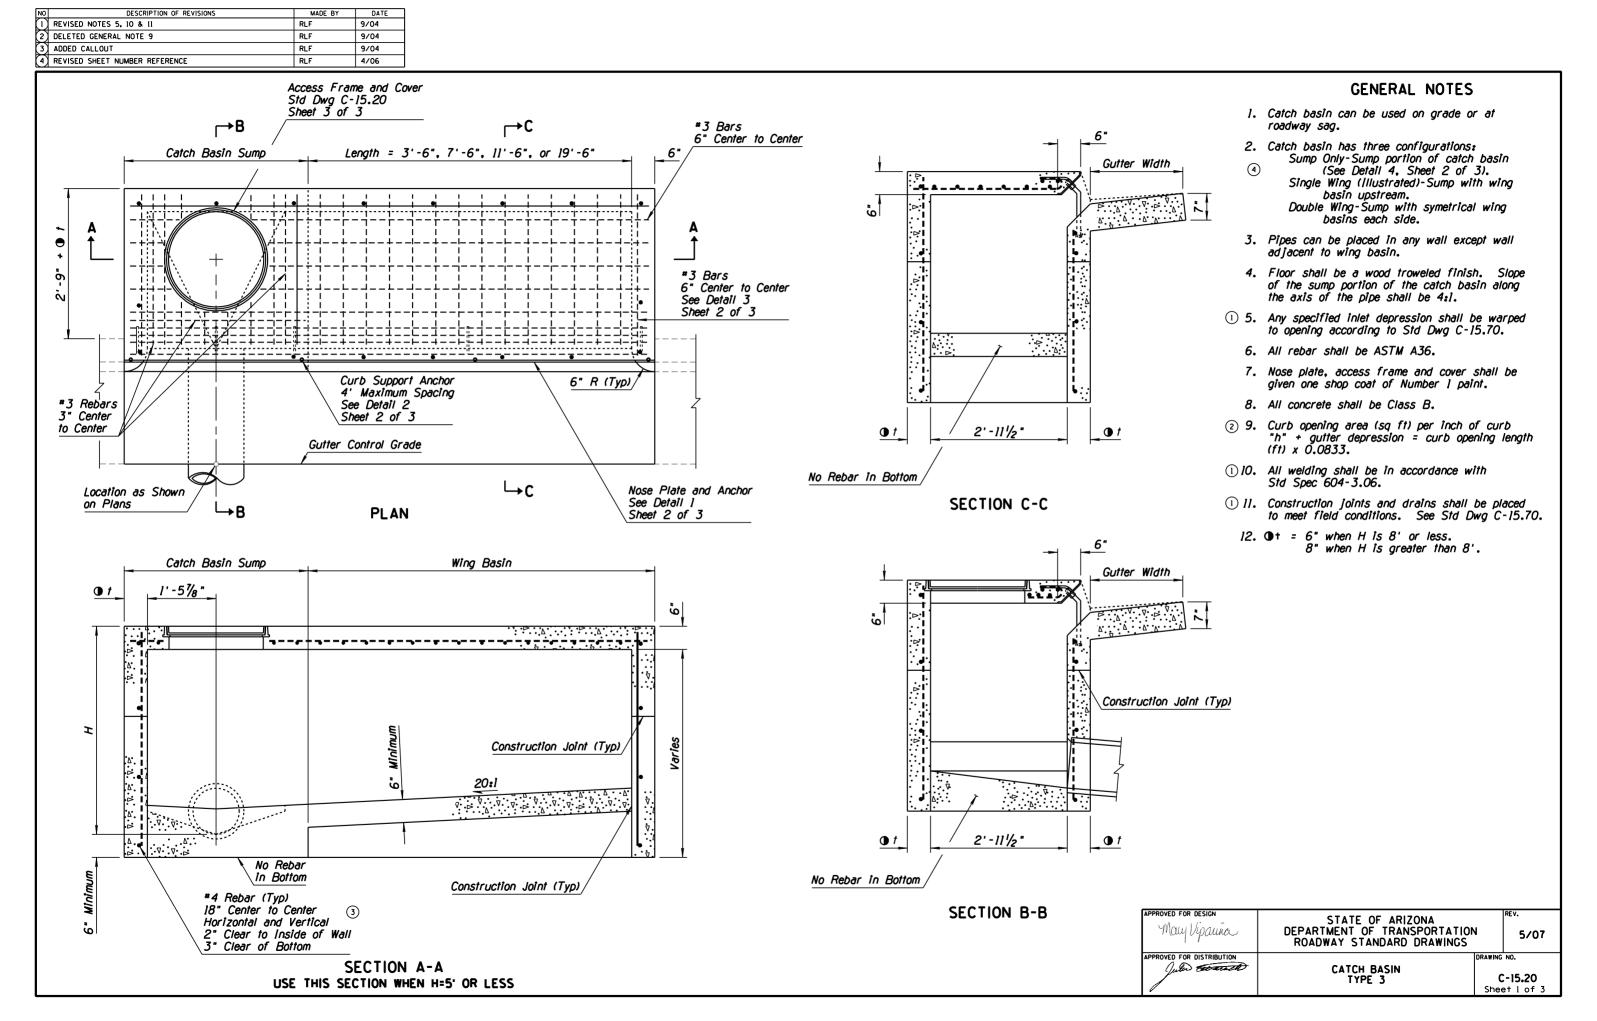

NO DESCRIPTION OF REVISIONS MADE BY DATE  (1) REVISED SHEET NUMBER REFERENCE RLF 5/07  (2)		
Catch Basin Sump Length = 3'-6", 7'-6", 11'-6", or 19'-6"	Nose Plate 8"x¾6" Bent Plate Length: 2'-11¾" + 2 • t + (L + 6")	GENERAL NOTES  1. See Sheet I of 3 for other dimensions, notes and rebar.  2. • t = 6" when H is 8' or less 8" when H is greater than 8'
	Anchor #4 Rebar 6" Center to Center  #3 Rebar 6" Center to Center See Detail 3	#3 Rebar  3'-21/2"  DETAIL 3
Curb Support Anchor 4' Maximum Anchor Spacing See Detail 2  PLAN	DETAIL I	Catch Basin Sump  2'-11¾"  1 t
Catch Basin Sump  Wing Basin  V: V	Normal Gutter Slope	
Note: Rebars Shown Are For Floor Of Wing And Wall Only See Sections On Sheet 1 of 3 for Other Reinforcing	The series of th	
No Rebar in Botttom  Construction Joint (Typ)	<b>*4</b> Rebar	DETAIL 4
SECTION A-A  USE THIS SECTION WHEN H IS GREATER THAN 5'	DETAIL 2 CURB SUPPORT ANCHOR	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS  FOR DISTRIBUTION CATCH BASIN TYPE 3  C-15.20 Sheet 2 of 3

RENAMED STANDARD FROM C-15.65 TO C-15.20, SHEET 3 OF 3 RLF 9/04	W. Diameter Lifting Hole  B  B
PLAN	PLAN
27"  26"  26"  24"  28"	25¾"  24¾"  Concrete Filler  25½"  25½"

SECTION A-A FRAME

# GENERAL NOTES

- Cover shall be non-locking.
- 2. Frame and cover shall be cast iron or structural steel.
- Catch basin access frame and cover is for use in sidewalk area only.
- 4. Cover shall be filled with concrete and broom finished.

SECTION B-B COVER


APPROVED FOR DESIGN
STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS

APPROVED FOR DISTRIBUTION
CATCH BASIN
ACCESS FRAME AND COVER DETAILS


C-15.20
Sheet 3 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED STANDARD FOR NEW FRAME	PNB	5/97
2			
(3)			
$\overline{A}$			

#### Dimensions are Common to Catch Basin Type 4-Single Except as Shown

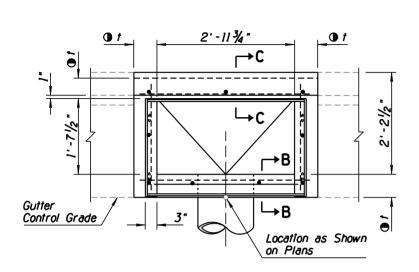


PLAN - CATCH BASIN TYPE 4 - SINGLE

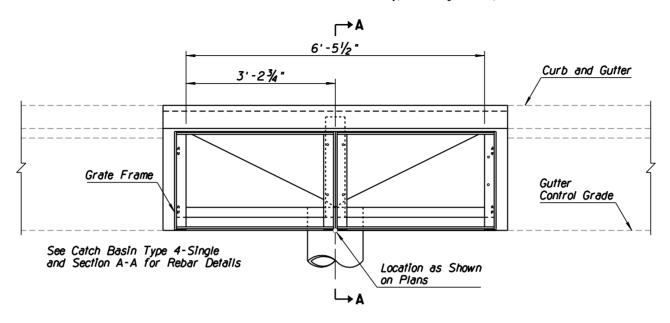


PLAN - CATCH BASIN TYPE 4 - DOUBLE

SECTION C-C

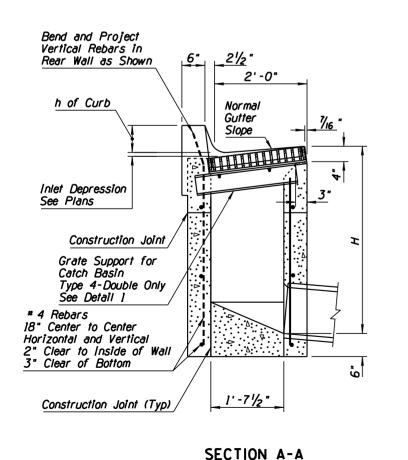

USE THIS SECTION WHEN +=8"


SECTION B-B




DETAIL FOR WIDE GUTTER (SEE STD DWG C-05.10)


ROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION
ROADWAY STANDARD DRAWINGS Mary Vipauna 5/07 PROVED FOR DISTRIBUTION Outer Ferrack CATCH BASIN TYPE 4 C-15.30

- 1. Catch basin can be used on grade or at roadway sag.
- 2. Pipes can be placed in any wall.
- 3. Floor shall be a wood troweled finish with a minimum 4:1 slope along the axis of the pipe toward the pipe.
- 4. Curb over catch basin shall not be constructed untill catch basin concrete has set for a minimum of 24 hours.
- 5. Catch basin can be used with curb and gutter (as shown)
- 6. See Std Dwg C-15.50 for grate and frame details and opening areas.
- 7. Any specified inlet depression shall be warped to opening according to Std Dwg C-15.70.
- 8. All rebar shall be ASTM A36.
- 9. Grate, frame and beam shall be given one shop coat of Number 1 paint.
- 10. All concrete shall be Class B.
- 11. Construction joints and drains shall be placed to meet field conditions. See Std Dwg C-15.70.
- 12. Silicone sealant shall be placed between the grate frame and PCCP, recessed 1/4" from the pavement surface.
- 13. See Detail 2 for catch basin with wide gutter.
- 14. ① † = 6" when H is 8' or less. 8" when H is greater than 8'. See Section B-B.
  - 9" when pavement is AC. Match pavement thickness when pavement is PCCP.

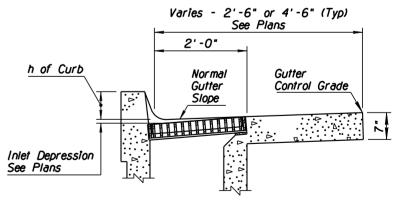

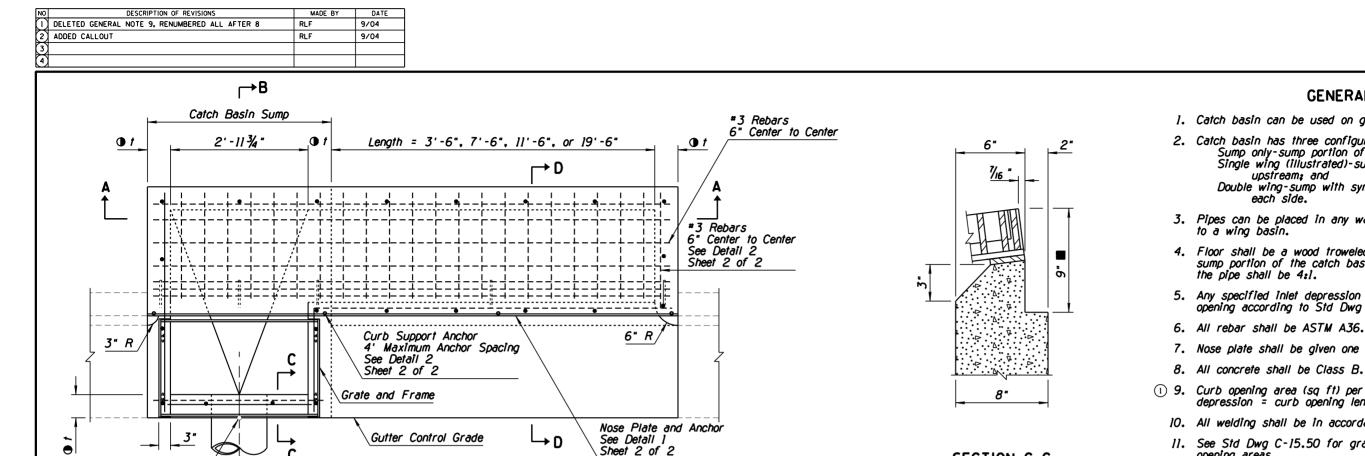

# SECTION C-C **USE THIS SECTION** WHEN +=8"

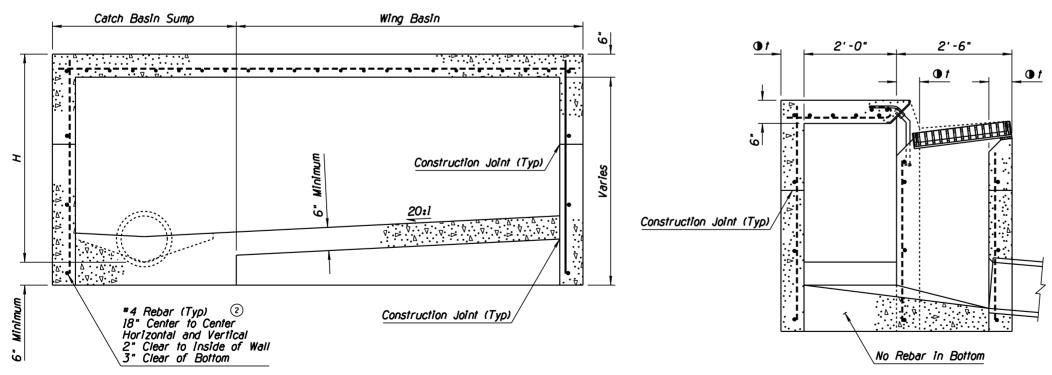

**PLAN** 

USE THIS SECTION WHEN H=5' OR LESS

Location as Shown


on Plans

SECTION B-B

# **GENERAL NOTES**


- 1. Catch basin can be used on grade or at roadway sag.
- 2. Catch basin has three configurations: Sump only-sump portion of catch basin; Single wing (illustrated)-sump with wing basin Double wing-sump with symmetrical wing basins
- 3. Pipes can be placed in any wall except wall adjacent
- 4. Floor shall be a wood troweled finish. Slope of the sump portion of the catch basin along the axis of
- 5. Any specified inlet depression shall be warped to opening according to Std Dwg C-15.70.
- 7. Nose plate shall be given one shop coat of Number 1 paint.
- (1) 9. Curb opening area (sq ft) per inch of curb "h" + inlet depression = curb opening length (ft) x = 0.0833.
  - 10. All welding shall be in accordance with Std Spec 604-3.06.
  - 11. See Std Dwg C-15.50 for grate and frame details and opening areas.
  - 12. Construction joints and drains shall be placed to meet field conditions. See Std Dwg C-15.70.
- 13. Silicone sealant shall be placed between the grate frame and PCCP, recessed 1/4" from the pavement surface.
- 6" when H is 8' or less. 14. • t = 8" when H is greater than 8'. See Section C-C.
- 15. = 9" when pavement is AC.

  Match pavement thickness when pavement is PCCP.

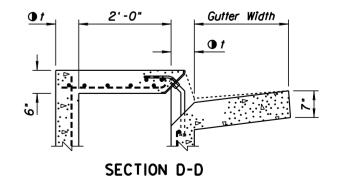

ROVED FOR DESIGN STATE OF ARIZONA
DEPARTMENT OF TRANSPORTATION Mary Vipauna 5/07 ROADWAY STANDARD DRAWINGS PROVED FOR DISTRIBUTION Outer Ferrack CATCH BASIN C-15.40 TYPE 5 Sheet 1 of 2


# SECTION A-A

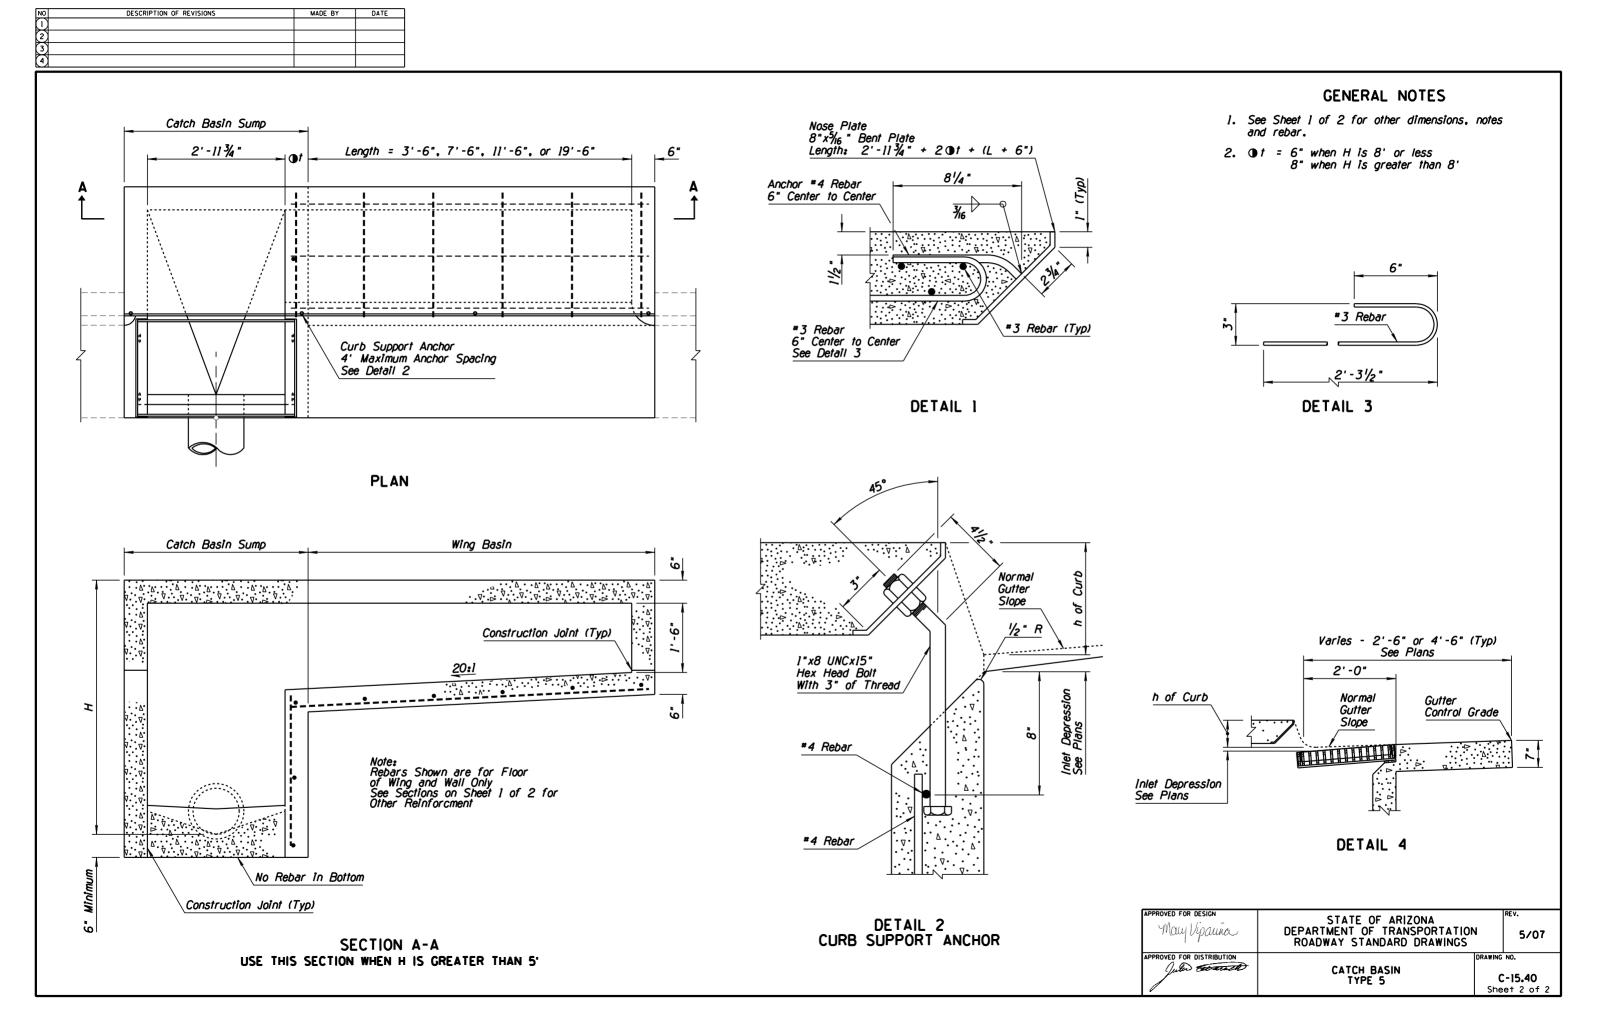



NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REVISED GRATE DIMENSIONS AND REISSUED STANDARD	RT/RLF	7/01
(2)			
(3)			
4			

# 2'-1½" |/4" (Typ) | L 3"x4"x½" |/2"x3½" Bar |/2"x3½" Bar |/2"x3½" Bar |/2"x3½" Bar



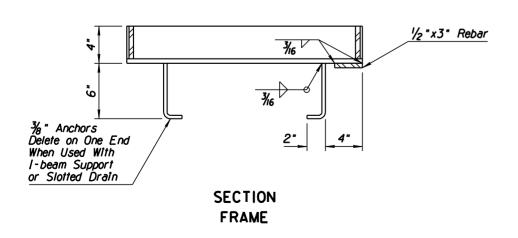

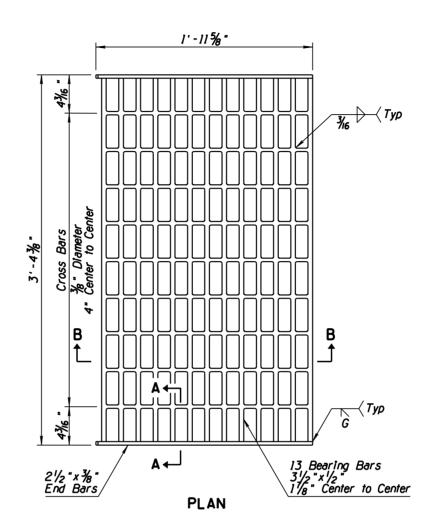




SECTION B-B GRATE


1

## GENERAL NOTES

- Grating units and frames shall be fabricated from structural steel ASTM A36 except as noted.
- 2. All welding shall be in accordance with Std Spec 604-3.06.
- 3. The completed assembly shall be given one shop coat of Number 1 paint.
- 4. Frames and grates shall fit to a maximum rock of  $^{3}/_{32}$ " at any point.
- 5. Grate opening is 3.60 Sq Ft.
- 6. Bracing of frame is recommended for handling and placement purposes.
- 7. Frame and Grate to be used with Std Dwgs C-15.10, C-15.30 and C-15.40.
- 8. Grate may be used with Std Dwg C-15.92 Frame.

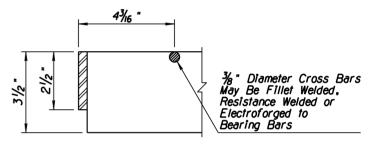


SECTION A-A

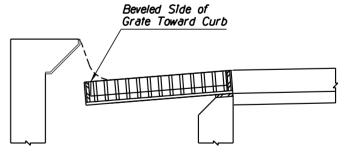

# TYPICAL INSTALLATION

C-15.10 Catch Basin Shown Similar for C-15.30 and C-15.40

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		FEV. 5/07
APPROVED FOR DISTRIBUTION		DRAWING	NO.
Julio Estach	CATCH BASIN FRAME AND GRATE		:-15.50

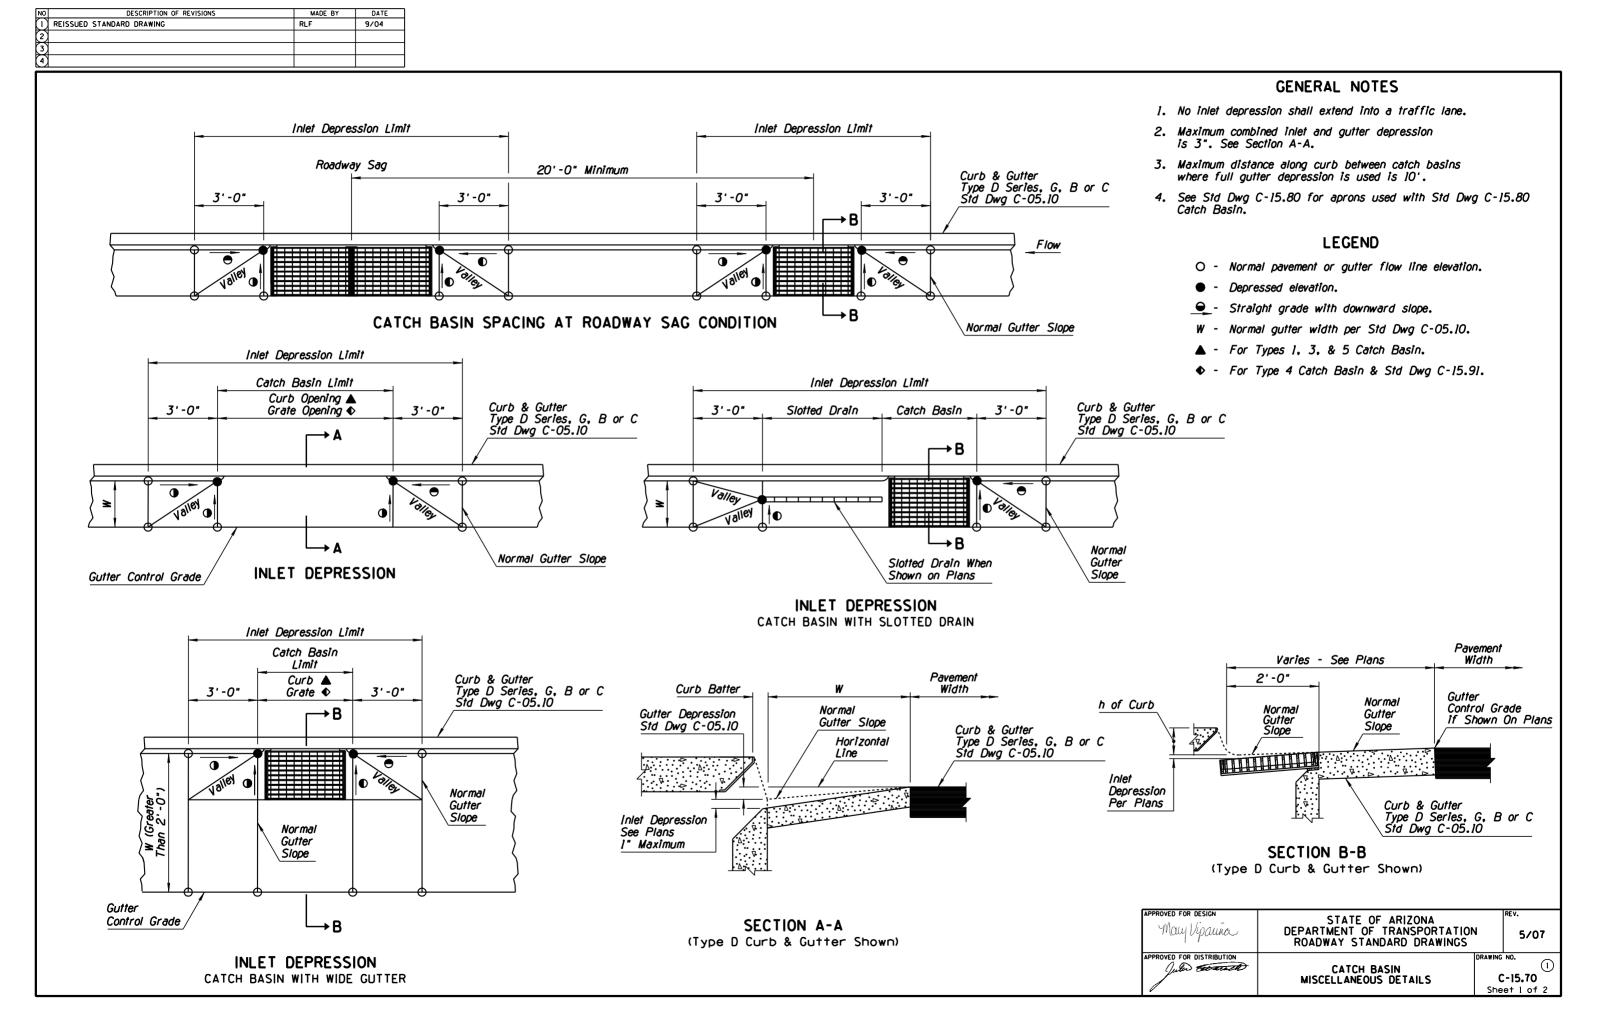



NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REMOVED CMP DESIGNATION	RLF	9/04
2	ADDED NOTE	RLF	9/04
3			
$\overline{\mathbf{A}}$			

1. Construction drain may be deleted at the option of the Engineer.


## LEGEND

O - Normal pavement or gutter flow line elevation.

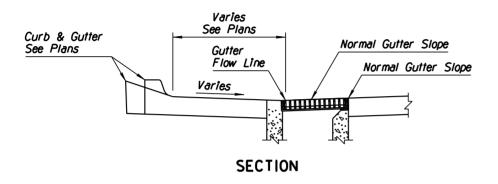

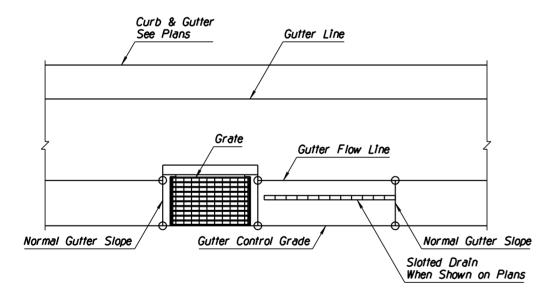


TYPE 4 CATCH BASIN WITHOUT CURB

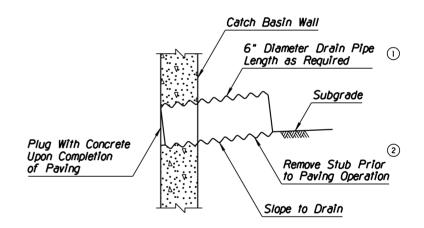


CATCH BASIN CONSTRUCTION DRAIN


May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07	
APPROVED FOR DISTRIBUTION July Therese	CATCH BASIN MISCELLANEOUS DETAILS	C	C-15.70 Sheet 2 of 2	

_			
NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
1	REVISED TABLE MEASUREMENT FORMAT	RLF	9/04
(2)			
(3)			
4			

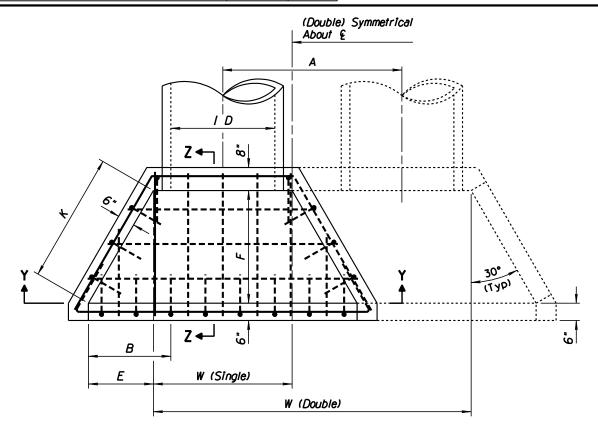


PLAN

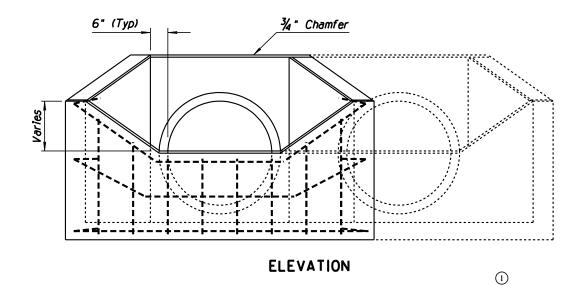

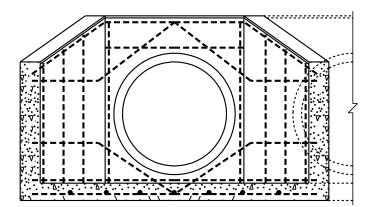

SECTION Y-Y

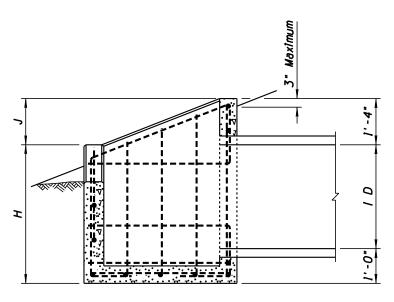



SECTION Z-Z


PIPE	DIMENSIONS (Ft-In)				QUANTITI	ES (Based o	on CMP Inst	allation)					
ΙD			В	F	F	F H J		, ,	Concrete (CY)		Reinforcing Steel (Lbs)		
(ln)	Single	Double	A			,	,		, A	Single	Double	Single	Double
18	2 -6	5 -2	2 -8	1 -3	0-9	1 -3%	3 -1	0-9	1 -6	0.7	1.1	75	<i>10</i> 5
24	3 -0	6 -6	3 -6	1 -71/2	1 -11/2	1 -11%	3 -5	0-11	2 -3	1.0	1.6	90	<i>13</i> 5
30	3 -6	7 -10	4 -4	2 -0	1 -6	2 -71/4	3 -9	1 -1	3 -0	1.5	<b>2.</b> 3	110	<i>1</i> 65
36	4 -0	9 -2	5 -2	2 -41/2	1 -101/2	3 -3	4 -0	1 -4	3 -9	2.0	<b>3.</b> 0	145	<i>21</i> 5
42	4 -6	10 -6	6 -0	2 -9	2 -3	3 -103/4	4 -4	1 -6	4 -6	<b>2.</b> 5	<b>3.8</b>	190	280

- 1. See also Std Dwg C-13.10.
- 2. High point of headwall shall not project more than 3" above slope.
- 3. All concrete shall be Class B.
- 4. All rebar shall be #4, 1'-0" center to center, with 3" minimum clear to inside of walls and floor.

APPROVED FOR DESIGN	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS	FEV. 5/07
APPROVED FOR DISTRIBUTION	CATCH BASIN DROP INLET	C-15.75

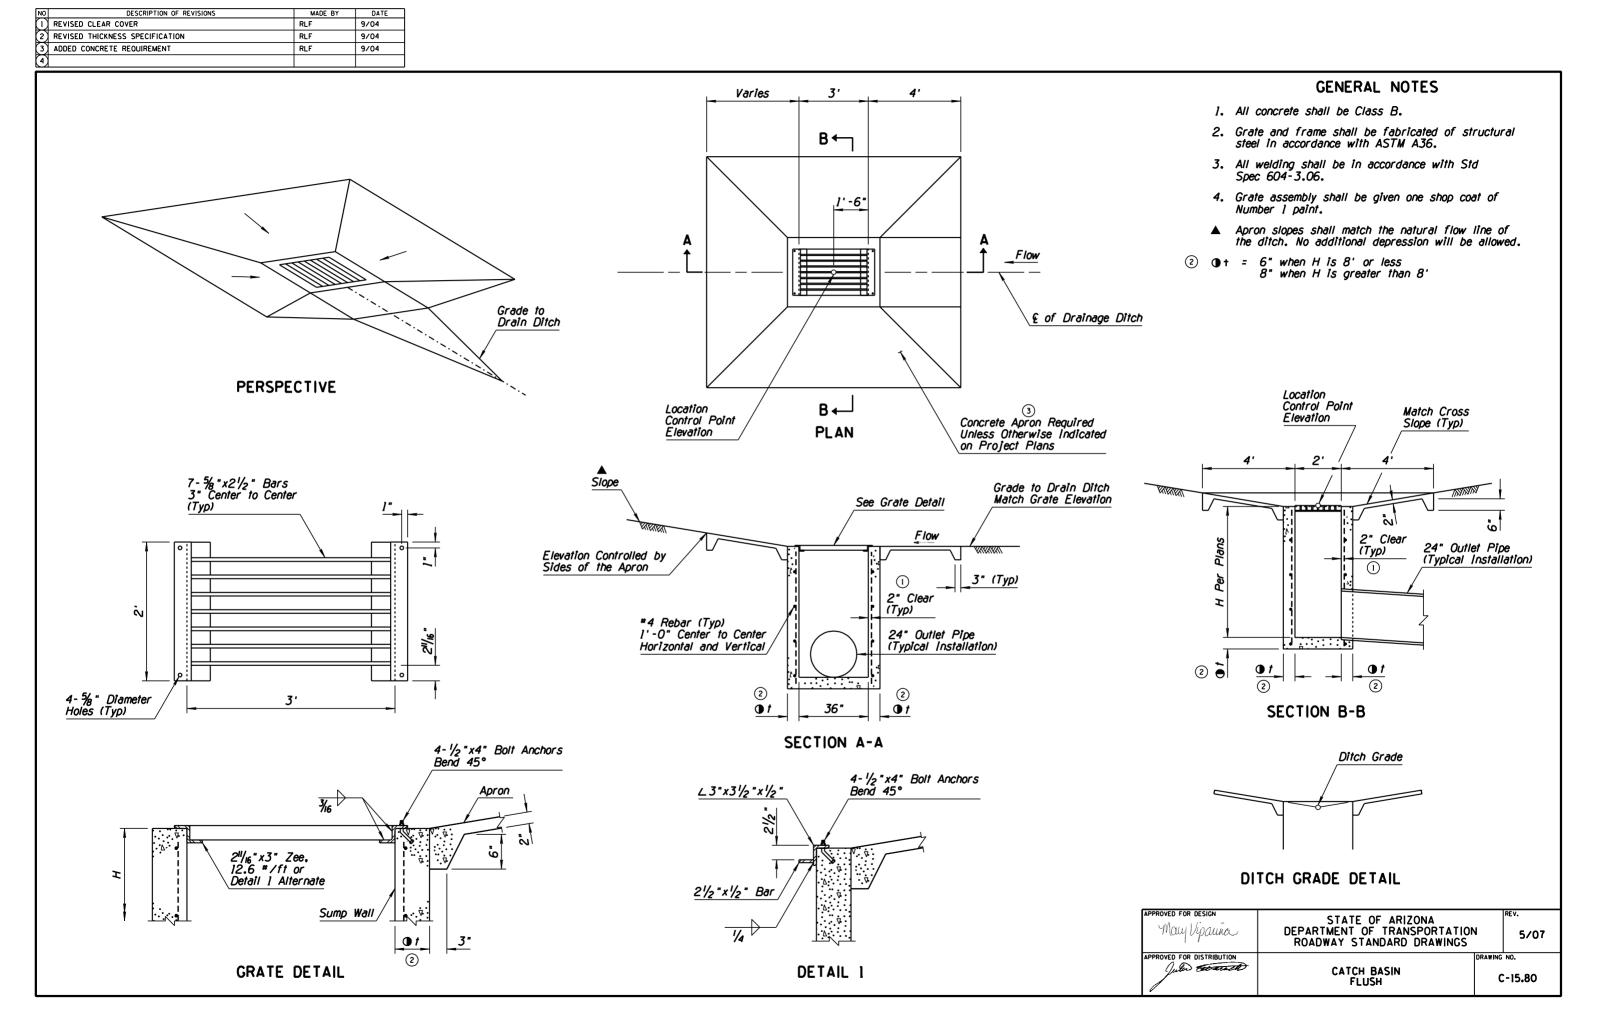

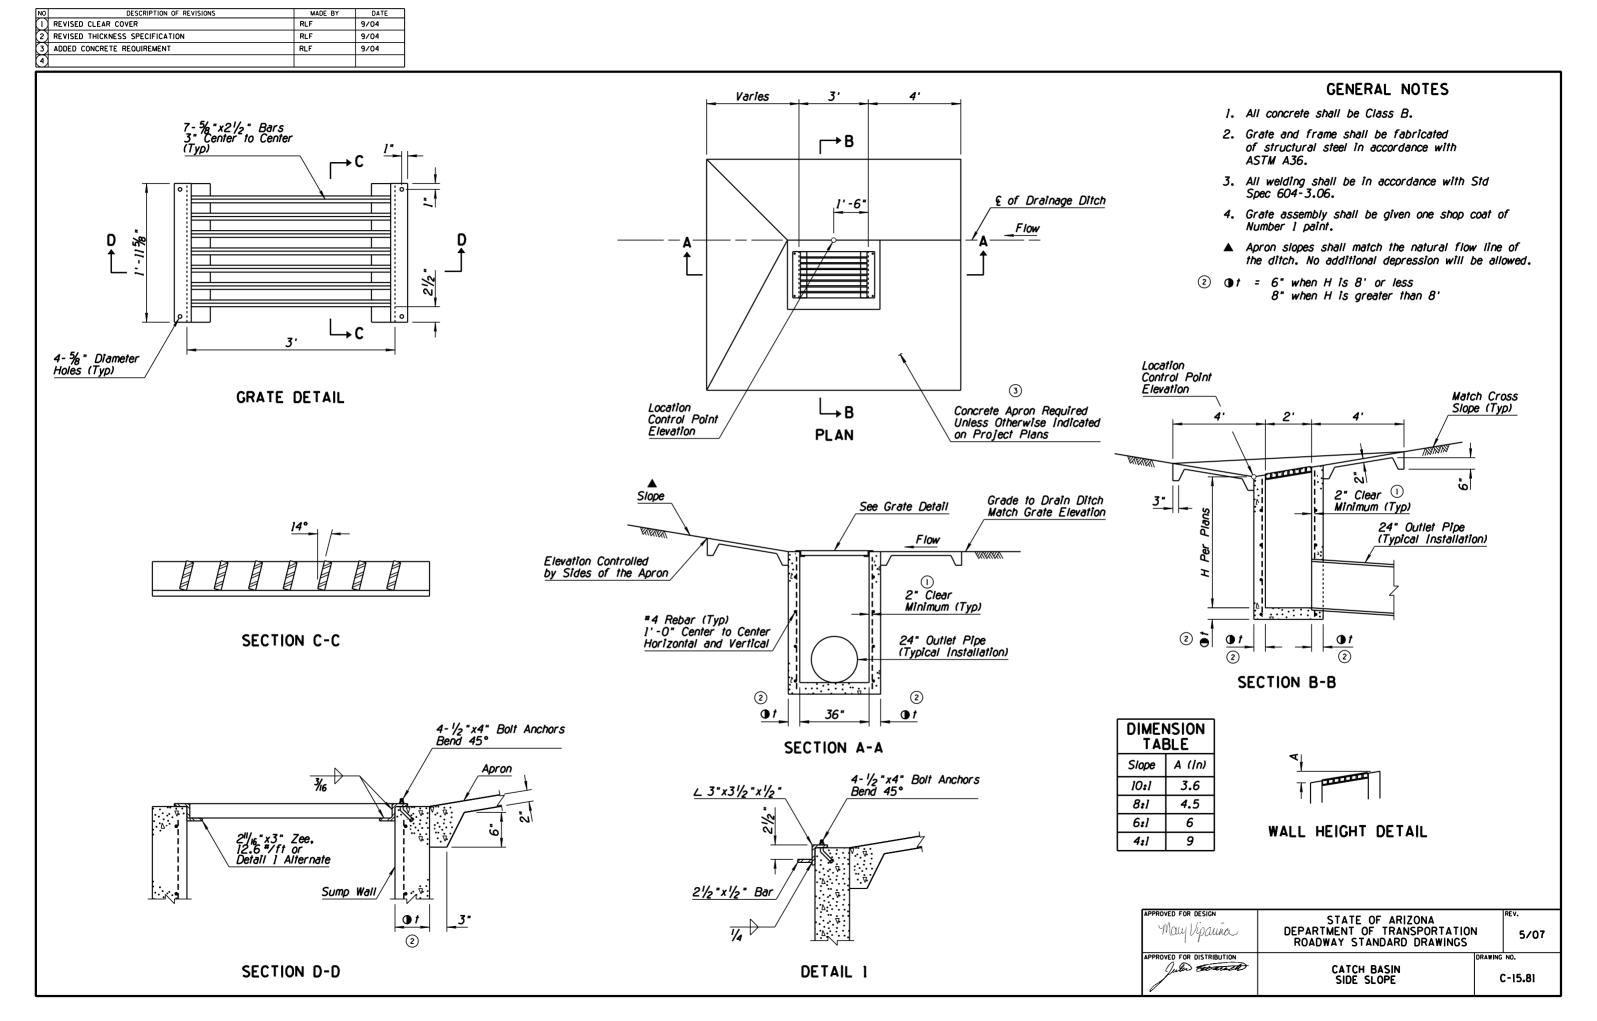


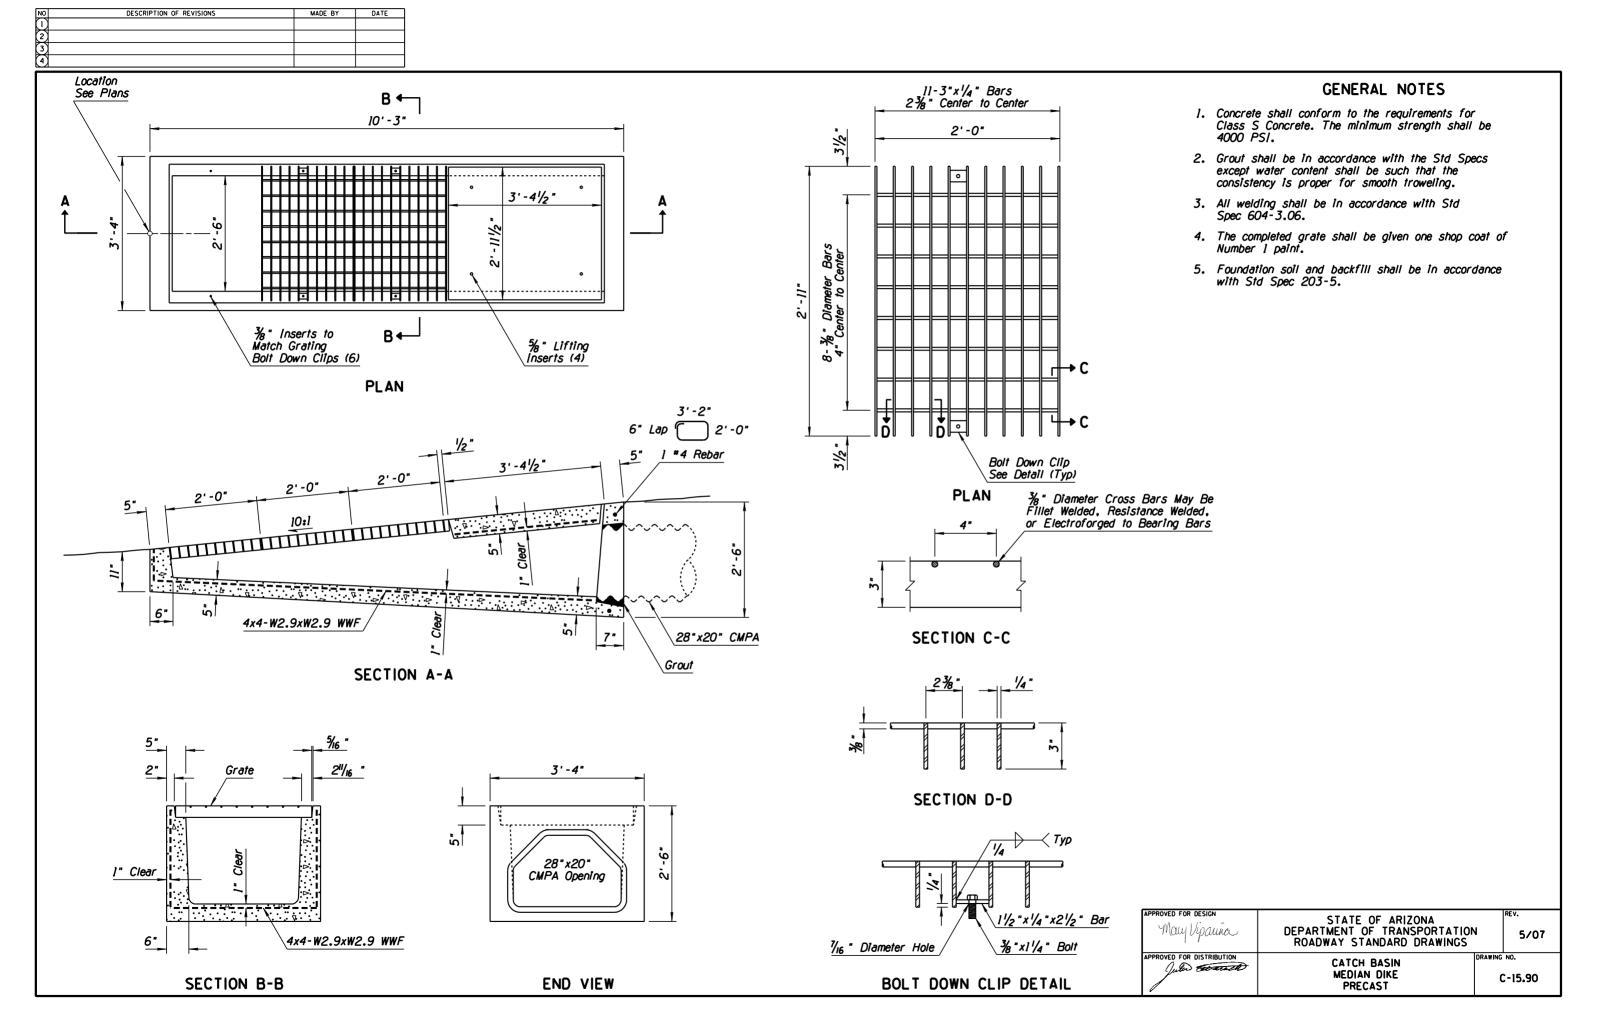

NO DESCRIPTION OF REVISIONS MADE BY DATE  1 DELETED PREVIOUS GENERAL NOTE* 2 RLF 7/01  2 REVISED THICKNESS SPECIFICATION RLF 9/04			
3 4			
Gutter Flow Line  Roadway Width  Solotted Drain  1'-6"  2'-6"	Location Marker	i. All conc	GENERAL NO
<u>1°</u> - B←	Fill to Subgrade  Subgrade  4"x4" Timbers	otherwis 3. #4 rebā horizont	or shall have 2" minimum se noted. or shall be placed 12" ce sal & vertical in walls. ory be placed in any wall.
B+ B+	or as Approved by the Engineer	5. See Std Informat ▲ Includes	Dwgs C-13.60 and C-1.  Ton and dimensions of slope  The image of the slope of the slope  The image of the slope of the slo
Location Control Point	Limits of Work	8*	when H is greater than
4'-0"	NOTE: Bend Rebars and Cover With Two Layers of 4"x4" Timbers		
PLAN	TEMPORARY TIMBER CAP DETAIL		
Grate Elevation See Plans  1'-6"  2'-6"  Grate & Frame Std Dwg C-15.91 Sheet 2 of 2  7" Type B Curb 4" Type C Curb  Remove Base for Placement of Special	Grate & Frame Sheet 2 of 2  CMP Coupling Band Flow Line		
Placement of Special Catch Basin  Catch Basi	18" or 24" Diameter Slotted Drain		
6. Minimum 6. Minimum 7. O. Minimum 8. Minimum 1. O. Minim	Naries (S. S. S		
2"   1'-6"   2		May Vipauna	STATE OF A DEPARTMENT OF TR ROADWAY STANDAR
SECTION A-A Invert Elevation	SECTION B-B	APPROVED FOR DISTRIBUTION	FREEWAY CATCH BASII

# NOTES

- num clear cover unless
  - center to center
  - 9//.
  - C-13.65 for more slotted drains.
- an 8'



NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED CONCRETE ANCHOR STUD LENGTH	RLF	9/04
2	REARRANGED GENERAL NOTES	RLF	9/04
3	REVISED WELD SIZE NOTATIONS ON DRAWING	RLF	4/06
$\overline{\mathbf{A}}$			


12"

3/8 "x6" Concrete Anchor Studs

(Typ)

24"

<u>"4"</u> (3)

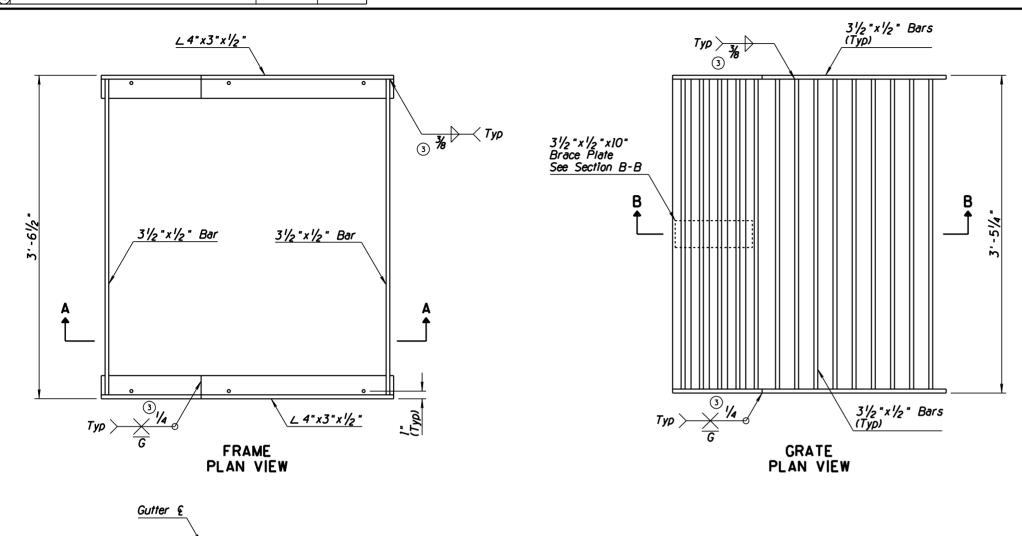


# © GENERAL NOTES

- 1. All structural steel shall be in accordance with ASTM A36.
- 2. All welding shall be in accordance with Std Spec 604-3.06.
- 3. The completed grate assembly (frame & grate) shall be given two shop coats of Number 1 paint.

# NOTE TO DESIGNERS

Grate design is not suitable for locations subject to bicycle traffic.

GRATE AND FRAME DIMENSIONS							
Туре	Curb Height ( n)		Gutter	Catch Basin Frame		Catch Basin Grate	
rype			(In)		A ([n)	٧	C (ln)
В	6	2-6	1315/16	26°-57′-40"	121/16	26°-57′-40″	
С	3	2-6	135/16	15°-37'-45"	117/8	15°-37'-45"	

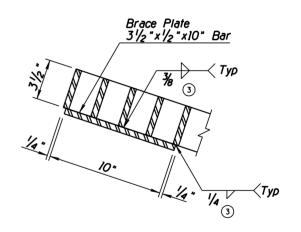


BRACE PLATE DETAIL

Type C - 251/16 "  Type B - 251/8"	3½"x½"xIO" Bar See Brace Plate Detail	
------------------------------------	---------------------------------------	--


SECTION A-A SECTION B-B

May Vipauia	STATE OF ARIZONA		FEV. 5/07
APPROVED FOR DISTRIBUTION  July Governor	FREEWAY CATCH BASIN DETAILS	_	no. -15.91 et 2 of 2


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD DRAWING	RLF	9/04
2			
3			
4			

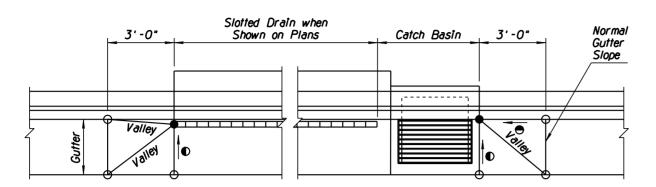

PLAN

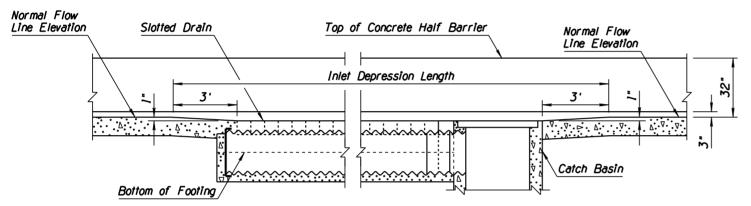

## **ELEVATION**

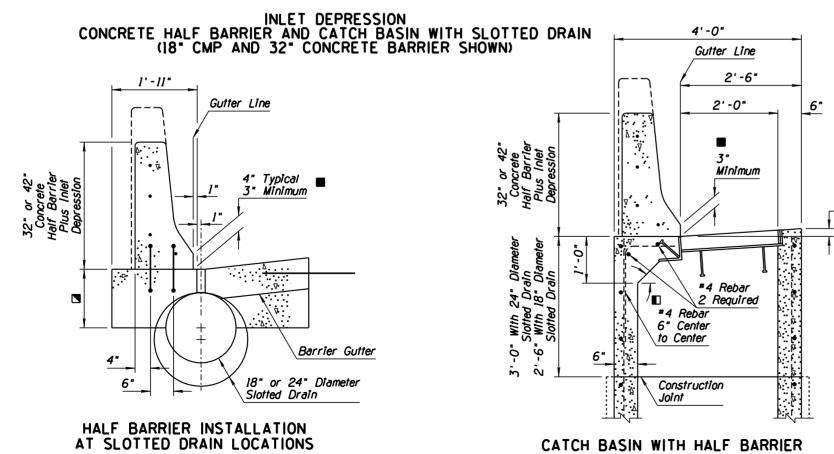


#### GENERAL NOTES

- 1. See Std Dwg C-15.91 for dimensions, sizes and details not shown for construction of catch basin.
- 2. See Std Dwgs C-10.52 and C-10.53 for dimensions, sizes and details not shown for construction of barrier.
- 3. See Std Dwg C-13.60 for dimensions, sizes and details not shown for construction of slotted drain.
- Only longitudinal reinforcing steel shall be placed in half barrier within 1' of catch basin frame. S-shape bars shall not be placed in the rear wall of the catch basin.
  - ☐ 1'-3" for 18" diameter slotted drain 1'-6" for 24" diameter slotted drain
  - Angle varies. approximately 45°
  - Varies in increased height over catch basin and slotted drain inlet depression
  - Depressed elevation.
  - O Normal pavement or gutter flow line elevation.
  - Match adjacent gutter depression. Additional inlet depression as specified
  - Straight grade with downward slope.

## NOTE TO DESIGNERS


Grate design shown is not suitable for locations subject to bicycle traffic. Use Std Dwg C-15.50 grate with Std Dwg C-15.92 frame (Sheet 2 of 2) for locations with bicycle traffic.

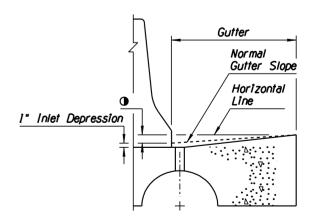



# GUTTER DEPRESSION AT SLOTTED DRAIN LOCATIONS

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		FEV.	07
APPROVED FOR DISTRIBUTION  July Control	CATCH BASIN WITH TYPE 'F' CONCRETE HALF BARRIER	_	NO. C-15.92 Bet 1 o	-


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD DRAWING	RLF	9/04
2	DELETED GENERAL NOTE	RLF	4/06
(3)	REVISED NOTE TO DESIGNERS	RLF	5/07
(4)			

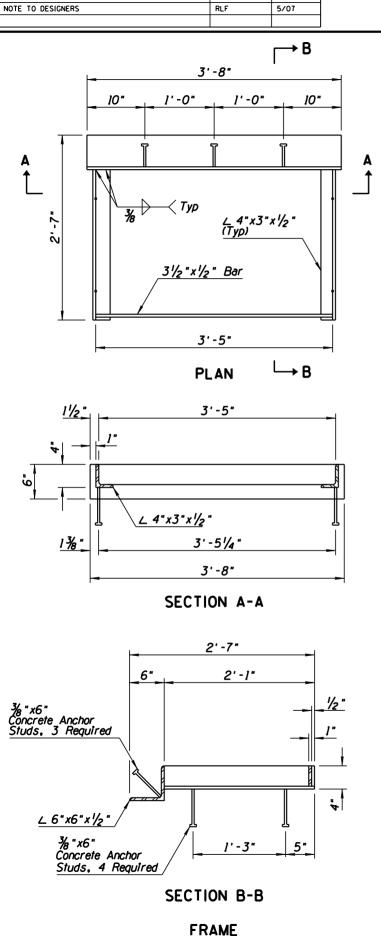

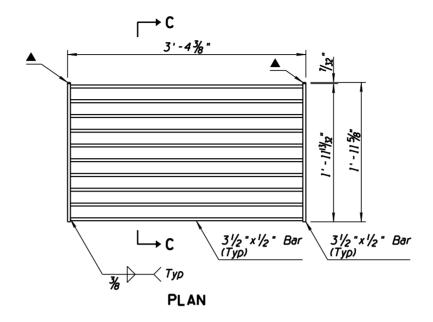

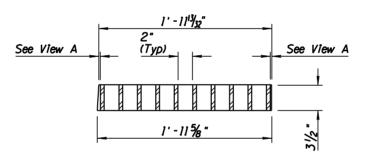

SECTION C-C GRATE




View A

- 1. All welding shall be in accordance with Std Spec 604-3.06.
- 2. Grate opening for grate shown is 4.75 Sq Ft.
- ▲ Beveled side of grate toward barrier


(2)


# **3 NOTE TO DESIGNERS**


Grate design shown is not suitable for locations with bicycle traffic. Use Std Dwg C-15.50 grate with Std Dwg C-15.92 frame (Sheet 2 of 2) for locations with bicycle traffic.




NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD DRAWING	RLF	9/04
2	DELETED GENERAL NOTE	RLF	4/06
(3)	REVISED NOTE TO DESIGNERS	RLF	5/07
(4)			

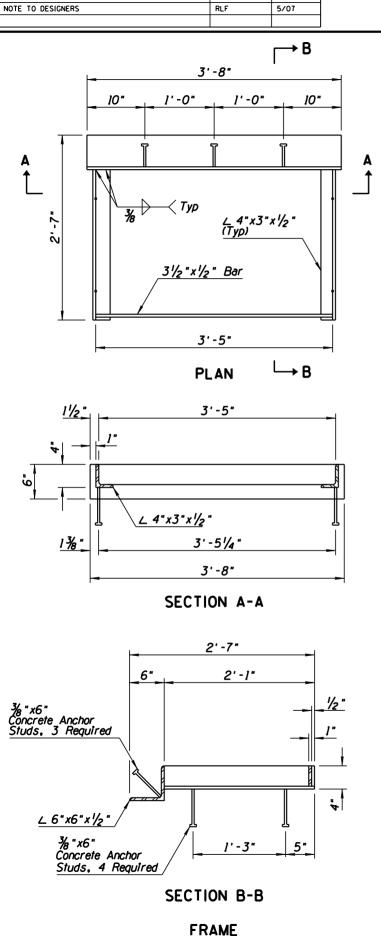

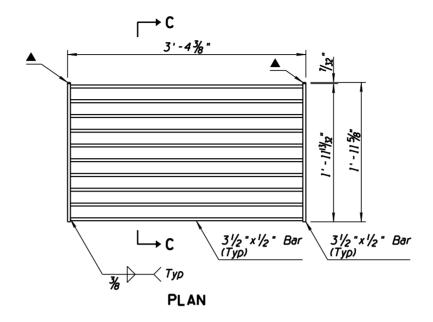

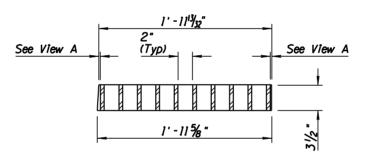

SECTION C-C GRATE




View A

- 1. All welding shall be in accordance with Std Spec 604-3.06.
- 2. Grate opening for grate shown is 4.75 Sq Ft.
- ▲ Beveled side of grate toward barrier


(2)

# **3 NOTE TO DESIGNERS**


Grate design shown is not suitable for locations with bicycle traffic. Use Std Dwg C-15.50 grate with Std Dwg C-15.92 frame (Sheet 2 of 2) for locations with bicycle traffic.




NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REVISED GRAPHICS	RLF	9/04
2			
(3)			
(4)			

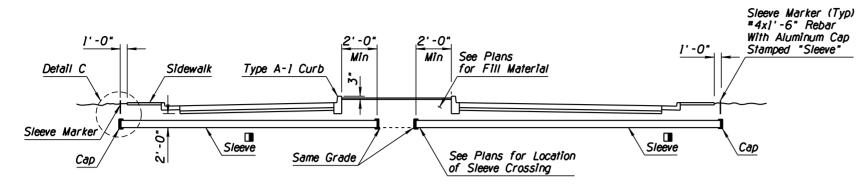


SLEEVE UNDER CROSSROAD

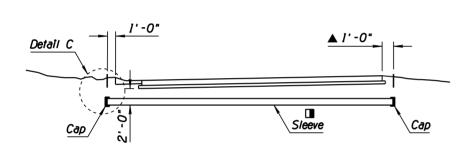


SLEEVE UNDER MAINLINE

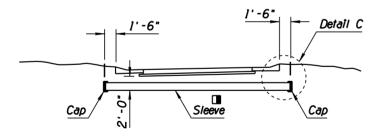


SLEEVE UNDER RAMP

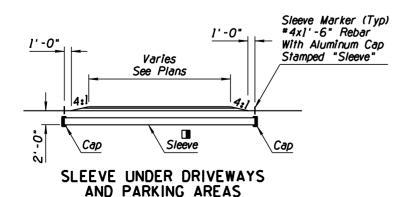

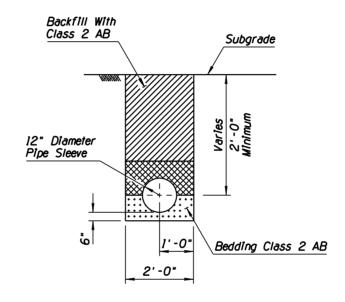


TYPICAL INSTALLATION


1

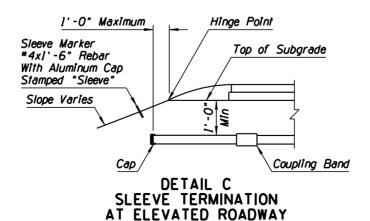


- 1. Irrigation sleeves shall be installed in a trench condition. See Std Dwg C-13.15.
- 2. Bedding and backfill material shall be Class 2 AB.
- 3. Pipe installation shall conform to Section 501 of Std Specs.
- 4. The contractor shall imprint a 4" ± high letter "S" on the face of all curbs at sleeve locations. The width of the letter shall be ½" and shall penetrate the concrete surface ½".
- 5. For non-continuous sleeves under crossroads, Std Dwg C-05.10 Type "A-1" curb shall be required where median is irrigated. See plans for locations. Dumbell waterstop shall be at all expansion ioints.
- 6. Materials used for caps or plugs shall be as recommended by the pipe supplier and approved by the Engineer.
- Sleeves shall be installed parallel to the roadway subgrade. Slope may vary in superelevated sections. Minimum slope nominal to drain.
- ▲ 2'-0" Back of Curb Median




DUMBELL WATERSTOP



NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD DRAWING	RLF	9/04
2			
3			
$\mathbf{A}$			

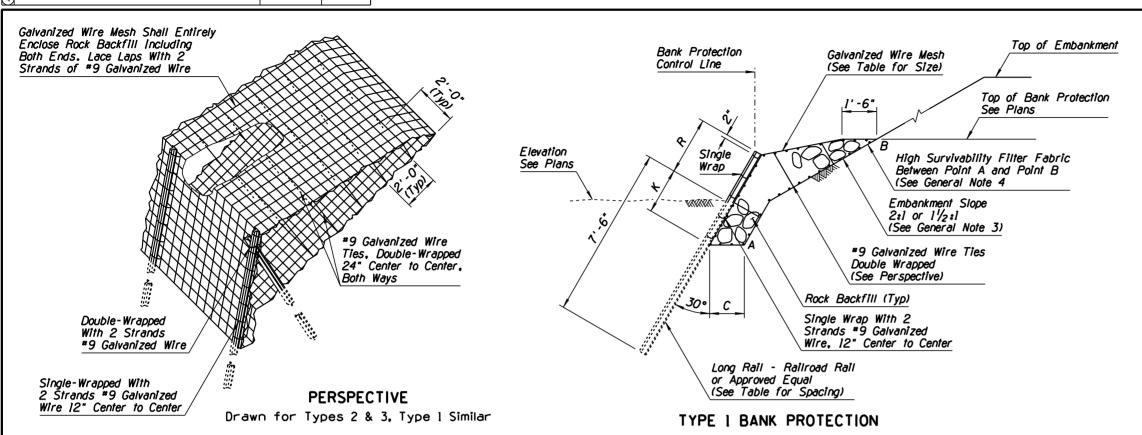

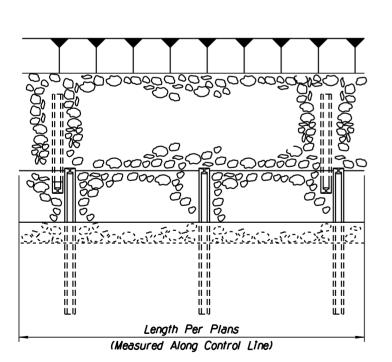


PLAN OF CHANNEL BANK PROTECTION

#### Top of Embankment Galvanized Wire Mesh (See Table for Size) Rock Backfill (Typ) Bank Protection Top of Bank Protection Control Line See Plans Elevation Embankment Slope 2:1 or 1½:1 (See General Note 3) See Plans Single Wrap \*9 Galvanized Wire Ties Double Wrapped (See Perspective) High Survivability Filter Fabric Between Point A and Point B C (See General Note 4) 300 Short Rail - Railroad Rail or Approved Equal 3/4"x21/2" Galvanized Iron 15' -0" Center to Center Long Rail - Railroad Rail or Approved Equal Pipe Spacer (See Table for Spacing)


TYPE 2 AND 3 BANK PROTECTION

# GENERAL NOTES


- Rock shall conform to Std Spec 913-2.01(A). The rock shall have a minimum nominal diameter no smaller than the mesh opening, and a maximum nominal diameter of 12".
- 2. All mesh wire, tie wire, cable, bolts, washers and nuts shall be galvanized.
- 3. When other embankment slope rates are encountered, warp to 11/2:1 or 2:1.
- 4. High survivability filter fabric shall conform to Section 913-2.05 of the Standard Specifications.
- All wire mesh on a single project shall have the same mesh opening.




ELEVATION AT CHORD POINT ON CURVE



#### **ELEVATION ON STRAIGHT SECTION**



# SECTION A - A WIRE MESH SPLICE DETAILS





Burn Holes Through Rails in Field and Bolt Together as Shown

# RAIL CONNECTION DETAIL

ı												
ı	Tues	SHORT RAIL	SHORT RAIL	LONG RAIL	LONG RAIL	LONG RAIL SPACING	MESH	С	1	K	R	TOP OF BANK PROTECTION
ı	Туре	LENGTH (Ft)	WT (Lbs/Yd)	LENGTH (Ft)	WT (Lbs/Yd)	(Ft-In) (Center to Center)	DESIGNATION	(Ft-In)	(Ft)	(Ft-In)	(Ft-In)	ABOVE THE STREAM BED (Ft)
ı	1	N/A	N/A	10	20 Min	7-0	3"X3"-W1.4/W1.4	1-6	0	2-0	2-6	2 to 4
ı	2	10	20 Min	15	50 Min	7-6	or	1-6	0	3-0	5-0	4 to 7
ı	3	12	20 Min	17	50 Min	7-6	4"X4"-W].4/W].4	2-0	1	4-0	7-0	6 to 12
		•	•	•		·		•			•	

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION  July Toward	RAIL BANK PROTECTION FOR DRAINAGEWAYS TYPES 1, 2 & 3	DRAWING C	NO. (1)



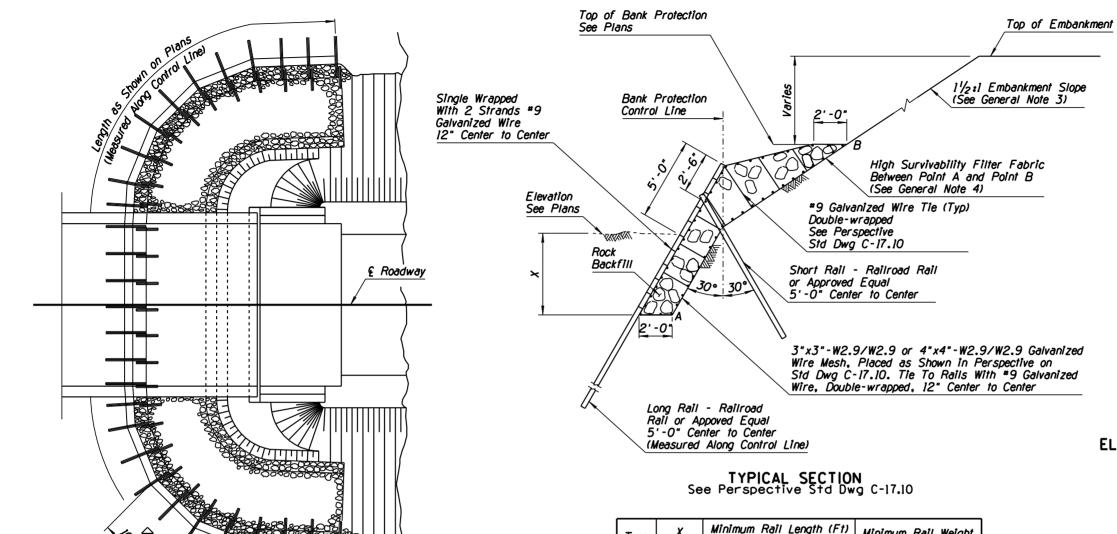

	Туре	х	Minimum Rai	I Length (Ft)	Minimum Rail Weight
1	, ypc	(Ft-In)	Long Rail	Short Rail	(Lbs/Yd)
ı	4	5-0	22	10	50
ı	5	7-6	<i>2</i> 5	13	50
-	6	10-0	28	16	50


¾ "x4½" Bolt, Washer & Nut

34"x21/2" Galvanized Iron

Pipe Spacer

# PLAN OF BANK PROTECTION AT ABUTMENT

 ☐ Construct on Two-Panel Chords Around Curves

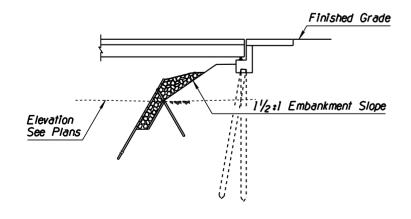


SECTION ON € ROADWAY

RAIL CONNECTION DETAIL
Burn Holes Through Rails In Field
and Bolt Together as Shown


----------

# GENERAL NOTES


- 1. Rock shall conform to Section 913-2.01(A) of the Standard Specifications. The rock shall have a minimum nominal diameter no smaller than the mesh opening, and a maximum nominal diameter of 12".
- All mesh wire, tie wire, cable, bolts, washers and nuts shall be galvanized.
- 3. When other embankment slope rates are encountered, warp to 11/2:1 or 2:1.
- 4. High survivability filter fabric shall conform to Section 913-2.05 of the Standard Specifications.
- All wire mesh on a single project shall have the same mesh opening.



**ELEVATION AT CHORD POINT ON CURVE** 




# **ELEVATION ON STRAIGHT SECTION**




# WIRE MESH SPLICE DETAILS


May Vipauña	STATE OF ARIZONA	
APPROVED FOR DISTRIBUTION	RAIL BANK PROTECTON AT ABUTMENTS TYPES 4, 5 & 6	C-17.15


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REISSUED STANDARD DRAWING	RLF	9/04
(2)			
(3)			
4			

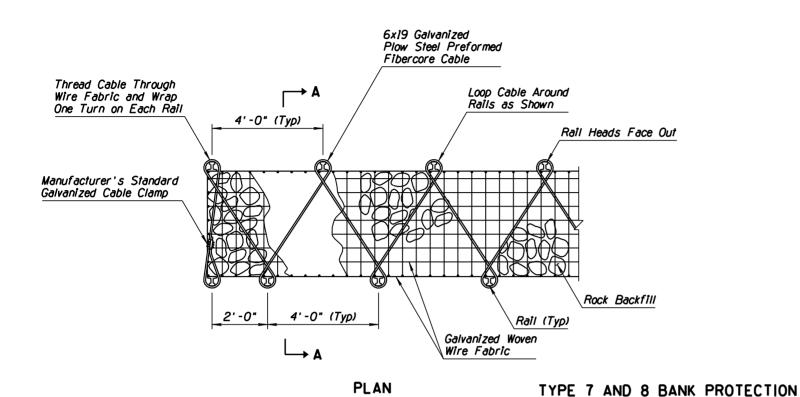


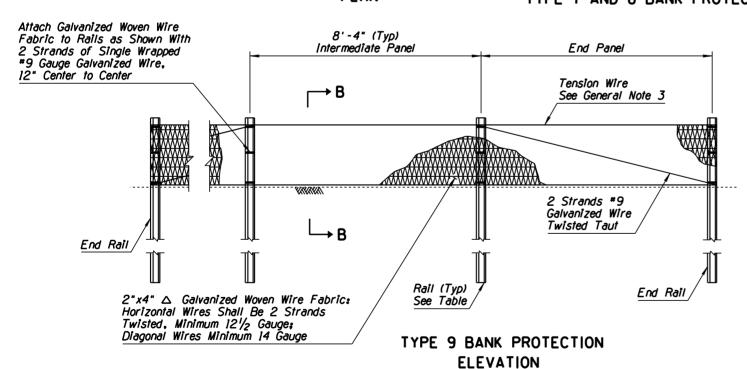

Туре	MIN RAIL LENGTH (Ft)	MIN RAIL WT (Ibs/Yd)	MESH	A (Ft-In)	B (Ft-In)	D (Ft)	Y (In)
7	15	50	3"X3"-W].4/W].4	4 - 0	2 - 0	4	6
8	18	50	4"X4"-W].4/W].4	7 - 0	3 - 0	5	6
9	10	15	N/A	2 - 2	N/A	N/A	3

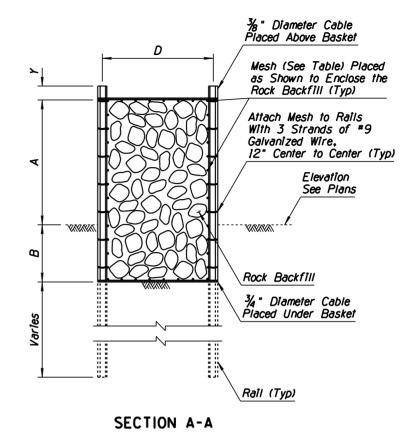

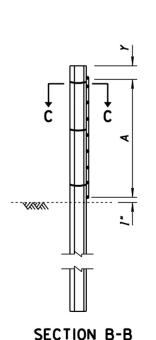




4" Minimum Lap

2 Strands #9 Galvanized Wire

- Rock shall conform to Std Spec 9!3-2.0!(A). The rock shall have a minimum nominal diameter no smaller than the mesh opening, and a maximim nominal diameter of 12".
- 2. All mesh wire, tie wire, cable, bolts, washers and nuts shall be galvanized.
- 3. Tension wires shall be 7 gauge (0.177 in diameter) coll-spring steel wire with a minimum tensile strength of 75,000 pounds per square inch and shall be zinc-coated or aluminum-coated.

May Vipauna	STATE OF ARIZONA	
APPROVED FOR DISTRIBUTION  Julia Control	RAIL BANK PROTECTION FOR DRAINAGEWAYS TYPES 7, 8 & 9	C-17.20

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	RENAMED STD DWG FROM C-18.40 TO C-18.10, SHEET 1 OF 3	RLF	9/04
2	REVISED GENERAL NOTE	RLF	7/05
3	DELETED ORIGINAL NOTE 5: CHANGED NUMBERS 6 & 7	RLF	5/07
4	ADDED NOTE TO DESIGNERS	RLF	5/07

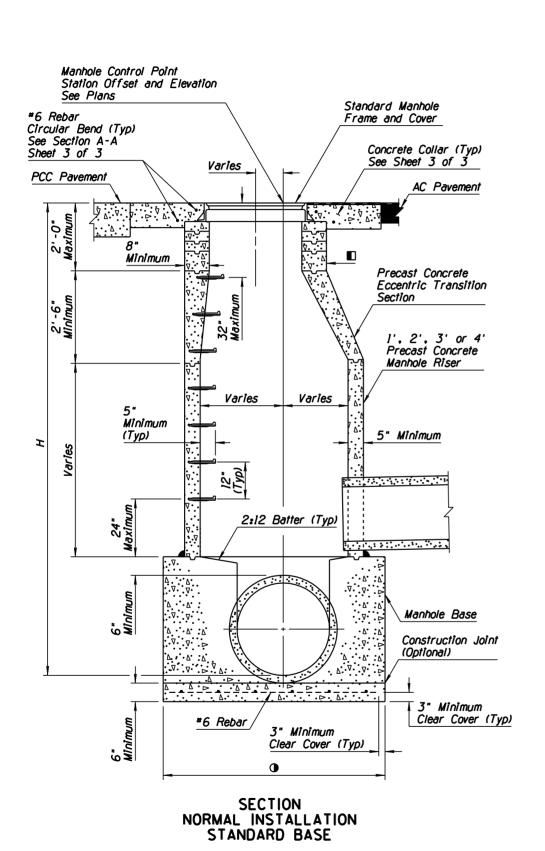

6" Minimum (Typ)

## SECTION A-A

Manhole Control Point Station Offset and Elevation

See Plans

Standard Manhole Frame and Cover #6 Rebar Circular Bend (Typ) Concrete Collar (Typ) See Section A-A See Sheet 3 of 3 Sheet 3 of 3 Varies PCC Pavement AC Pavement Precast Reinforced Concrete Flat Slab Top Section 2'-0" Waximu #4 Rebars 6" Center to Center Minimum Precast Concrete Manhole Riser 6" Minimum (Typ) : v: 5" Minimum (Typ) Grout Bead #6 Rebar @ 12" Center to Center Maximum 3" Minimum Both Directions (Typ) Clear Cover (Typ) 3" Minimum Clear Cover

> SECTION SHALLOW INSTALLATION SLAB BASE


#### GENERAL NOTES

- 1. Pipe sizes and elevations are shown on plans.
- 2. The manhole height, H, shall be measured from the lowest invert elevation to the top of the manhole frame.
- 3. Concrete for cast-in-place manholes shall be Class B.
- 2 4. All manholes deeper than 56 inches shall have steps. Manhole steps shall be constructed in accordance with AASHTO Migg. Where precast manholes are used, the steps shall be installed at the same time sections are cast.
- 3 5. Precast manhole sections shall be manufactured in accordance with AASHTO M199, except that the compressive strength of each section shall be determined and accepted in accordance with Std Spec 1006-7.
- 6. Manhole size, location and elevation shall be as shown on plans.
- 3 ② 7. Backfill material shall be compacted to at least 95 percent of the maximum density per the applicable test method of the ADOT Materials Testing Manual.
  - 4", 6", 8" or 12" (30" Inside Diameter) Grade Rings
  - ▲ 1/4"/ft
  - See Sheet 2 of 3


#### (4)


#### NOTE TO DESIGNERS

Per OSHA requirements, special treatments are required for heights exceeding 30 ft.





Sheet 1 of 3

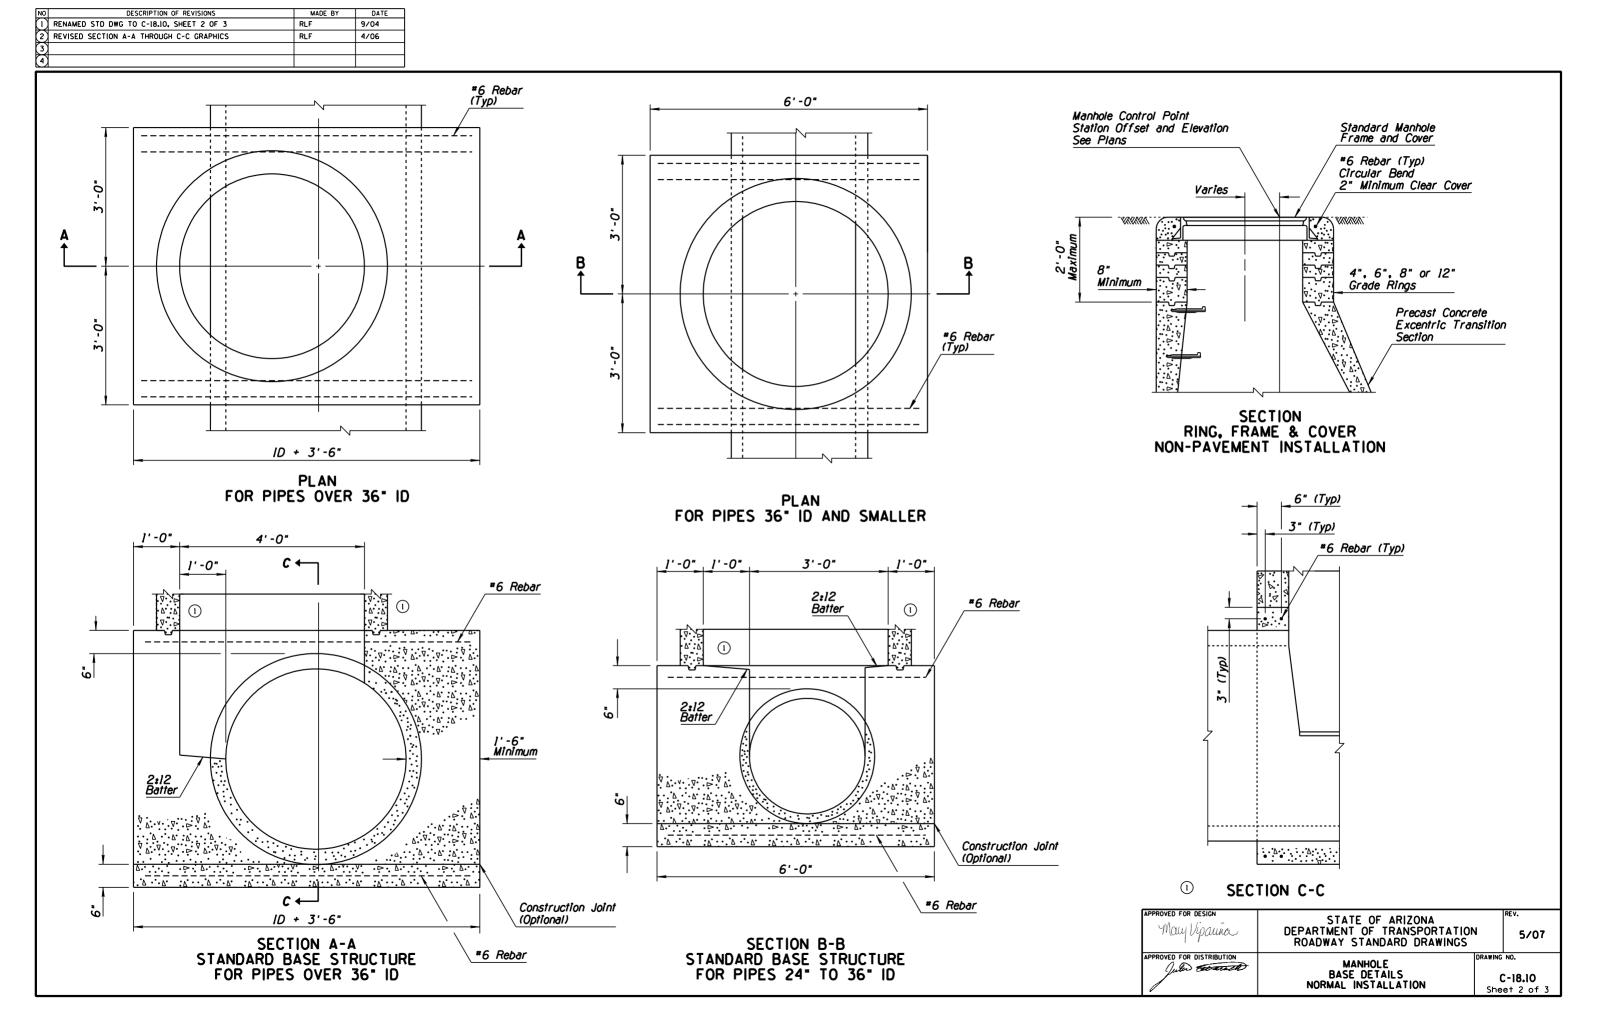

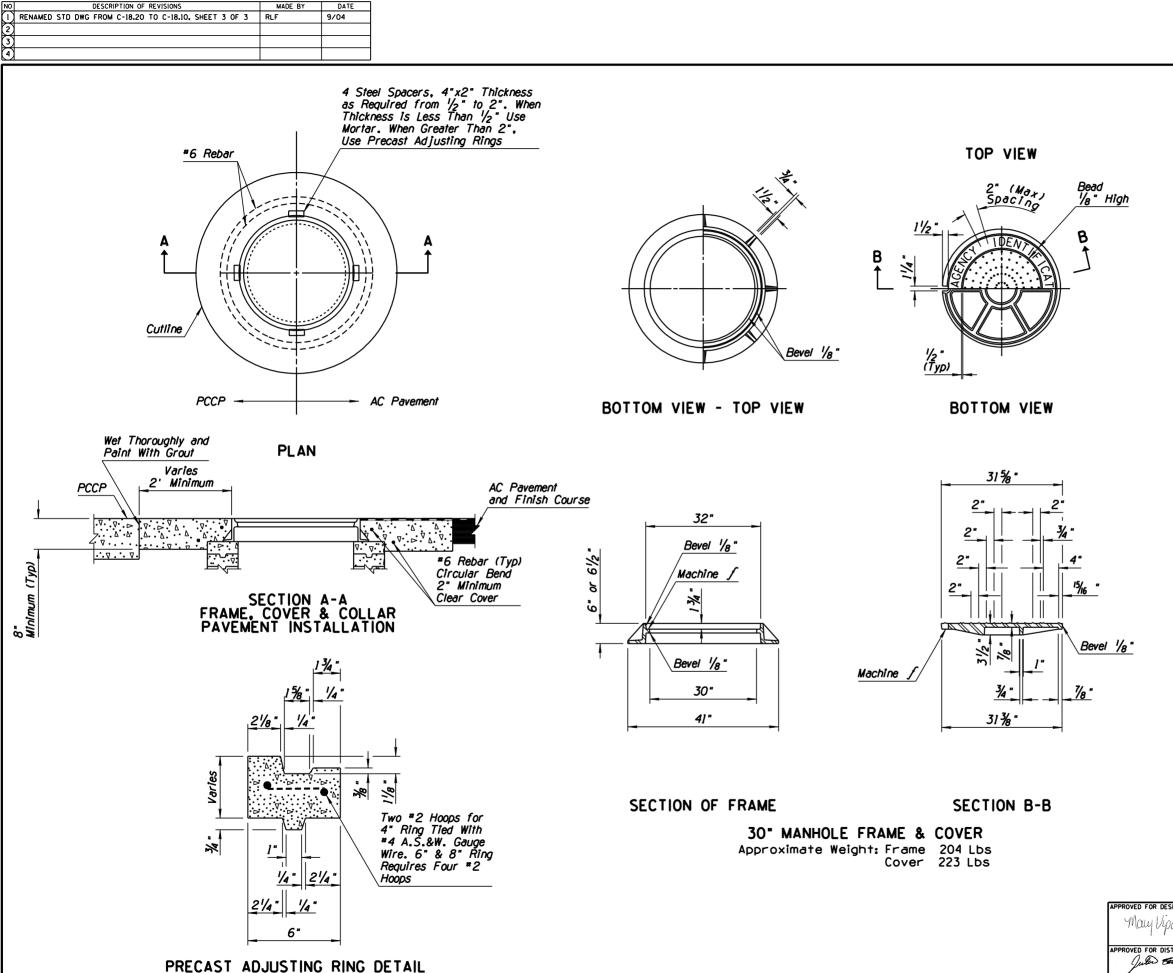

- All frames, grates, and covers shall support HS20 loading, minimum.
- Casting weights shown are minimum weights and are either for cast-iron or ductile-iron castings. Casting weight shall not exceed 110 % of the weights shown.
- Covers (excluding grates) shall conform to the following:
  - A. Manhole covers to contain the agency name and utility, as directed:
  - B. Letters shall be 2 inches in height and raised '/8-inch above the plane of the cover;
  - C. Letters and words to be equally spaced; and
  - D. Letter font and layout shall be as approved by the Engineer.
- 4. Details shown are typical. Alternative designs of manhole frames and covers may be used upon approval of the Engineer, as long as the minimum loading and weight criteria (see above) are met.






SECTION C-C
36" NOMINAL CMP FRAME & GRATE
Approximate Weight: Frame 125 Lbs
Cover 167 Lbs


May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION		DRAWING	NO. (1)
Julio Fire Contracto	MANHOLE FRAME AND COVER DETAILS	I	C-18.10 et 3 of 3

NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\odot$	REISSUED STD AS C-19.10, SHEET 1 OF 2	RLF	9/04
2	ADDED GENERAL NOTE 4	RLF	9/04
3			
4			

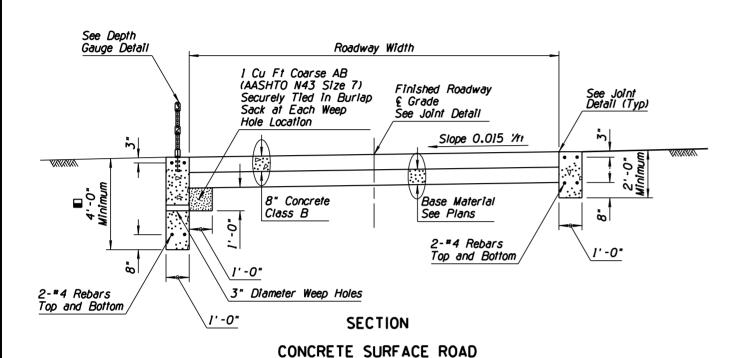


WITH CONCRETE WALLS

■ Min Distance Below Stream Bed

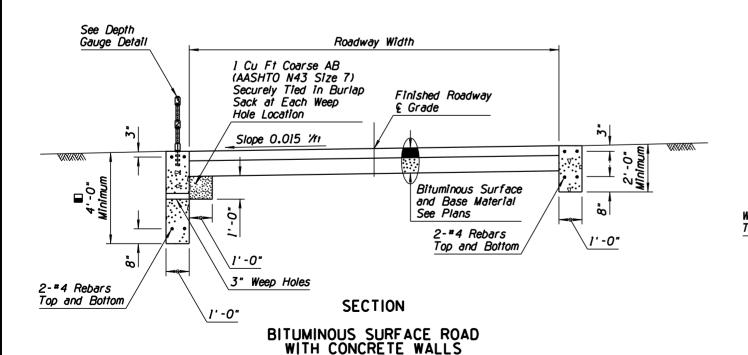

# GENERAL NOTES

- 1. Ford walls shall be Class B concrete.
- Depth gauge tubing shall be protected against concrete entering through bottom or perforations.
- Depth gauge tubing and both sides of numeral tabs shall be painted with two coats of white enamel. Numerals and markers shall be painted with one coat of gloss black enamel.
- 2 4. Depth gauge foundation may be utility concrete.



JOINT DETAIL

#### DEPTH GAUGE DETAIL

ö

%

21/2

2/2

21/2"x4"x18 Gauge Sheet Metal Number Tabs, Both

134"x3'-10" Perforated

Telescoping Square Tube 12 Gauge, 7/16 " Holes 1" Center to Center

2"x21/4"x1/2" Numerals

2"x10" Perforated


4 Sides

Telescoping Square Tube 12 Gauge, 1/16 " Holes 1" Center to Center


Finished Grade


4 Sides

Sides. Fasten With Two % "x3" Bolts Through Tube

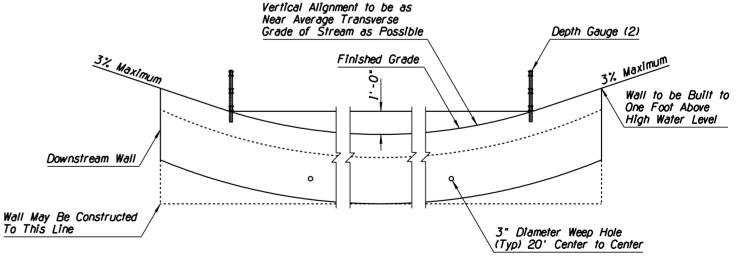


ELEVATION LOOKING UPSTREAM




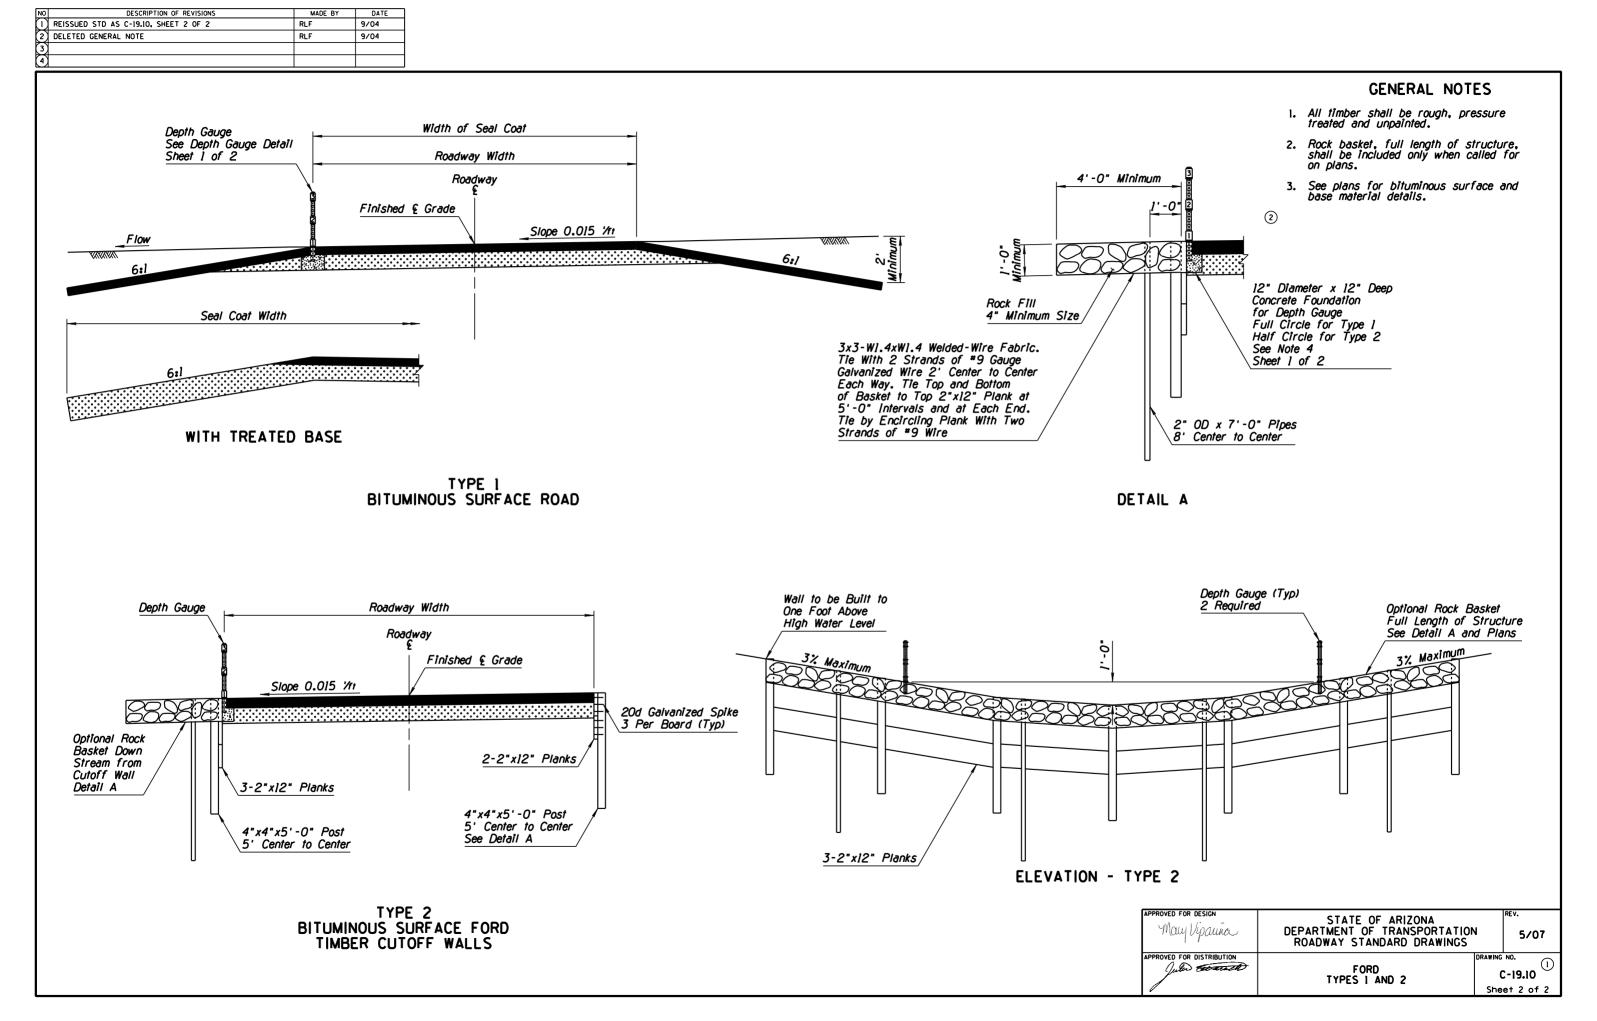


NO		
Varies, Maximum = 2'-0"  R/W Line  PLAN	11 1/4 "Diameter Diameter 10 1/4 " Diameter 10 1/4 " Diameter 10 1/4 " Diameter 10 1/6 " Diameter 10 1/6 " Diameter 2 2. A Right-of-Way marke survey monument and complete-in-place, sha a unit. 3. All markers shall be put the plans or as direct 4. Frames may be either 5. Frames shall weigh at 6. Covers shall weigh at 6. Covers shall weigh at 1/4 " R	er, consisting of a a reference marker, all be considered  placed as shown on ted by the Engineer.  Type A or Type B.  I least 16 pounds.  the frame and
Std Dwg C-21.20  Chamfer 34.  Two Coats Wille Enamel  Letters - Gloss Black Enamel  12. From Page 12. From 12.	The state of the s	all be magnetically cture thickness,
May be Poured to Neat Lines Diameter Minimum  ELEVATION SURVEY MONUMENT  RIGHT-OF-WAY MARKER		ZONA SPORTATION 5/07 DRAWINGS


NO	DESCRIPTION OF REVISIONS	MADE BY	DATE
$\Box$	REVISED GENERAL NOTES	RLF	9/04
2	REVISED SHANK DESIGN CRITERIA	RLF	9/04
(3)	ADDED DETAIL A - RIGHT-OF-WAY MARKER INFORMATION	RLF	9/04
(4)			



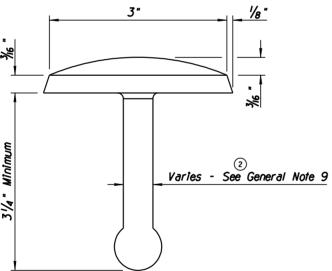

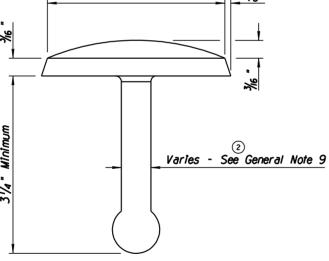

**ELEVATION** SURVEY MARKER



DETAIL A R/W MARKER INFORMATION 3



- 1. Survey marker may be used with survey monument, and as bench or R/W markers.
- Survey marker will be furnished by the Department. Cast-in lettering format may vary.
- 3. When used to define section lines, the marker shall be stamped in accordance with the BLM "Manual of Surveying
- 4. When used to define R/W not consisting of section lines, the marker shall be stamped in accordance with Detail A, R/W Marker information.
- 5. When used as a R/W marker or to define a section line, the land surveyor's registration number shall be stamped on the marker.
- 6. Bench marks shall be established on headwalls, bridge walls and other permanent structures, as shown on plans or as directed by the Engineer.
- 7. Station, elevation, year, and/or other information shall be hand stamped in field, as approved by the Engineer.
- 8. Survey marker shall be made of brass.
- 9. Shank cross-sectional area shall be a minimum of 0.31 square inches and a maximum of 0.60 square inches. Shank cross-section may vary and is not a critical feature of this standard.
- 10. Shank geometry shall provide for secure anchorage in concrete.
- 11. Text shall not obscure survey point.
- ▲ Right-Of-Way plan number
- Point Number
- Registered Land Surveyor Number See General Note 5

May Vipauna	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION ROADWAY STANDARD DRAWINGS		5/07
APPROVED FOR DISTRIBUTION	SURVEY MARKER	DRAWING	NO. 3-21.20