
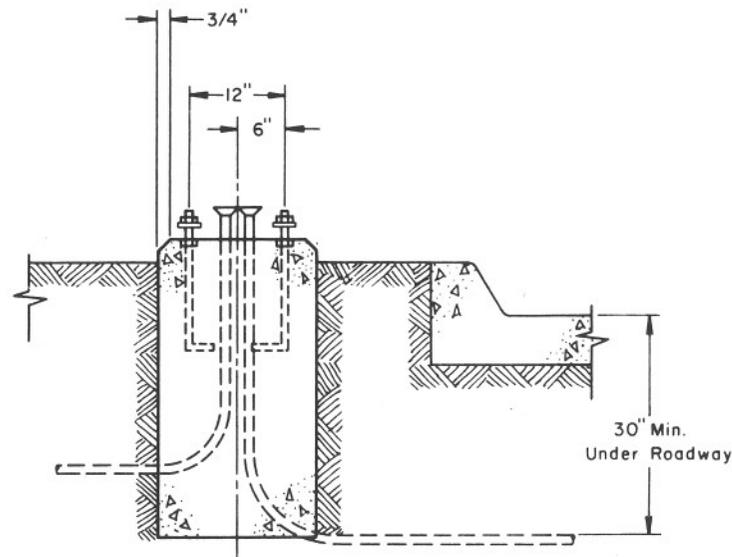


Back side of foundation shall be increased 5" when service enclosure on T.S. 3-14 is required as shown on plans.

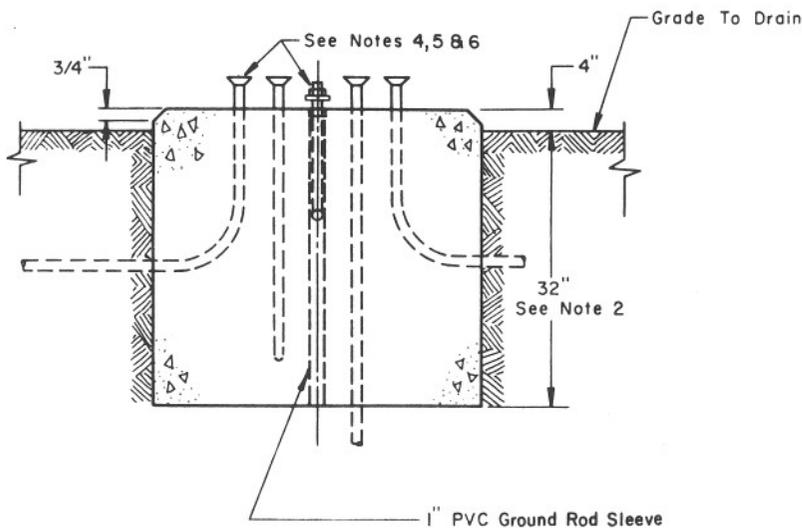

**NOTES:**

1. All materials and construction shall conform to the requirements of the Specifications.
2. Unstable soil may require deeper foundations. See Specifications.
3. For conduit size, location, and quantity, see plans.
4. Anchor bolts shall be galvanized steel, 3/4" x 16" x 3" complete with nuts and washers.
5. Anchor bolt projection above foundation shall be 2" min. and 2 1/2" max.
6. Conduit projection above foundation shall be 2" min. 4" max.
7. Use grout, or mastic, to seal gap between cabinet and foundation.
8. In unpaved areas a raised PCC pad 36" x 4" x width of foundation shall be placed in front of cabinet. Pad shall be set 2" below the foundation elevation. Slope pad away from cabinet. See pad detail on T.S. 2-1.
9. All cabinet foundations shall have a 5/8" x 10' Bonded Copper Ground Rod.
10. Install 2-2" conduits for future use stubbed and capped 2' past the edge of the foundation as directed by the engineer.

DESIGN APPROVED <i>[Signature]</i> 12/14/87	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION DIVISION OF HIGHWAYS STANDARD DRAWINGS	REV II-23-87
APPROVED FOR DISTRIBUTION <i>[Signature]</i>	FOUNDATION FOR TYPE III CONTROL CABINET	DRAWING NO. T.S. 2-2