


240 V. Lighting shall be un-metered when called for on plans.

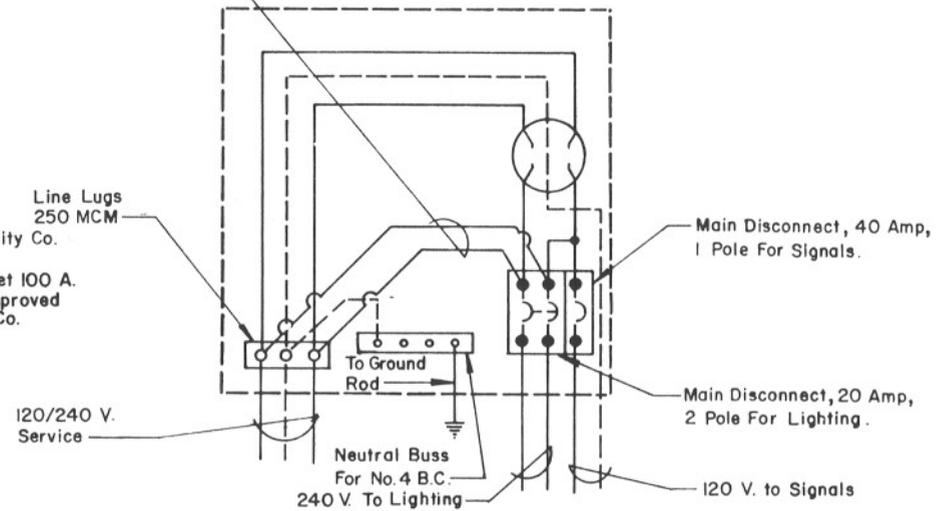

WIRING DETAIL

NOTES:

1. Circuit breaker sizes shall be as shown unless specified otherwise.
2. Circuit breakers shall be the molded case, thermal magnetic, plug-in type with a minimum fault interrupting capacity of 10,000 amperes.
3. The meter pedestal cabinet shall be NEMA 3R rated.

DESIGN APPROVED <i>Bill Brown</i> 7/24/65	STATE OF ARIZONA DEPARTMENT OF TRANSPORTATION DIVISION OF HIGHWAYS STANDARD DRAWINGS	REV.
APPROVED FOR DISTRIBUTION <i>[Signature]</i>	METER PEDESTAL CABINET	DRAWING NO. T.S. 3-16